

Amerimax Exterior Home Products Alumawood™ Patio Cover, Carport and Commercial Structure Engineering 2018 IBC

PAGES	DRAWING	SECTION DESCRIPTION
2 PAGES	GN01-2018 GN02-2018	GENERAL NOTES
1 PAGE		PROFESSIONAL ENGINEERING STAMPS PAGE
2 PAGES	SC01-2018 SC02-2018	SOLID PANEL STRUCTURAL CONFIGURATIONS ALUMAWOOD STRUCTURAL CONFIGURATIONS
4 PAGES		SECTION 1.0 RAFTER SPANS FOR COMMERCIAL AND PATIO STRUCTURES
38 PAGES		SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS
4 PAGES	LT01-2018 LT02-2018 LT03-2018 LT04-2018	COMPONENT PARTS AND CONNECTION DETAILS FOR LATTICE STRUCTURES
7 PAGES		SECTION 4.0 SOLID COVER PANEL SPANS FOR COMMERCIAL AND PATIO STRUCTURES
51 PAGES		SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS
4 PAGES	NP01-2018 NP02-2018 NP03-2018 NP04-2018	COMPONENT PARTS AND CONNECTION DETAILS FOR NEWPORTS
9 PAGES	CD01-2018 CD02-2018 CD03-2018 CD04-2018 CD05-2018 CD06-2018 CD07-2018 CD08-2018 CD09-2018	COMPONENT PARTS AND CONNECTION DETAILS
11 PAGES	Misc1a-2018 Misc1b-2018 Misc2-2018 Misc3-2018 Misc4a-2018 Misc4b-2018 Misc5a-2018 Misc5b-2018 Misc6-2018 Misc7-2018 Misc8-2018	MISCELLANEOUS DETAILS MISCELLANEOUS DETAILS FAN BEAM DETAILS 7.0 POST AND FASTENER REQUIREMENTS FOR ALL STRUCTURES 7.0 ALTERNATIVE FOOTING TABLES 7.0 ALTERNATIVE FOOTING TABLES 7.0 REQUIREMENTS FOR SURFACE MOUNTED POSTS ON CONCRETE SLABS OR FOOTINGS 7.0 REQUIREMENTS FOR SURFACE MOUNTED POSTS ON CONCRETE SLABS OR FOOTINGS 7.0 FORCES ON EXISTING STRUCTURES STRUCTURAL PROPERTIES OF BEAMS, FASCIA, PANELS AND RAFTERS FOR USE BY DESIGN PROFESSIONALS CONCRETE SLAB REQUIREMENTS FOR CONSTRAINED FOOTINGS



MAY 03 2019

March 18, 2019

GENERAL NOTES:

- DESIGNED IN ACCORDANCE WITH THE 2018 INTERNATIONAL BUILDING CODE.
- ALUMINUM DESIGN IN ACCORDANCE WITH THE 2015 EDITION OF ALUMINUM ASSOCIATION'S SPECIFICATIONS AND CHAPTER 20 OF THE INTERNATIONAL BUILDING CODE.
- DESIGN LOADINGS: $C_t = 1.2$, $I = 1.0$, $C_e = 1.0$ (ALL EXPOSURES EXCEPT B AND C WHEN LOCATED TIGHT AMONG CONIFERS)

GROUND SNOW LOAD	DESIGN LOAD
10 PSF	10 PSF LIVE LOAD ONLY
15 PSF	15 PSF DESIGN ROOF SNOW LOAD
20 PSF	20 PSF LIVE LOAD ONLY
25 PSF	21.0 PSF DESIGN ROOF SNOW LOAD
30 PSF	25.2 PSF DESIGN ROOF SNOW LOAD
35.7 PSF	30.0 PSF DESIGN ROOF SNOW LOAD
42 PSF	35.3 PSF DESIGN ROOF SNOW LOAD
50 PSF	42.0 PSF DESIGN ROOF SNOW LOAD
60 PSF	50.4 PSF DESIGN ROOF SNOW LOAD

FOR $0.25/12 < \text{SLOPE} < 1/12$

WIND SPEEDS IN THE 2018 IBC ARE "ULTIMATE DESIGN WIND SPEED". ALL STRUCTURES DESCRIBED IN THIS REPORT ARE DESIGNED USING PRESSURES CALCULATED FROM "ULTIMATE DESIGN WIND SPEEDS" FOR RISK CATEGORY II. FOR ATTACHED STRUCTURES THE MAXIMUM MEAN ROOF HEIGHT OF THE EXISTING STRUCTURE IS 30'. K_{zt} WAS ASSUMED AS 1.0 FOR ALL WIND LOADS. SITE LOCATIONS REQUIRING HIGHER A HIGHER K_{zt} VALUE (ISOLATED HILLS, RIDGES, ESCARPMENTS) WILL REQUIRE HIGHER WIND LOADS AS PER ASCE7-16 SECTION 26.8 AND ARE OUTSIDE THE SCOPE OF THIS REPORT.

NOTE: EXPOSURE B: SHALL APPLY WHEN THE GROUND SURFACE ROUGHNESS CATEGORY B (URBAN AND SUBURBAN AREAS, WOODED AREAS, OR OTHER TERRAIN W/ NUMEROUS CLOSELY SPACED OBSTRUCTIONS HAVING THE SIZE OF A SINGLE FAMILY DWELLING OR LARGER) PREVAILS IN THE UPWIND DIRECTION FOR A DISTANCE OF AT LEAST 1500 FT.

EXPOSURE C: SHALL APPLY WHEN EXPOSURE B AND D (SMOOTH MUD FLATS, SALT FLATS, UNBROKEN ICE AND OTHER) DO NOT.

SEISMIC LOADING

MAXIMUM $S_s = 150\%$ SHOWN IN 2018 IBC FIGURE 1613.2.1(1)

$S_s > 150\%$ ARE NOT REQUIRED AS PER ASCE7-16 12.8.1.3 FOR $S_s < 215\%$

S1 NOT APPLICABLE TO THESE STRUCTURES

SITE CLASS = D

BASIC SEISMIC FORCE RESISTING SYSTEM

POSTS EMBEDDED INTO FOOTINGS = ORDINARY STEEL MOMENT FRAME $\gg R = 1.25$

POSTS SURFACE MOUNTED = GENERIC SYSTEM $\gg R = 1.25$

ANALYSIS PROCEDURE = EQUIVALENT LATERAL FORCE PROCEDURE

THESE ROOFS ARE NOT SUBJECT TO MAINTENANCE WORKERS AND HAVE NOT BEEN EVALUATED FOR A CONCENTRATED 300 LBF LOAD.

THE BASIS OF THE DESIGN FORCES ARE IN ACCORDANCE WITH THE BASIC LOAD COMBINATIONS DESCRIBED IN 2018 IBC SECTION 1605.3.1 AND NO FURTHER INCREASES ARE PERMITTED FOR PATIO COVERS RESISTING WIND OR SEISMIC FORCES.

- THIS ENTIRE ENGINEERING PACKAGE IS NOT REQUIRED FOR MOST BUILDING PERMITS. SUBMISSION FOR A BUILDING PERMIT MUST INCLUDE:
 - GENERAL NOTES (2 PAGES)
 - STRUCTURAL CONFIGURATIONS (1 OR 2 PAGES)
 - RAFTER SPAN TABLES (FOR LATTICE STRUCTURES), PANEL SPAN TABLES FOR SOLID COVER STRUCTURES) OR BOTH (FOR COMBINATION STRUCTURES)
 - HEADER POST SPACING, FOOTING SIZE AND POST TABLE FOR LIVE/SNOW AND WIND LOAD
 - ALL APPROPRIATE DETAILS
 - OTHER DOCUMENTATION REQUIRED BY LOCAL BUILDING AUTHORITY.

5. CONCRETE MIX: CONCRETE WILL MEET THE DURABILITY REQUIREMENTS OF ACI 318-14. PATIO STRUCTURES MAY BE ATTACHED TO CONCRETE SLAB WITHOUT FOOTINGS WHEN THE POST LOAD IS 750# OR LESS AND THE FROST DEPTH IS ZERO. CONCRETE SHALL BE A MINIMUM OF 3.5 INCHES THICK AND NO CRACKS WITHIN 2'-6" OF POSTS. POSTS AND CONCRETE ANCHORS SHALL BE SET BACK A MINIMUM OF 4 INCHES FROM EDGE OR EXPANSION JOINT OF A SLAB.

6. FOOTINGS HAVE BEEN DESIGNED FOR CLASS 5 SOIL AS PER 2018 IBC TABLE 1806.2. ALLOWABLE FOUNDATION PRESSURE IS 1500 POUNDS PER SQUARE FOOT. LATERAL BEARING PRESSURE IS 100 PSF/FT AND IS DOUBLED PER 2018 IBC SECTION 1806.3.4. THESE DESIGN VALUES DO NOT APPLY TO MUD, ORGANIC SILTS, ORGANIC CLAYS, PEAT OR UNPREPARED FILLS AND MAY REQUIRE FURTHER SOIL INVESTIGATION. THE BUILDING OFFICIAL MAY ASSIGN A LOAD BEARING CAPACITY. UNITS IN SNOW/LIVE LOAD AREA OF 25 PSF OR LESS MAY BE BUILT ON 1000 PSF BEARING SOIL W/O ADDITIONAL ENGINEERING. MINIMUM FOOTING DEPTH IS THE LOCAL FROST DEPTH.


7. 20 PSF AND HIGHER LIVE LOAD STRUCTURES MAY BE USED AS COVERS FOR PARKING OF MOTOR VEHICLES. CARPORTS MUST HAVE AT LEAST TWO OPEN SIDES AND HAVE FLOOR SURFACES MADE OF APPROVED NONCOMBUSTIBLE MATERIAL OR ASPHALT.

8. AT LEAST ONE HORIZONTAL DIMENSION (PROJECTION OR WIDTH) OF COVER SHALL BE LESS THAN 30'.

9. ALL STEEL SHALL BE GALVANIZED ASTM A-653 G90, A123 G45 OR A153 B-3, PAINTED ASTM A755 OR USE AN APPROVED COATING COMPLYING WITH 2018 IBC SECTION 2203.1.

10. ALTERNATE ALUMINUM ALLOYS OF EQUAL OR HIGHER STRENGTHS MAY BE USED. 3004H2x ALUMINUM MAY BE SUBSTITUTED FOR 3004H3x.



		28921 US Hwy 74 Romoland, CA 92585	
EXTERIOR HOME PRODUCTS			
DRAWN BY:	CMP	DRAWING OR PART NAME: GENERAL NOTES	
SCALE:	NONE	DRAWING OR PART NUMBER:	GN01-2018
DATE:			SHEET 1 OF 2

GENERAL NOTES:
(CONTINUED FROM SHEET NO. 1)

11. STEEL FASTENERS SHALL BE EITHER STAINLESS (3000 SERIES), GALVANIZED OR DOUBLE CADMIUM PLATED. BOLTS SHALL BE ASTM A-307 HOT DIPPED GALVANIZED, MECHANICALLY GALVANIZED, ZINC ELECTROPLATED, ALUMINIZED OR 300 SERIES STAINLESS STEEL. CONCRETE ANCHOR BOLTS ARE SPECIFIED IN THE DETAILS. ALL WOOD SCREWS MUST COMPLY WITH ANSI/ASME STANDARD B18.6.1 AND AWC NDS-18 12.1.5. ALL LAG SCREWS MUST COMPLY WITH ANSI/ASME B18.2.1 AND AWC NDS-18 12.1.4. ALL STEEL WASHERS TO BE ASTM F844 W/ DIMENSIONS IN ACCORDANCE WITH ASME B18.22.1, TYPE A. ALL STEEL NUTS TO BE ASTM A563. THE MINIMUM WASHER DIAMETER SHALL BE 1" FOR BOLTED CONNECTIONS. SCREWS AND BOLTS WILL HAVE A MINIMUM EDGE DISTANCE OF 2X FASTENER DIAMETER.

12. EMBEDDED POST SURFACES SHALL BE CLEAN AND FREE FROM OILY SURFACES.

13. HEADER SPLICES SHALL NOT BE LOCATED NEARER TO THE END OF THE STRUCTURE THAN THE FIRST INTERIOR POST. (EXCEPT FOR FULL STRENGTH SPLICES) FULL STRENGTH SPLICES (DETAILS U, AND X) MAY BE LOCATED ANYWHERE.

14. ALL SELF DRILLING AND SELF TAPPING SCREWS MUST COMPLY TO ICC- ESR 1271, 1408, 1976, 2196, 3006, 3215, 3223, 3231, 3294, 3332, 3528, 3558 OR EQUIVALENT AND USE HEADS W/ DIAMETERS EQUAL TO #8 = $\frac{5}{16}$ " , #10 = $\frac{3}{8}$ " , #12 = $\frac{13}{32}$ " AND #14 = $\frac{1}{2}$ " OR STEEL WASHERS OF SIMILAR DIAMETER AND AS PER GENERAL NOTE #11

15. STRUCTURES MAY NOT BE ENCLOSED IN ANY MANNER WITHOUT ADDITIONAL ENGINEERING ANALYSIS OR APPROVAL OF THE LOCAL BUILDING AUTHORITY.

16. ALUMINUM SOLID ROOF PANELS ARE CLASS A FIRE RATED AS INDICATED BY THE EXCEPTION #2 IN 2018 IBC SECTION 1505.2. ALUMINUM IS A NONCOMBUSTIBLE MATERIAL AS PER 2018 IBC CHAPTER 20 AND THE ALUM ASSOC. 2015 ALUMINUM DESIGN MANUAL (AA ADM 1) PART III SECTION 7.

17. STRUCTURES MAY BE ATTACHED TO EAVE OVERHANGS PER SCHEDULE.

18. WHERE ALUMINUM ALLOY PARTS ARE IN CONTACT WITH DISSIMILAR METALS (OTHER THAN STAINLESS, ALUMINIZED OR GALVANIZED STEEL) OR ABSORBENT BUILDING MATERIALS, LIKELY TO BE CONTINUOUSLY OR INTERMITTENTLY WET, THE FAYING SURFACES SHALL BE PAINTED OR OTHERWISE SEPARATED IN ACCORDANCE WITH THE ALUMINUM DESIGN MANUAL PART I SECTION M7.1 OR M7.2.

19. WHEN A SINGLE SPAN ATTACHED UNIT HAS POSTS ATTACHED TO A WOODEN DECK, THE MAXIMUM DEAD LOAD + ROOF LOAD FROM THE PATIO COVER IS 750 LBS AND THE POST SPACING SHALL NOT EXCEED THAT SPECIFIED FOR ATTACHING TO A CONCRETE SLAB. THE MAXIMUM CONNECTION UPLIFT LOAD IS 1162 LBS FOR 115 MPH EXP C WIND SPEED. CONNECTIONS ARE FOR MAXIMUM PATIO ROOF HEIGHTS OF 12 FT FROM GRADE. THE EXISTING DECK STRUCTURE MUST BE ADEQUATE TO SUSTAIN THESE ADDITIONAL LOADS. THE STRUCTURAL ADEQUACY OF THE DECK TO SAFELY SUSTAIN THESE ADDITIONAL LOADS WILL REQUIRE APPROVAL BY LOCAL BUILDING AUTHORITY OR ADDITIONAL ENGINEERING. SEE DETAIL L13, N12 OR AL. CONSTRUCTION OUTSIDE OF THESE PARAMETERS MAY REQUIRE ADDITIONAL ENGINEERING.

20. **All structures must comply with one of the following:**
- a. **All structures with a roof snow load of 30 psf or less may be built in Seismic Design Category (SDC) A-D up to the maximum Ss noted in General Note #3.**
 - b. **Structures with flat roof design snow loads over 30 psf complying with IBC Section 1613.1 Exception #1 do not require additional seismic analysis.**
 - c. **Structures not complying with (a) or (b) must have constrained footings and are limited to the Ss shown in Sections 2.0 or 5.0.**

21. DRIFTING SNOW IS ADDRESSED IN DETAIL M4. SLIDING SNOW IS BEYOND THE SCOPE OF THIS REPORT.

22. ALL MULTISPAN TABLES AND DETAILS ASSUME EQUAL SPANS WITHIN 20%. ALL SPECIFICATIONS MUST BE BASED ON LONGEST ACTUAL SPAN.


23. WOOD USED IN CONNECTIONS SHALL BE PROTECTED FROM WEATHER AS PER IBC SECTION 1402.2 (WALLS) AND/OR 1503 (ROOFS), WHICHEVER IS MORE APPROPRIATE.

24. AT LEAST ONE HORIZONTAL DIMENSION OF A FREESTANDING COVER (PROJECTION OR WIDTH) SHALL BE LESS THAN 30'

GENERAL NOTES FOR LATTICE STRUCTURES:
(PERTAINS TO LATTICE STRUCTURES ON DRAWINGS SC02-2018 AND LT01-2018 THRU LT04-2018.)


- 1. SEE GENERAL NOTE #3 FOR LIVE AND SNOW LOADS.
- 2. NOTE INTENTIONALLY LEFT BLANK.
- 3. SINGLE SPAN ATTACHED LATTICE STRUCTURES THAT DO NOT USE DETAIL L29 MUST COMPLY WITH TABLE L1 AND L2 ON SHEET M5.



		28921 US Hwy 74 Romoland, CA 92585	
		EXTERIOR HOME PRODUCTS	
DRAWN BY:	CMP	DRAWING OR PART NAME:	GENERAL NOTES
SCALE:	NONE	DRAWING OR PART:	GN02-2018
DATE:			SHEET 2 OF 2

MAY 03 2019





PROFESSIONAL ENGINEERING STAMPS PAGE

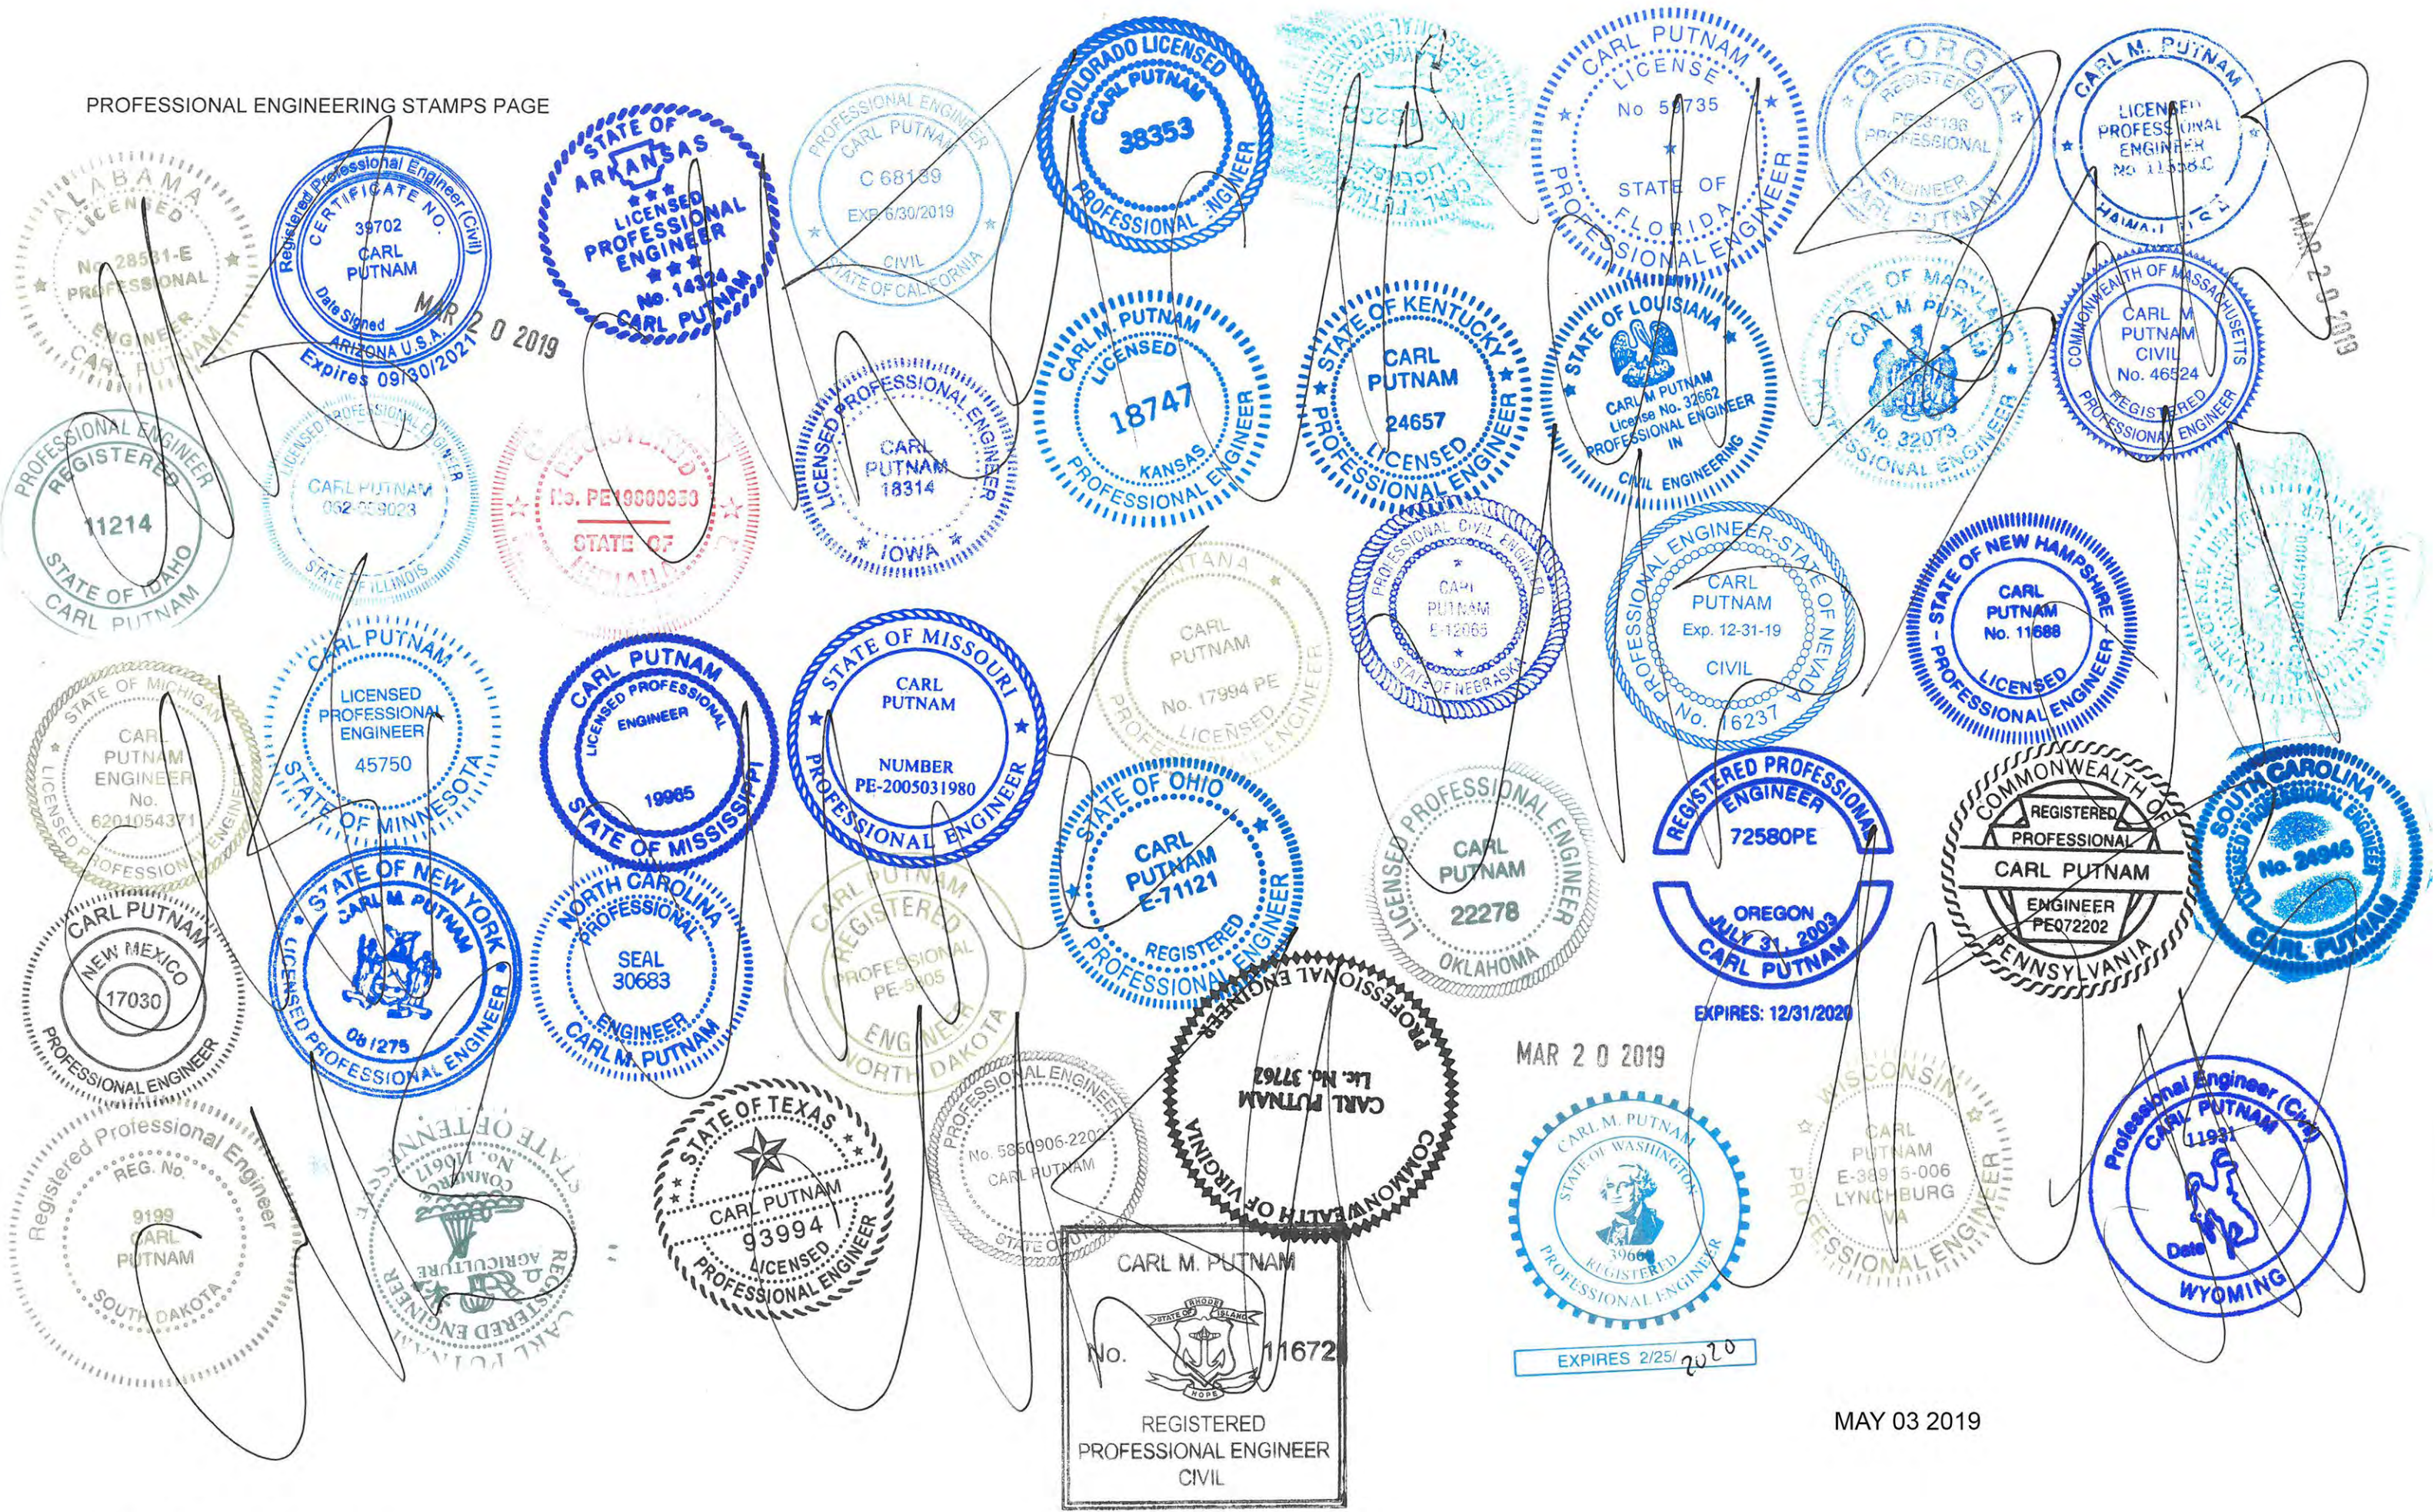


CARL M. PUTNAM
No. 11672
REGISTERED PROFESSIONAL ENGINEER
CIVIL

EXPIRES 2/25/2020


MAY 03 2019

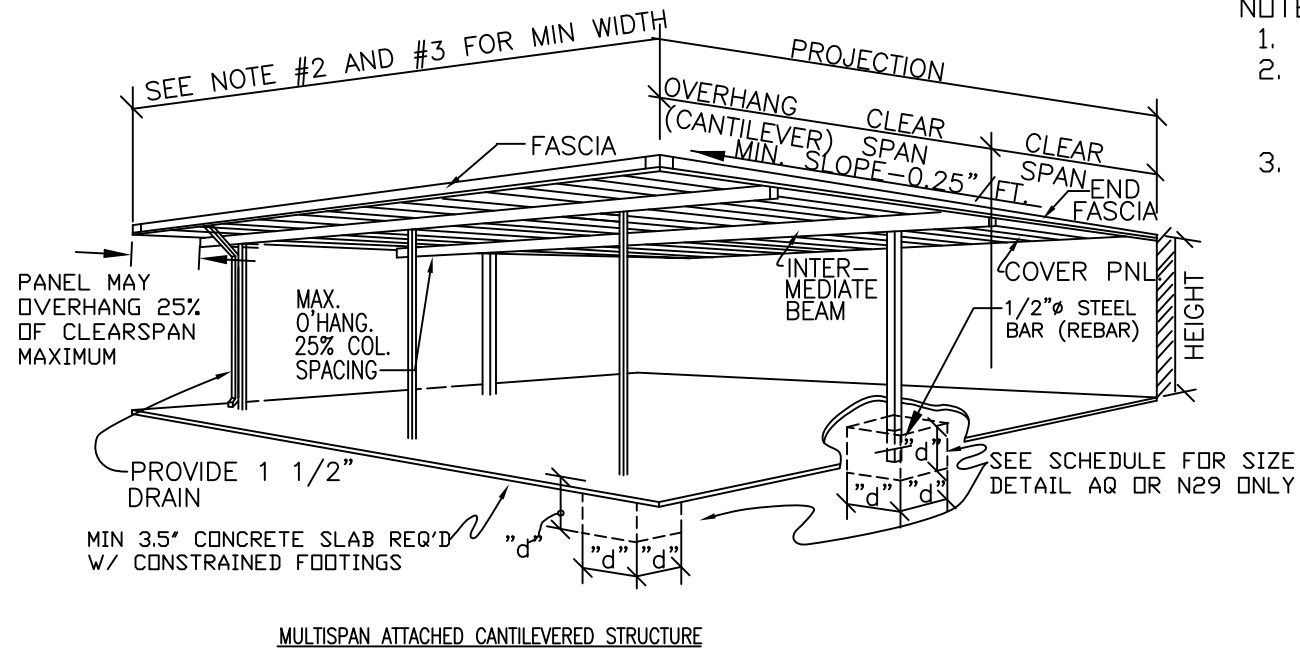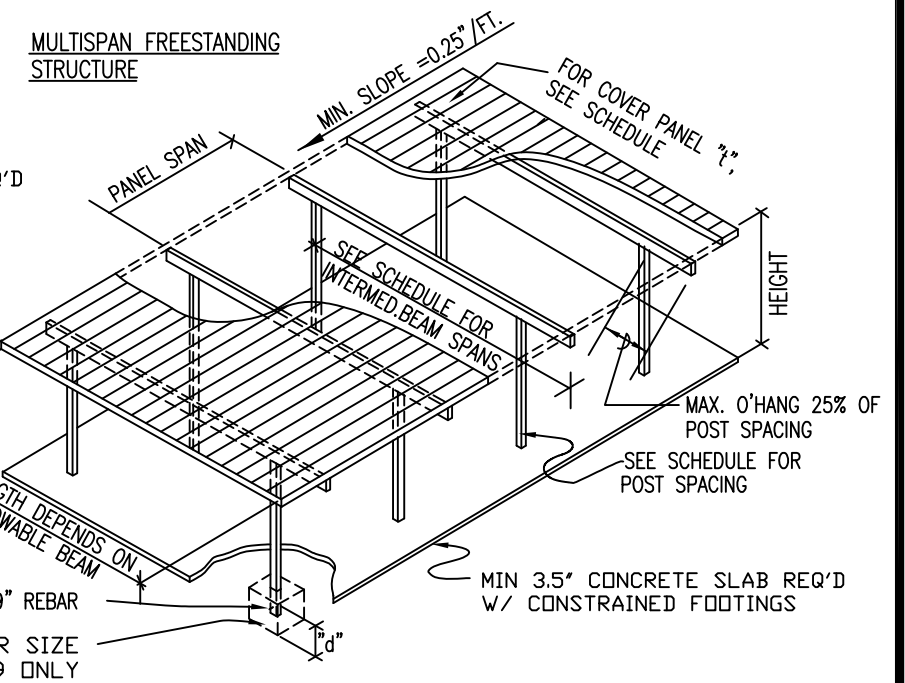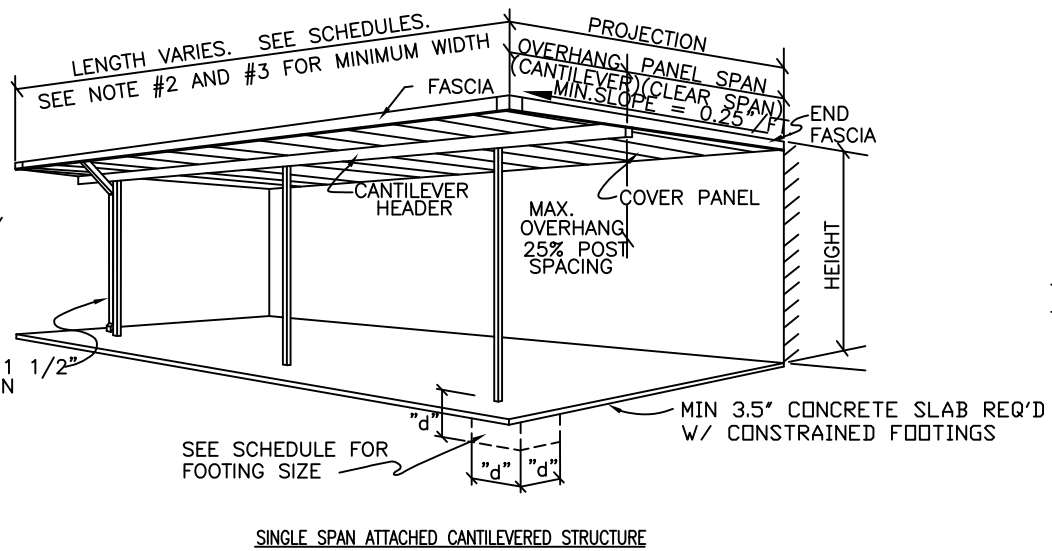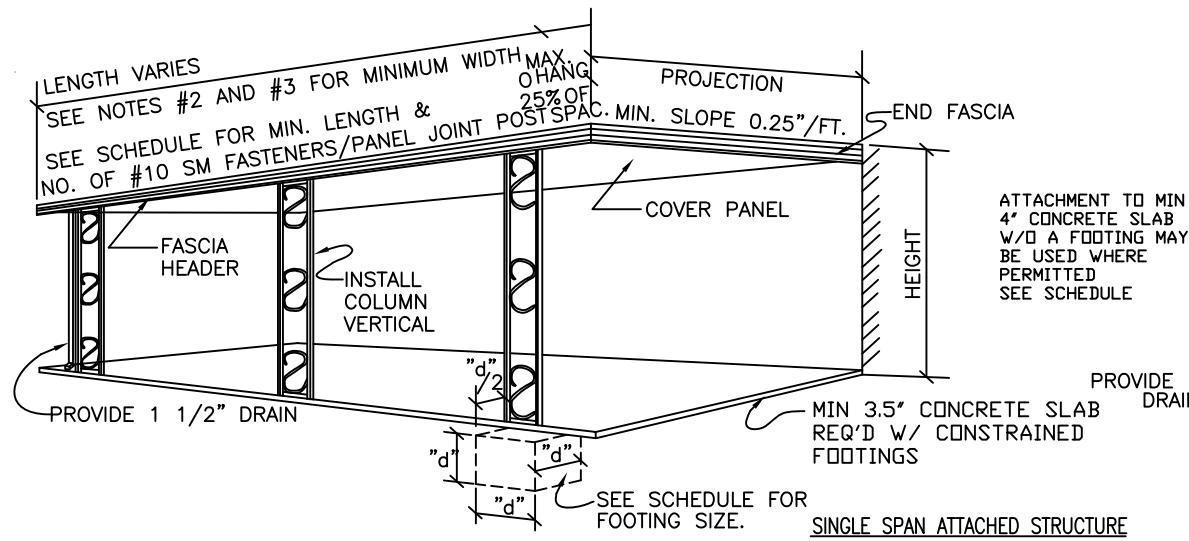

- NOTES:
1. SEE SCHEDULES FOR POST SPACING FOR WIND SPEEDS UP TO 115 MPH EXP. HIGHER WIND SPEEDS MUST BE 150%.
 2. MIN WIDTH IS 100% OF PROJECTION
 3. THERE IS NO MINIMUM WIDTH IF USING CONSTRAINED FOOTINGS AND DETAILS N29, AQ OR M5.






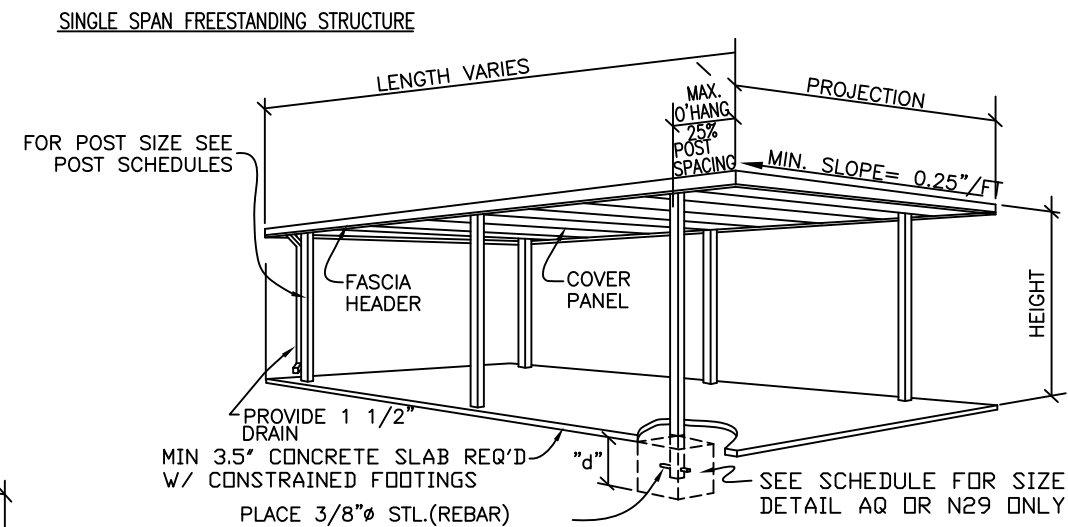


PATIO COVERS ARE LIMITED TO 12' HEIGHT. CARPORTS AND COMMERCIAL STRUCTURES ARE LIMITED TO 15' HEIGHT.

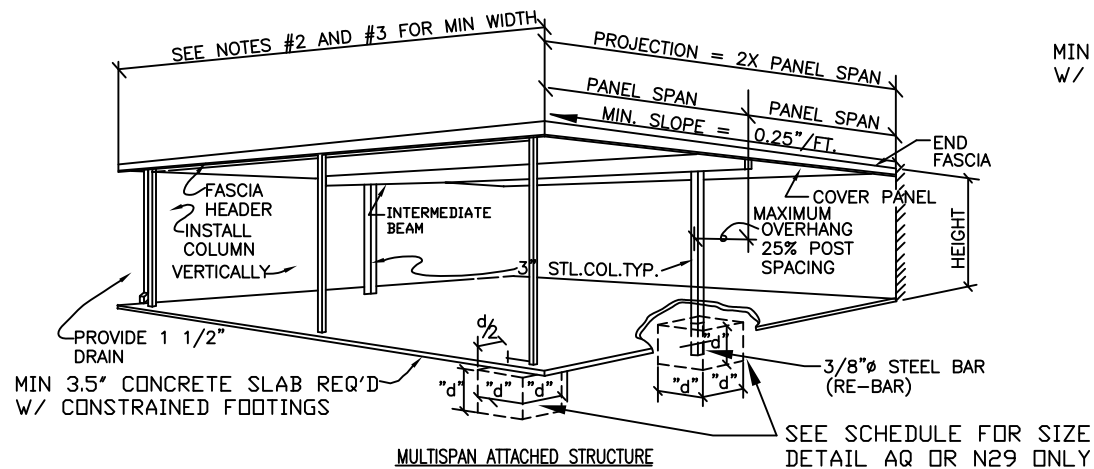

MAY 03 2019

		28921 US Hwy 74 Romoland, CA 92585	
		EXTERIOR HOME PRODUCTS	
DRAWN BY: CMP	DRAWING OR PART NAME SOLID PANEL STRUCTURAL CONFIGURATIONS		
SCALE: NONE	DRAWING OR PART NUMBER SC01-2018	SHEET 1 OF 2	
DATE:			

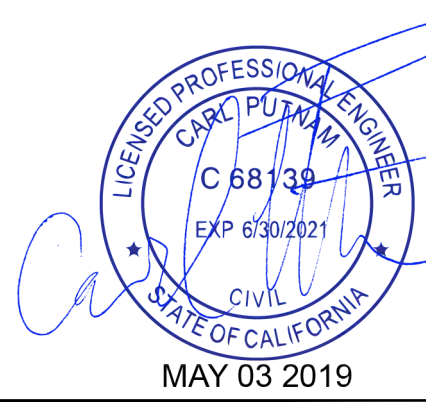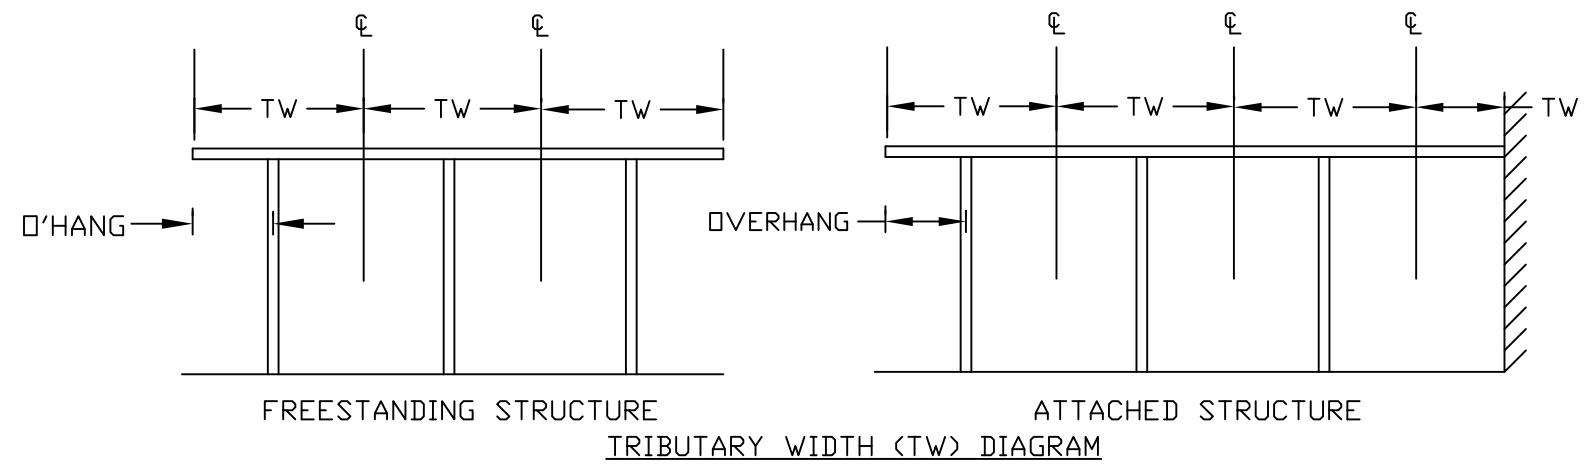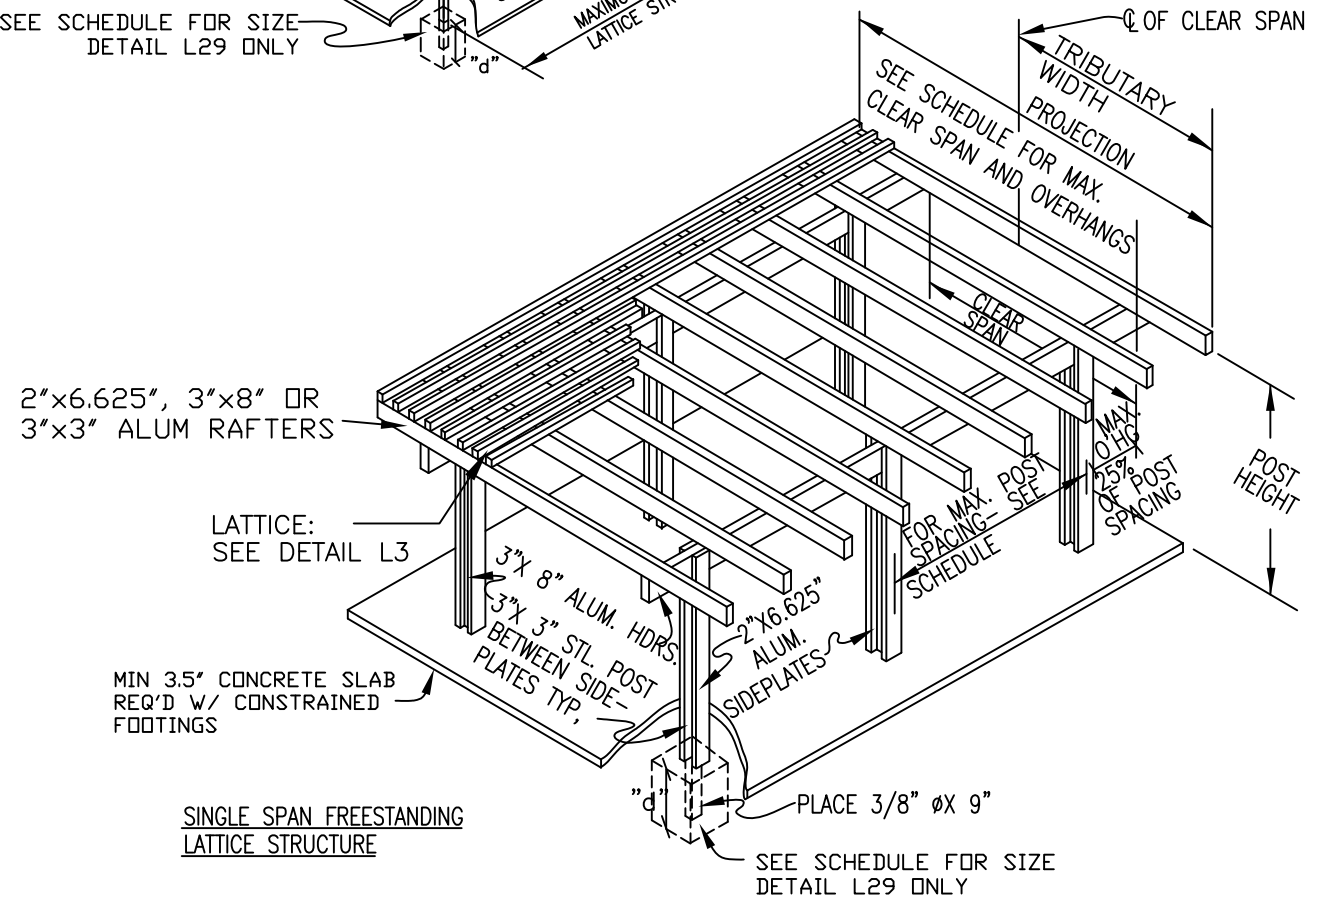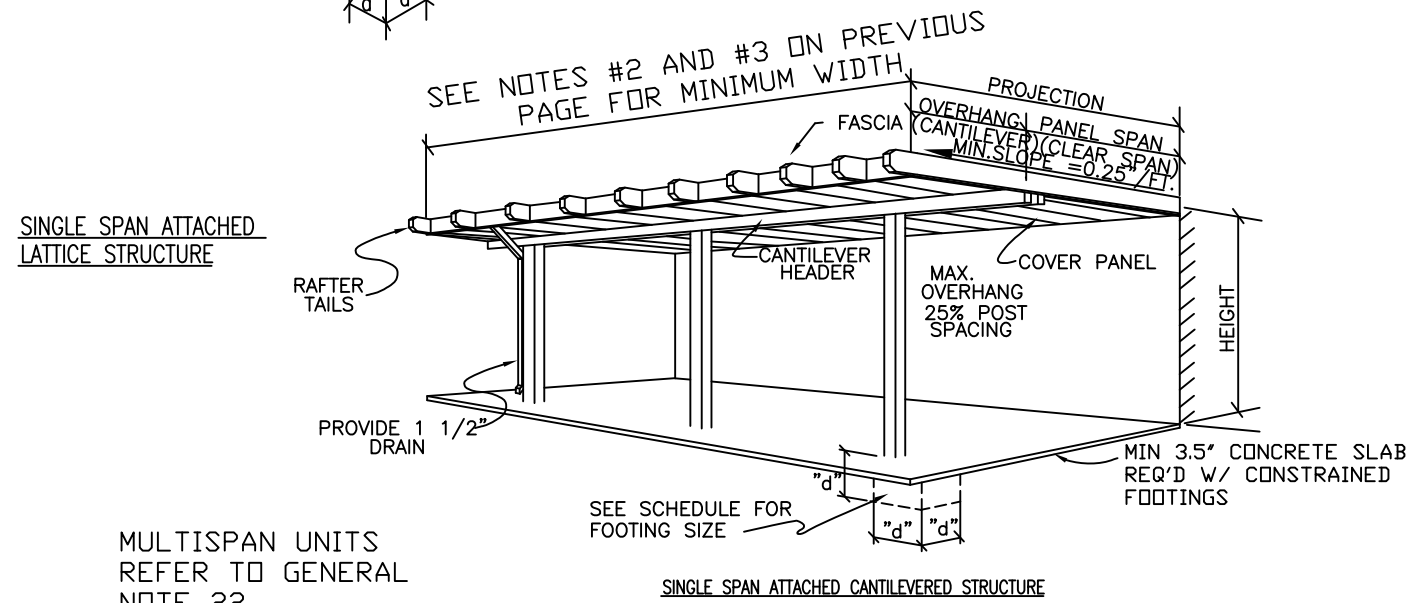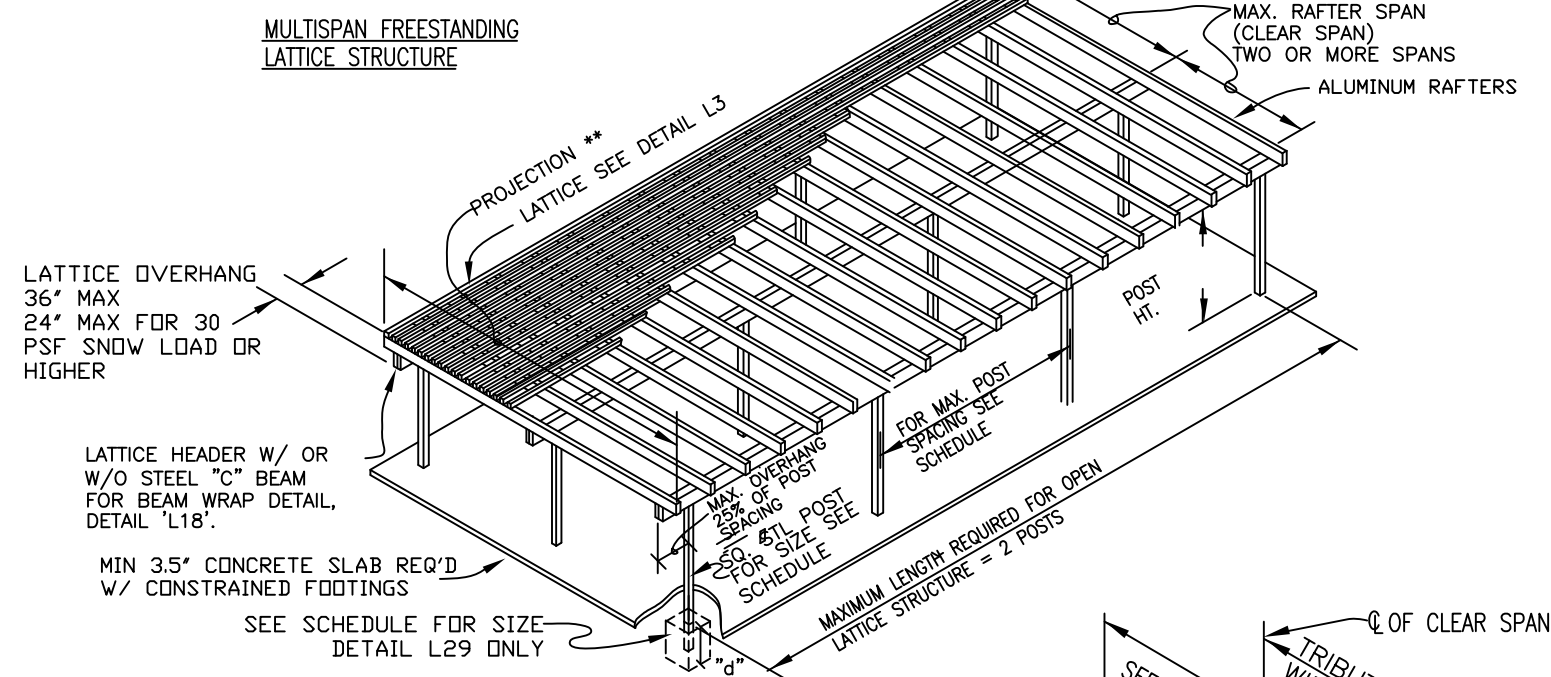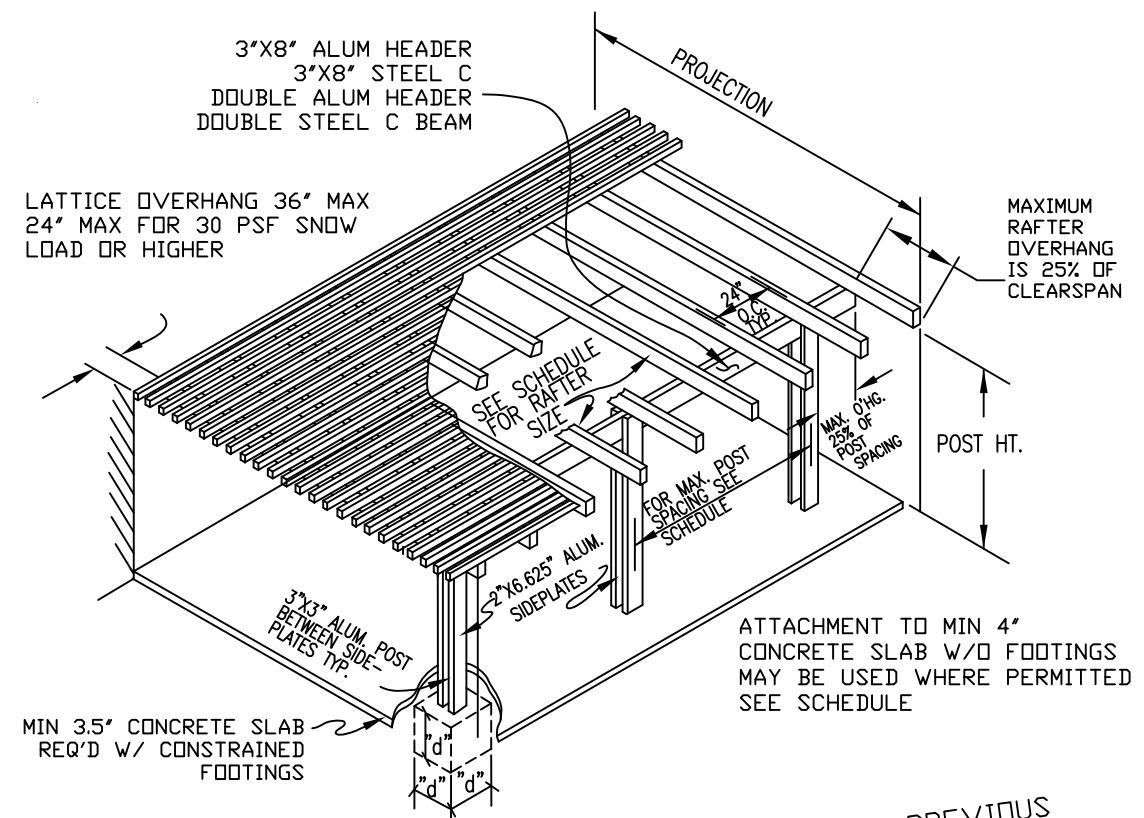

Amerimax		28921 US Hwy 74 Romoland, CA 92585	
EXTERIOR HOME PRODUCTS			
DRAWN BY:	CMP	DRAWING OR PART NAME ALUMAWOOD STRUCTURAL CONFIGURATIONS	
SCALE:	NONE	DRAWING OR PART NUMBER	SC02-2018
DATE:			SHEET 2 OF 2

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.3a: Grid of post spacing and footing size requirements for structures attached to existing buildings under various load conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Larchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.3b: Grid of post spacing and footing size requirements for freestanding structures under various load conditions.

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 105 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.3c: Grid of post spacing and footing size requirements for structures attached to existing buildings under 105 MPH wind exposure.



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.4a: Table with columns for footing dimensions (trib, Min Post, Uplift Footing, Constrained Footing) and rows for various materials like On Slab, 0.042"x3"x8", Double 2"x6".

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585


Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.4b: Table with columns for footing dimensions and rows for various materials like On Slab, 0.042"x3"x8", Double 2"x6".

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 105 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.4c: Table with columns for footing dimensions and rows for various materials like On Slab, 0.042"x3"x8", Double 2"x6".

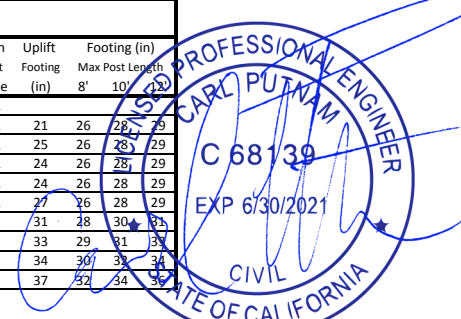

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.5a: Design table for lattice covers with 11 psf roof design load and 130 MPH wind speed. Columns include footing type, post type, and footing length for various slab and steel deck configurations.


Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 14 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.5b: Design table for lattice covers with 14 psf roof design load and 130 MPH wind speed. Columns include footing type, post type, and footing length for various slab and steel deck configurations.

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.5c: Design table for lattice covers with 11 psf roof design load and 120 MPH wind speed. Columns include footing type, post type, and footing length for various slab and steel deck configurations.

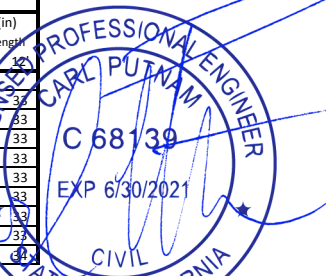

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 14 psf Wind Speed: 150 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Structures are Attached to Existing Building

Table 2.6a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
		trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length																
On Slab	On Slab	22'-8"	A1	23	22	23	24	19'-5"	A1	23	22	23	24	17'-0"	A1	23	22	23	24	15'-1"	A1	23	22	23	24	13'-7"	A1	23	22	23	24	11'-4"	A1	23	22	23	24	9'-1"	A1	23	22	23	24	8'-6"	A1	23	22	23	24
0.042"x3"x8"	L1	10'-2"	A1	23	22	23	24	9'-4"	A1	24	23	24	25	8'-7"	A1	24	23	25	26	8'-0"	A1	25	24	26	27	7'-6"	A1	25	25	26	28	7'-0"	A1	25	25	27	28	6'-8"	A1	25	26	28	29	6'-4"	A1	26	27	29	30

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 19 psf Wind Speed: 150 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Freestanding Structures


Table 2.6b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
		trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length								
On Slab	On Slab	22'-8"	A1	23	31	33	34	19'-5"	A1	23	30	32	34	17'-0"	A1	23	30	31	33	15'-1"	A1	24	29	31	32	13'-7"	A1	24	29	30	32	12'-4"	A1	24	28	30	31	11'-4"	A1	24	28	30	31	9'-1"	A1	24	27	29	30

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 12 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.6c

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
		trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length								
On Slab	On Slab	22'-8"	A1	21	29	31	32	19'-5"	A1	21	29	30	32	17'-0"	A1	21	28	29	31	15'-1"	A1	22	28	29	31	13'-7"	A1	22	27	29	30	12'-4"	A1	22	27	29	30	11'-4"	A1	23	27	28	29	9'-1"	A1	23	26	28	29

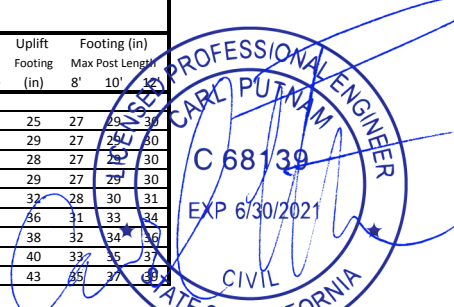

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 18 psf Wind Speed: 170 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Structures are Attached to Existing Building

Table 2.8a: Table with 20 columns for different footing types and 15 rows of structural details including On Slab, 0.042"x3"x8", Double 3"x8", Double 2"x6.625", 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, and Double 12 G Steel C.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 24 psf Wind Speed: 170 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Freestanding Structures

Table 2.8b: Table with 20 columns for different footing types and 15 rows of structural details including On Slab, 0.042"x3"x8", Double 3"x8", Double 2"x6.625", 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, and Double 12 G Steel C.

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 140 MPH EXPOSURE C or 160 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.8c: Table with 20 columns for different footing types and 15 rows of structural details including On Slab, 0.042"x3"x8", Double 3"x8", Double 2"x6.625", 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, and Double 12 G Steel C.



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 15 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 100% Seismic Design Category D Structures are Attached to Existing Building

Table 2.9a: Grid of post spacing and footing size requirements for structures attached to existing buildings. Columns include footing type (trib, min, uplift, constrained), footing length (8', 10', 12'), and footing width (3'-0" to 8'-0").

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Larchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 15 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 100% Seismic Design Category D Freestanding Structures

Table 2.9b: Grid of post spacing and footing size requirements for freestanding structures. Columns include footing type (trib, min, uplift, constrained), footing length (8', 10', 12'), and footing width (3'-0" to 8'-0").

Ground Snow Load: 15 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 110 MPH EXPOSURE B Seismic Ss= 100% Seismic Design Category D Structures are Attached to Existing Building

Table 2.9c: Grid of post spacing and footing size requirements for structures attached to existing buildings. Columns include footing type (trib, min, uplift, constrained), footing length (8', 10', 12'), and footing width (3'-0" to 8'-0").



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 15 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 100% Seismic Design Category D Structures are Attached to Existing Building

Table 2.10a: A grid with 30 columns representing different footing sizes (3' to 18') and 10 rows representing different cover types and materials (On Slab, L1, L1/L12, L2/L12, 16 G Steel C, L18, 12 G Steel C, L18/L8, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C). Each cell contains a type code and four numerical values representing footing dimensions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585


Carl Putnam, P. E. 3441 Ivylink Place Larchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 15 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 100% Seismic Design Category D Freestanding Structures

Table 2.10b: A grid with 30 columns representing different footing sizes (3' to 18') and 10 rows representing different cover types and materials (On Slab, L1, L1/L12, L2/L12, 16 G Steel C, L18, 12 G Steel C, L18/L8, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C). Each cell contains a type code and four numerical values representing footing dimensions.

Ground Snow Load: 15 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 110 MPH EXPOSURE B Seismic Ss= 100% Seismic Design Category D Freestanding Structures

Table 2.10c: A grid with 30 columns representing different footing sizes (3' to 18') and 10 rows representing different cover types and materials (On Slab, L1, L1/L12, L2/L12, 16 G Steel C, L18, 12 G Steel C, L18/L8, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C). Each cell contains a type code and four numerical values representing footing dimensions.

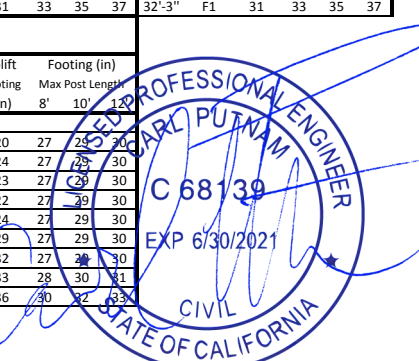

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 95 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.11a: Grid of post spacing and footing size data for attached structures under various load conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585


Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 95 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.11b: Grid of post spacing and footing size data for freestanding structures under various load conditions.

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.11c: Grid of post spacing and footing size data for attached structures under EXPOSURE C or 110 MPH EXPOSURE B conditions.

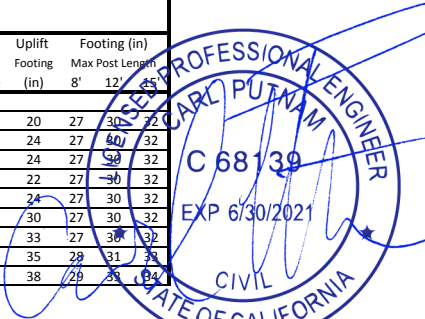

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.13a: Table with columns for 'trib', 'Min Post', 'Uplift Footing', 'Constrained Footing (in)', 'Max Post Length', and rows for various footing types (A1, A2, B, C, D, E, F1, F2, F3, F4) and materials (On Slab, L1, L1/L12, L2/L12, 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.13b: Table with columns for 'trib', 'Min Post', 'Uplift Footing', 'Constrained Footing (in)', 'Max Post Length', and rows for various footing types and materials, similar to Table 2.13a but for freestanding structures.

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.13c: Table with columns for 'trib', 'Min Post', 'Uplift Footing', 'Constrained Footing (in)', 'Max Post Length', and rows for various footing types and materials, similar to Table 2.13a but for 115 MPH exposure.



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.14a: Table with columns for member details (On Slab, L1, L1/L12, L2/L12, L18, L12 G Steel C, L18/L8, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C) and rows for footing types (A1, A2, B, C, D, E, F1, F2, F3, F4). Each cell contains footing dimensions and member sizes.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585


Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.14b: Table with columns for member details (On Slab, L1, L1/L12, L2/L12, L18, L12 G Steel C, L18, L18/L8, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C) and rows for footing types (A1, A2, B, C, D, E, F1, F2, F3, F4). Each cell contains footing dimensions and member sizes.

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.14c: Table with columns for member details (On Slab, L1, L1/L12, L2/L12, L18, L12 G Steel C, L18, L18/L8, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C) and rows for footing types (A1, A2, B, C, D, E, F1, F2, F3, F4). Each cell contains footing dimensions and member sizes.

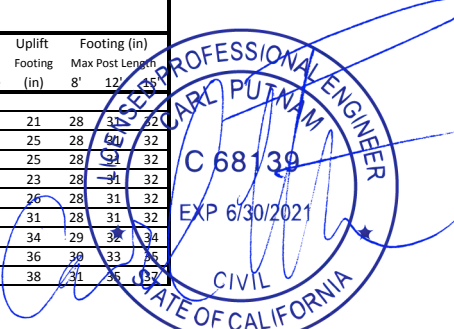

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 160 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Structures are Attached to Existing Building

Table 2.17a: Design table for lattice covers with 15 columns of post spacing and footing size options (e.g., 3'-10" A1, 3'-5" A1, etc.).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585


Carl Putnam, P. E. 3441 Ivylink Place Larchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 160 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Freestanding Structures

Table 2.17b: Design table for freestanding structures with 15 columns of post spacing and footing size options (e.g., 3'-11" A1, 3'-5" A1, etc.).

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 140 MPH EXPOSURE C or 160 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Structures are Attached to Existing Building

Table 2.17c: Design table for structures attached to existing building with 15 columns of post spacing and footing size options (e.g., 3'-10" A1, 3'-5" A1, etc.).

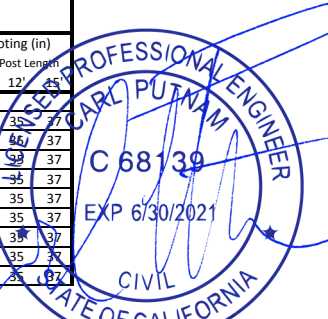

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 170 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Structures are Attached to Existing Building

Table 2.18a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																																																																																																																											
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)																																																																																																																												
On Slab	On Slab	11'-10"	A1			10'-2"	A1			8'-11"	A1			7'-11"	A1			6'-5"	A1			5'-11"	A1			4'-9"	A1			3'-11"	A1			2'-11"	A1			1'-11"	A1			10'-10"	A1			9'-10"	A1			8'-10"	A1			7'-10"	A1			6'-10"	A1			5'-10"	A1			4'-10"	A1			3'-10"	A1			2'-10"	A1			1'-10"	A1																																																																																										
0.042"x3"x8"	L1	8'-10"	A1	24	23	26	27	8'-0"	A1	25	24	27	28	7'-4"	A1	25	25	28	29	6'-9"	A1	25	26	29	30	6'-4"	A1	26	26	29	31	5'-11"	A1	26	27	30	32	5'-6"	A1	26	28	31	33	5'-3"	A1	26	28	31	33	4'-11"	A1	26	29	32	34	4'-8"	A1	27	29	33	34	4'-5"	A1	27	30	33	35	4'-2"	A1	27	31	34	36	3'-11"	A1	27	32	35	37	3'-8"	A1	28	24	27	28	3'-5"	A1	28	26	29	30	3'-2"	A1	28	28	31	33	2'-10"	A1	28	29	32	34	1'-10"	A1	28	29	32	34	10'-10"	A1	29	29	32	34	9'-10"	A1	29	32	34	36	8'-10"	A1	29	32	34	36	7'-10"	A1	29	32	34	36	6'-10"	A1	29	32	34	36	5'-10"	A1	29	32	34	36	4'-10"	A1	29	32	34	36	3'-10"	A1	29	32	34	36	2'-10"	A1	29	32	34	36	1'-10"	A1	29	32	34	36

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 24 psf Wind Speed: 170 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Freestanding Structures


Table 2.18b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																																																																																																																					
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)																																																																																																																		
On Slab	On Slab	11'-10"	A2			10'-2"	A2			8'-11"	A2			7'-11"	A2			6'-5"	A2			5'-11"	A2			4'-9"	A2			3'-11"	A2			2'-11"	A2			1'-11"	A2			10'-10"	A2			9'-10"	A2			8'-10"	A2			7'-10"	A2			6'-10"	A2			5'-10"	A2			4'-10"	A2			3'-10"	A2			2'-10"	A2			1'-10"	A2																																																																																				
0.042"x3"x8"	L1	9'-8"	A1	23	32	35	37	8'-10"	A1	24	31	35	37	8'-11"	A1	24	30	34	36	7'-6"	A1	24	30	33	35	7'-0"	A1	25	29	32	34	6'-8"	A1	25	29	32	34	6'-3"	A1	25	29	32	34	5'-11"	A1	25	29	32	34	5'-8"	A1	26	28	31	33	5'-5"	A1	26	28	31	33	5'-2"	A1	26	28	31	33	4'-10"	A1	26	29	32	34	4'-7"	A1	27	31	34	36	4'-4"	A1	27	31	34	36	4'-1"	A1	27	31	34	36	3'-9"	A1	27	31	34	36	3'-6"	A1	27	31	34	36	3'-3"	A1	27	31	34	36	3'-0"	A1	27	31	34	36	2'-11"	A1	27	31	34	36	2'-8"	A1	27	31	34	36	2'-5"	A1	27	31	34	36	2'-2"	A1	27	31	34	36	1'-11"	A1	27	31	34	36	1'-8"	A1	27	31	34	36	1'-5"	A1	27	31	34	36	1'-2"	A1	27	31	34	36

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 21 psf Wind Speed: 140 MPH EXPOSURE C or 160 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Freestanding Structures

Table 2.18c

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																																																																																																																					
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)																																																																																																																		
On Slab	On Slab	11'-10"	A1			10'-2"	A1			8'-11"	A1			7'-11"	A1			6'-5"	A1			5'-11"	A1			4'-9"	A1			3'-11"	A1			2'-11"	A1			1'-11"	A1			10'-10"	A1			9'-10"	A1			8'-10"	A1			7'-10"	A1			6'-10"	A1			5'-10"	A1			4'-10"	A1			3'-10"	A1			2'-10"	A1			1'-10"	A1																																																																																				
0.042"x3"x8"	L1	10'-5"	A1	21	29	33	35	9'-6"	A1	21	29	32	34	8'-8"	A1	21	28	31	33	7'-11"	A1	22	28	31	32	7'-2"	A1	22	27	30	32	6'-8"	A1	22	27	30	32	6'-3"	A1	22	27	30	32	5'-11"	A1	22	27	30	32	5'-8"	A1	22	27	30	32	5'-5"	A1	22	27	30	32	5'-2"	A1	22	27	30	32	4'-10"	A1	22	27	30	32	4'-7"	A1	22	27	30	32	4'-4"	A1	22	27	30	32	4'-1"	A1	22	27	30	32	3'-9"	A1	22	27	30	32	3'-6"	A1	22	27	30	32	3'-3"	A1	22	27	30	32	3'-0"	A1	22	27	30	32	2'-11"	A1	22	27	30	32	2'-8"	A1	22	27	30	32	2'-5"	A1	22	27	30	32	2'-2"	A1	22	27	30	32	1'-11"	A1	22	27	30	32	1'-8"	A1	22	27	30	32	1'-5"	A1	22	27	30	32	1'-2"	A1	22	27	30	32

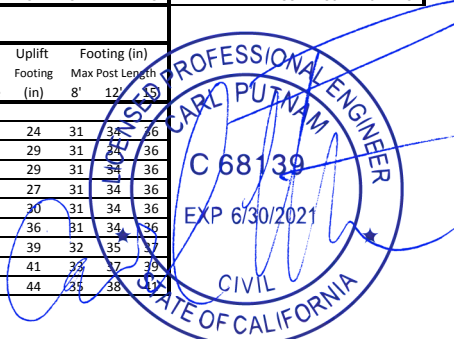

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.19a: Design table for lattice covers with ground snow load of 25 psf, live load of 20 psf, roof design load of 22 psf, wind speed of 95 MPH, seismic Ss=150%, and seismic design category D. It includes columns for various footing types (trib, min post, uplift, constrained) and sizes (3' through 8').

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585


Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.19b: Design table for lattice covers with ground snow load of 25 psf, live load of 20 psf, roof design load of 22 psf, wind speed of 95 MPH, seismic Ss=150%, and seismic design category D for freestanding structures. It includes columns for various footing types and sizes (3' through 8').

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.19c: Design table for lattice covers with ground snow load of 25 psf, live load of 20 psf, roof design load of 22 psf, wind speed of 100 MPH, seismic Ss=150%, and seismic design category D. It includes columns for various footing types and sizes (3' through 8').

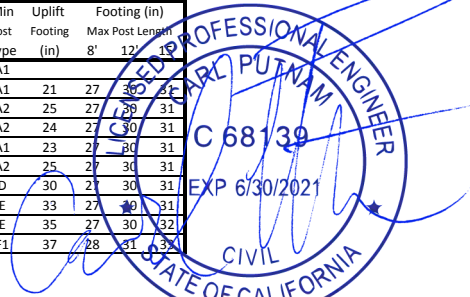

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.20a: Grid of columns for post spacing, post type, and footing size for lattice covers. Includes headers for 'cubic footing d' and 'Constrained Footing (in)' with sub-headers for 'trib', 'Min Post', 'Uplift Footing', and 'Max Post Length'.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585


Carl Putnam, P. E. 3441 Ivylink Place Larchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.20b: Grid of columns for post spacing, post type, and footing size for freestanding structures. Includes headers for 'cubic footing d' and 'Constrained Footing (in)' with sub-headers for 'trib', 'Min Post', 'Uplift Footing', and 'Max Post Length'.

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.20c: Grid of columns for post spacing, post type, and footing size for freestanding structures under different wind and seismic conditions. Includes headers for 'cubic footing d' and 'Constrained Footing (in)' with sub-headers for 'trib', 'Min Post', 'Uplift Footing', and 'Max Post Length'.

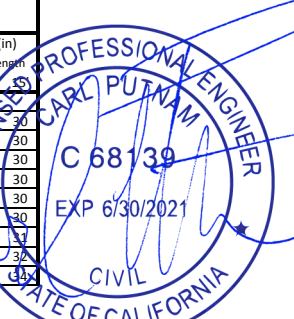

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.21a		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"													
Header		trib				trib				trib				trib				trib				trib				trib				trib				trib				trib					
Detail		Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length													
On Slab	On Slab	11'-4"	A1			9'-8"	A1			8'-6"	A1			7'-6"	A1			6'-9"	A1			5'-8"	A1			4'-10"	A1			4'-6"	A1			4'-3"	A1								
0.042"x3"x8"	L1	10'-0"	A1	19	19	21	22	9'-3"	A1	19	19	21	23	8'-5"	A1	19	20	22	24	7'-11"	A1	20	21	23	24	6'-11"	A2	20	22	24	26	5'-10"	A2	21	23	26	27	5'-7"	A2	21	24	26	28

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585


Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.21b		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"													
Header		trib				trib				trib				trib				trib				trib				trib				trib				trib									
Detail		Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length																	
On Slab	On Slab	11'-4"	A1			9'-8"	A1			8'-6"	A1			7'-6"	A1			6'-9"	A1			5'-8"	A1			4'-10"	A1			4'-6"	A1			4'-3"	A1								
0.042"x3"x8"	L1	10'-0"	A1	17	26	29	30	4'-10"	A2	18	25	28	30	8'-5"	A1	18	25	27	29	7'-11"	A1	18	24	27	28	6'-9"	A1	18	24	26	28	5'-10"	A2	19	23	26	27	5'-7"	A2	19	23	25	27

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.21c		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"													
Header		trib				trib				trib				trib				trib				trib				trib				trib				trib									
Detail		Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length				Min Post Uplift Footing (in) Max Post Length																	
On Slab	On Slab	11'-4"	A1			9'-8"	A1			8'-6"	A1			7'-6"	A1			6'-9"	A1			5'-8"	A1			4'-10"	A1			4'-6"	A1			4'-3"	A1								
0.042"x3"x8"	L1	10'-0"	A1	21	20	22	24	9'-3"	A1	22	21	23	25	8'-5"	A1	22	22	24	26	7'-11"	A1	22	22	25	26	6'-9"	A1	22	23	26	27	5'-10"	A2	23	24	27	28	5'-7"	A2	23	25	27	29

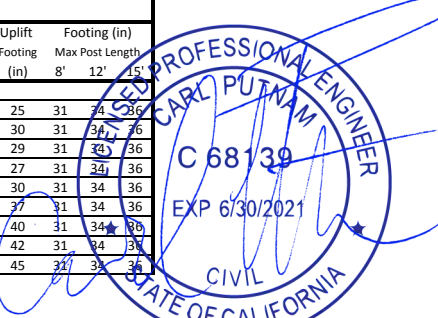

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.22a: Grid of post spacing and footing size requirements for structures attached to existing buildings. Columns include post spacing (3'-0" to 8'-0") and footing dimensions (8'-0" to 24'-0").

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.22b: Grid of post spacing and footing size requirements for freestanding structures. Columns include post spacing (3'-0" to 8'-0") and footing dimensions (8'-0" to 24'-0").

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 22 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.22c: Grid of post spacing and footing size requirements for freestanding structures with 130 MPH wind speed. Columns include post spacing (3'-0" to 8'-0") and footing dimensions (8'-0" to 24'-0").



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 105 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.24a: Design table for lattice covers with 30 psf ground snow load, 20 psf live load, 26 psf roof design load, 105 MPH wind speed, 150% seismic, and attached to existing building. Columns include On Slab, 0.042"x3"x8", Double 3"x8", Double 2"x6.625", 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, and Double 12 G Steel C. Rows specify footing dimensions (trib, Min Post, Uplift Footing, Footing (in), Max Post Length) for various post types (A1-A4, B1-B4, C1-C4, D1-D4, E1-E4, F1-F4) and sizes (3'-0" to 5'-0").

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 105 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.24b: Design table for lattice covers with 30 psf ground snow load, 20 psf live load, 26 psf roof design load, 105 MPH wind speed, 150% seismic, and freestanding structures. Columns include On Slab, 0.042"x3"x8", Double 3"x8", Double 2"x6.625", 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, and Double 12 G Steel C. Rows specify footing dimensions (trib, Min Post, Uplift Footing, Footing (in), Max Post Length) for various post types (A1-A4, B1-B4, C1-C4, D1-D4, E1-E4, F1-F4) and sizes (3'-0" to 5'-0").

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 100 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.24c: Design table for lattice covers with 30 psf ground snow load, 20 psf live load, 26 psf roof design load, 100 MPH wind speed, 150% seismic, and freestanding structures. Columns include On Slab, 0.042"x3"x8", Double 3"x8", Double 2"x6.625", 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, and Double 12 G Steel C. Rows specify footing dimensions (trib, Min Post, Uplift Footing, Footing (in), Max Post Length) for various post types (A1-A4, B1-B4, C1-C4, D1-D4, E1-E4, F1-F4) and sizes (3'-0" to 5'-0").



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.26a: Table with 18 columns for different footing sizes (3'-0" to 7'-0") and 2 rows for On Slab and On Footing. Each column contains min post, uplift, and footing (in) values.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585


Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.26b: Table with 18 columns for different footing sizes (3'-0" to 7'-0") and 2 rows for On Slab and On Footing. Each column contains min post, uplift, and footing (in) values.

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.26c: Table with 18 columns for different footing sizes (3'-0" to 7'-0") and 2 rows for On Slab and On Footing. Each column contains min post, uplift, and footing (in) values.

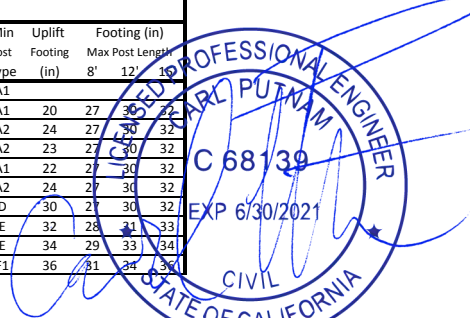

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.27a: Grid of post spacing and footing size data for structures attached to existing buildings under various load conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.27b: Grid of post spacing and footing size data for freestanding structures under various load conditions.

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.27c: Grid of post spacing and footing size data for structures attached to existing buildings under higher wind and seismic loads.



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.28a: Design table for attached structures with columns for footing size, post type, and various load conditions (3' to 15').

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.28b: Design table for freestanding structures with columns for footing size, post type, and various load conditions (3' to 15').

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.28c: Design table for freestanding structures under higher wind conditions with columns for footing size, post type, and various load conditions (3' to 15').



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: **36 psf**

Live Load: **20 psf**

Roof Design Load **31 psf**

Wind Speed: **100 MPH EXPOSURE C or 115 MPH EXPOSURE B**

Seismic Ss= **150%**

Seismic Design Category **D**

Structures are Attached to Existing Building

Table 2.29a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																									
		trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)																														
On Slab	On Slab	3'	Type	Max Post Length	8'	12'	15'	3.5'	Type	Max Post Length	8'	12'	15'	4'	Type	Max Post Length	8'	12'	15'	4.5'	Type	Max Post Length	8'	12'	15'	5'	Type	Max Post Length	8'	12'	15'	5.5'	Type	Max Post Length	8'	12'	15'	6'	Type	Max Post Length	8'	12'	15'	6.5'	Type	Max Post Length	8'	12'	15'	7'	Type	Max Post Length	8'	12'	15'	7.5'	Type	Max Post Length	8'	12'	15'	8'	Type	Max Post Length	8'	12'	15'
0.042"x3"x8"	L1	8"-2"	A1	16	18	20	21	7"-5"	A1	17	18	20	22	6"-10"	A2	17	19	21	22	6"-4"	A2	17	20	22	23	5"-10"	A2	17	20	22	24	5"-5"	A2	17	21	23	24	5"-2"	A2	18	21	23	25	4"-10"	A2	18	22	24	25	4"-7"	A2	18	22	24	26	4"-4"	A2	18	22	25	26	4"-1"	A2	18	23	25	27

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

Ground Snow Load: **36 psf**

Live Load: **20 psf**

Roof Design Load **31 psf**

Wind Speed: **100 MPH EXPOSURE C or 115 MPH EXPOSURE B**

Seismic Ss= **150%**

Seismic Design Category **D**

Freestanding Structures

Table 2.29b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																													
		trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type
On Slab	On Slab	8'-0"	A1	15	23	26	27 <th>6'-10"</th> <th>A1</th> <th>15</th> <th>23</th> <th>25</th> <th>27 <th>6'-0"</th> <th>A1</th> <th>16</th> <th>22</th> <th>25</th> <th>26 <th>5'-4"</th> <th>A1</th> <th>16</th> <th>22</th> <th>24</th> <th>26 <th>4'-10"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>4'-4"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>25 <th>4'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-8"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-5"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-2"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th></th></th></th></th></th></th></th></th></th>	6'-10"	A1	15	23	25	27 <th>6'-0"</th> <th>A1</th> <th>16</th> <th>22</th> <th>25</th> <th>26 <th>5'-4"</th> <th>A1</th> <th>16</th> <th>22</th> <th>24</th> <th>26 <th>4'-10"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>4'-4"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>25 <th>4'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-8"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-5"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-2"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th></th></th></th></th></th></th></th></th>	6'-0"	A1	16	22	25	26 <th>5'-4"</th> <th>A1</th> <th>16</th> <th>22</th> <th>24</th> <th>26 <th>4'-10"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>4'-4"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>25 <th>4'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-8"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-5"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-2"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th></th></th></th></th></th></th></th>	5'-4"	A1	16	22	24	26 <th>4'-10"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>4'-4"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>25 <th>4'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-8"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-5"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-2"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th></th></th></th></th></th></th>	4'-10"	A1	16	21	24	25 <th>4'-4"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>25 <th>4'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-8"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-5"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-2"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th></th></th></th></th></th>	4'-4"	A1	16	21	23	25 <th>4'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-8"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-5"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-2"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th></th></th></th></th>	4'-0"	A1	16	21	23	24 <th>3'-8"</th> <th>A1</th> <th>16</th> <th>21</th> <th>23</th> <th>24 <th>3'-5"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-2"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th></th></th></th>	3'-8"	A1	16	21	23	24 <th>3'-5"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-2"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th></th></th>	3'-5"	A1	16	21	24	25 <th>3'-2"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th></th>	3'-2"	A1	16	21	24	25 <th>3'-0"</th> <th>A1</th> <th>16</th> <th>21</th> <th>24</th> <th>25 </th>	3'-0"	A1	16	21	24	25								
0.042"x3"x8"	L1	8"-2"	A1	15	23	26	27	7"-5"	A1	15	23	25	27	6"-10"	A2	16	22	25	26	6"-4"	A2	16	22	24	26	5"-10"	A2	16	21	24	25	5"-5"	A2	16	21	23	25	4"-10"	A2	16	21	23	24	4"-7"	A2	16	21	24	25	4"-4"	A2	16	21	24	25	4"-1"	A2	16	21	24	25														

Ground Snow Load: **36 psf**

Live Load: **20 psf**

Roof Design Load **31 psf**

Wind Speed: **110 MPH EXPOSURE C or 130 MPH EXPOSURE B**

Seismic Ss= **150%**

Seismic Design Category **D**

Freestanding Structures

Table 2.29c

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																													
		trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type
On Slab	On Slab	8'-0"	A1	16	25	27 <th>29 <th>6'-10"</th> <th>A1</th> <th>16</th> <th>24</th> <th>26 <th>28 <th>6'-0"</th> <th>A1</th> <th>17</th> <th>23</th> <th>26 <th>27 <th>5'-4"</th> <th>A1</th> <th>17</th> <th>23</th> <th>25 <th>27 <th>4'-10"</th> <th>A1</th> <th>17</th> <th>22</th> <th>25 <th>26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th>	29 <th>6'-10"</th> <th>A1</th> <th>16</th> <th>24</th> <th>26 <th>28 <th>6'-0"</th> <th>A1</th> <th>17</th> <th>23</th> <th>26 <th>27 <th>5'-4"</th> <th>A1</th> <th>17</th> <th>23</th> <th>25 <th>27 <th>4'-10"</th> <th>A1</th> <th>17</th> <th>22</th> <th>25 <th>26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th>	6'-10"	A1	16	24	26 <th>28 <th>6'-0"</th> <th>A1</th> <th>17</th> <th>23</th> <th>26 <th>27 <th>5'-4"</th> <th>A1</th> <th>17</th> <th>23</th> <th>25 <th>27 <th>4'-10"</th> <th>A1</th> <th>17</th> <th>22</th> <th>25 <th>26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th>	28 <th>6'-0"</th> <th>A1</th> <th>17</th> <th>23</th> <th>26 <th>27 <th>5'-4"</th> <th>A1</th> <th>17</th> <th>23</th> <th>25 <th>27 <th>4'-10"</th> <th>A1</th> <th>17</th> <th>22</th> <th>25 <th>26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th></th></th></th></th></th></th>	6'-0"	A1	17	23	26 <th>27 <th>5'-4"</th> <th>A1</th> <th>17</th> <th>23</th> <th>25 <th>27 <th>4'-10"</th> <th>A1</th> <th>17</th> <th>22</th> <th>25 <th>26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th></th></th></th></th></th>	27 <th>5'-4"</th> <th>A1</th> <th>17</th> <th>23</th> <th>25 <th>27 <th>4'-10"</th> <th>A1</th> <th>17</th> <th>22</th> <th>25 <th>26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th></th></th></th></th>	5'-4"	A1	17	23	25 <th>27 <th>4'-10"</th> <th>A1</th> <th>17</th> <th>22</th> <th>25 <th>26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th></th></th></th>	27 <th>4'-10"</th> <th>A1</th> <th>17</th> <th>22</th> <th>25 <th>26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th></th></th>	4'-10"	A1	17	22	25 <th>26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th></th>	26 <th>4'-4"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th></th>	4'-4"	A1	17	22	24 <th>26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th></th>	26 <th>4'-0"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th></th>	4'-0"	A1	17	22	24 <th>26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th></th>	26 <th>3'-8"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th></th>	3'-8"	A1	17	22	24 <th>26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th></th>	26 <th>3'-5"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th></th>	3'-5"	A1	17	22	24 <th>26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th></th>	26 <th>3'-2"</th> <th>A1</th> <th>17</th> <th>22</th> <th>24 <th>26 </th></th>	3'-2"	A1	17	22	24 <th>26 </th>	26														
0.042"x3"x8"	L1	8"-2"	A1	16	25	27	29	7"-5"	A1	16	24	26	28	6"-10"	A2	17	23	26	27	6"-4"	A2	17	23	25	27	5"-10"	A2	17	22	25	26	5"-5"	A2	17	22	24	26	4"-10"	A2	17	22	24	26	4"-7"	A2	17	22	24	26	4"-4"	A2	17	22	25	26	4"-1"	A2	17	22	25	26														



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 36 psf Live Load: 20 psf Roof Design Load 31 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.30a

Header	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"												
	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)					
On Slab	8'-0"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1							
0.042"x3"x8"	L1	8'-2"	A1	19	22	23	7'-5"	A1	19	20	22	24	6'-10"	A2	19	21	23	25	6'-4"	A2	20	22	24	25	5'-10"	A2	20	22	25	26	5'-5"	A2	20	23	25	27	
Double 3"x8"	L1/L12	12'-5"	A2	21	19	22	23	11'-4"	B	22	20	22	24	10'-7"	C	22	21	23	25	9'-10"	C	23	22	24	25	9'-3"	C	23	22	25	26	8'-8"	C	23	23	25	27

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Iylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 36 psf Live Load: 20 psf Roof Design Load 31 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures


Table 2.30b

Header	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"												
	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)					
On Slab	8'-0"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1							
0.042"x3"x8"	L1	8'-2"	A1	17	26	28	30	7'-5"	A1	17	25	28	29	6'-10"	A2	18	24	27	28	6'-4"	A2	18	24	27	28	5'-10"	A2	18	23	26	28	5'-5"	A2	18	23	26	27
Double 3"x8"	L1/L12	12'-5"	A2	20	28	32	33	11'-4"	B	20	28	31	33	10'-7"	C	21	27	30	32	9'-10"	C	21	27	30	31	9'-3"	C	21	26	29	31	8'-8"	C	21	26	29	30

Ground Snow Load: 36 psf Live Load: 20 psf Roof Design Load 31 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Structures are Attached to Existing Building

Table 2.30c

Header	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"												
	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)					
On Slab	8'-0"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1			6'-10"	A1							
0.042"x3"x8"	L1	8'-2"	A1	18	19	21	22	7'-5"	A1	18	19	21	23	6'-10"	A2	18	20	22	24	6'-4"	A2	18	21	23	24	5'-10"	A2	19	21	24	25	5'-5"	A2	19	22	24	26
Double 3"x8"	L1/L12	12'-5"	A2	20	19	21	22	11'-4"	B	21	19	21	23	10'-7"	C	21	20	22	24	9'-10"	C	21	21	23	24	9'-3"	C	22	21	24	25	8'-8"	C	22	22	25	26

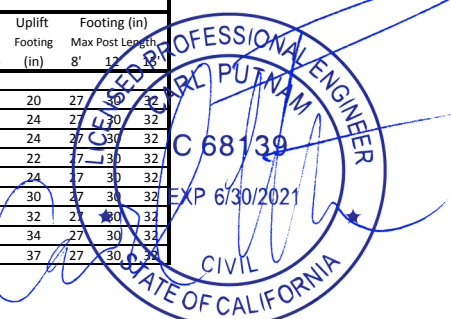

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 42 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Structures are Attached to Existing Building

Table 2.31a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
		trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)				
		2'	Type	(in)	8' 12' 15'	2.5'	Type	(in)	8' 12' 15'	3'	Type	(in)	8' 12' 15'	3.5'	Type	(in)	8' 12' 15'	4'	Type	(in)	8' 12' 15'	4.5'	Type	(in)	8' 12' 15'	5'	Type	(in)	8' 12' 15'	5.5'	Type	(in)	8' 12' 15'	6'	Type	(in)	8' 12' 15'	6.5'	Type	(in)	8' 12' 15'	7'	Type	(in)	8' 12' 15'				
On Slab	On Slab	10'-4"	A1			8'-3"	A1			6'-10"	A1			5'-10"	A1			5'-2"	A1			4'-7"	A1			4'-1"	A1			3'-9"	A1			3'-5"	A1			2'-11"	A1										
0.042"x3"x8"	L1	9'-6"	A1	15	19	21	22	8'-4"	A1	15	19	22	23	7'-5"	A1	16	20	22	23	6'-8"	A2	16	20	22	24	5'-8"	A2	17	21	23	24	4'-10"	A2	17	21	23	24	4'-7"	A2	17	22	24	25	4'-0"	A2	17	22	24	26
Double 3"x8"	L1/L12	14'-3"	A2	17	21	23	25	11'-4"	A2	18	22	24	25	11'-4"	B	18	22	24	26	10'-3"	A2	18	22	25	26	9'-2"	C	19	23	25	27	8'-11"	C	19	23	26	27	7'-11"	D	20	24	26	28	6'-9"	D	20	24	27	28
Double 2"x6.625"	L2/L12	12'-8"	A2	17	20	23	24	11'-3"	A2	17	21	23	25	10'-3"	A2	18	21	24	25	9'-5"	A2	18	22	24	26	8'-8"	C	18	22	25	26	7'-8"	C	19	23	25	27	6'-10"	C	19	23	26	27	6'-3"	C	20	23	26	28
16 G Steel C	L18	16'-11"	B	18	22	24	26	14'-6"	C	19	22	25	26	12'-9"	C	19	23	25	27	11'-2"	C	19	23	25	27	9'-10"	C	19	23	25	27	7'-10"	C	19	23	25	27	6'-11"	C	19	23	25	27	5'-7"	C	19	23	25	27
14 G Steel C	L18	20'-2"	C	19	23	25	27	17'-5"	C	20	23	26	27	15'-4"	D	20	24	26	28	13'-10"	D	20	24	27	28	12'-7"	D	21	24	27	29	10'-8"	D	21	25	27	29	8'-2"	D	21	25	27	29	7'-7"	D	21	25	27	29
12 G Steel C	L18	25'-1"	D	21	24	27	28	23'-3"	D	22	25	28	30	22'-0"	E	23	26	29	31	20'-1"	E	23	26	29	31	18'-5"	E	24	27	30	32	16'-0"	E	24	28	31	32	14'-2"	F1	25	28	31	33	12'-9"	F1	25	28	31	33
Double 16 G Steel C	L18/L8	26'-11"	D	21	25	27	29	24'-2"	D	22	25	28	30	22'-11"	E	23	26	29	31	21'-9"	E	24	27	30	32	20'-9"	F1	25	28	31	32	19'-3"	F1	26	29	32	34	17'-5"	F1	26	29	32	34	16'-0"	F1	27	30	33	35
Double 14 G Steel C	L18/L8	27'-10"	D	21	25	28	29	25'-10"	E	23	26	29	30	24'-5"	E	24	27	30	31	23'-2"	E	24	27	30	32	22'-2"	F1	25	28	31	33	21'-4"	F1	26	29	32	34	19'-5"	F1	27	30	33	35	18'-5"	F2	28	31	34	36
Double 12 G Steel C	L18/L8	31'-7"	E	22	26	29	30	29'-4"	E	24	27	30	31	27'-9"	E	25	28	31	32	26'-4"	F1	25	28	31	32	25'-2"	F1	26	29	32	34	23'-4"	F1	27	30	33	35	22'-0"	F2	28	31	34	36	20'-11"	F3	30	32	35	37

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

Ground Snow Load: 42 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Freestanding Structures

Table 2.31b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																									
		trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)										
		2'	Type	(in)	8' 12' 15'	2.5'	Type	(in)	8' 12' 15'	3'	Type	(in)	8' 12' 15'	3.5'	Type	(in)	8' 12' 15'	4'	Type	(in)	8' 12' 15'	4.5'	Type	(in)	8' 12' 15'	5'	Type	(in)	8' 12' 15'	5.5'	Type	(in)	8' 12' 15'	6'	Type	(in)	8' 12' 15'	6.5'	Type	(in)	8' 12' 15'	7'	Type	(in)	8' 12' 15'										
On Slab	On Slab	10'-4"	A1			8'-3"	A1			6'-10"	A1			5'-10"	A1			5'-2"	A1			4'-7"	A1			4'-1"	A1			3'-9"	A1			3'-5"	A1			2'-11"	A1																
0.042"x3"x8"	L1	9'-6"	A1	14	24	27	28	8'-3"	A2	14	23	26	27	7'-5"	A2	15	23	25	27	6'-8"	A2	15	22	25	26	5'-11"	A2	15	21	23	24	4'-10"	A2	16	21	23	24	4'-3"	A2	16	21	23	25	4'-0"	A2	16	21	24	25						
Double 3"x8"	L1/L12	14'-3"	A2	16	27	30	32	12'-7"	A2	16	26	29	31	11'-4"	B	17	25	28	29	10'-5"	C	17	25	27	29	9'-7"	C	17	24	27	29	8'-11"	C	18	24	26	28	7'-11"	D	19	24	26	28	6'-9"	D	19	24	27	28						
Double 2"x6.625"	L2/L12	12'-8"	A2	15	25	28	29	11'-3"	A2	16	24	27	28	10'-3"	A2	16	24	26	28	9'-5"	A2	17	23	26	27	8'-8"	C	17	23	25	27	7'-8"	C	18	23	26	28	6'-10"	C	18	23	26	27	6'-3"	C	18	23	26	28						
16 G Steel C	L18	16'-11"	B	17	28	31	33	14'-6"	C	17	27	30	32	12'-9"	C	17	26	29	31	11'-2"	C	18	25	28	30	9'-10"	C	18	24	26	28	8'-9"	C	18	24	26	28	7'-10"	C	18	23	25	27	6'-11"	C	18	23	25	27						
14 G Steel C	L18	20'-2"	C	18	29	33	34	17'-5"	C	18	28	31	33	15'-4"	D	19	27	30	32	13'-10"	D	19	27	30	31	12'-7"	D	19	25	28	29	11'-6"	D	19	25	28	29	10'-8"	D	19	25	27	29	8'-10"	D	20	25	27	29						
12 G Steel C	L18	25'-1"	D	19	31	34	36	23'-3"	D	20	30	34	36	22'-0"	E	21	29	32	34	20'-1"	E	21	29	32	34	18'-5"	E	22	29	32	34	17'-11"	E	22	28	31	33	16'-0"	E	23	28	31	32	14'-2"	F1	23	28	31	33						
Double 16 G Steel C	L18/L8	26'-11"	D	19	31	35	37	24'-2"	D	20	31	34	36	22'-11"	E	21	30	34	36	21'-9"	E	22	30	33	35	20'-9"	F1	23	29	32	34	19'-3"	F1	24	29	32	34	18'-4"	F1	24	29	32	34	16'-8"	F1	25	30	33	35						
Double 14 G Steel C	L18/L8	27'-10"	D	20	32	35	37	25'-10"	E	21	31	35	37	24'-5"	E	22	31	34	36	23'-2"	E	22	30	33	35	22'-9"	F1	23	30	33	35	21'-4"	F1	24	29	32	34	19'-11"	F1	25	30	33	35	18'-10"	F2	26	30	34	36						
Double 12 G Steel C	L18/L8	31'-7"	E	21	33	36	39	29'-4"	E	22	32	36	38	27'-9"	E	23	32	35	37	26'-4"	F1	23	31	35	37	25'-2"	F1	24	31	34	36	24'-3"	F1	25	31	34	36	23'-4"	F1	25	30	34	36	22'-8"	F2	26	31	34	36	20'-11"	F3	27	32	35	37

Ground Snow Load: 42 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Freestanding Structures

Table 2.31c

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
		trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)								
		2'	Type	(in)	8' 12' 15'	2.5'	Type	(in)	8' 12' 15'	3'	Type	(in)	8' 12' 15'	3.5'	Type	(in)	8' 12' 15'	4'	Type	(in)	8' 12' 15'	4.5'	Type	(in)	8' 12' 15'	5'	Type	(in)	8' 12' 15'	5.5'	Type	(in)	8' 12' 15'	6'	Type	(in)	8' 12' 15'	6.5'	Type	(in)	8' 12' 15'	7'	Type	(in)	8' 12' 15'				
On Slab	On Slab	10'-4"	A1			8'-3"	A1			6'-10"	A1			5'-10"	A1			5'-2"	A1			4'-7"	A1			4'-1"	A1			3'-9"	A1			3'-5"	A1			2'-11"	A1										
0.042"x3"x8"	L1	9'-6"	A1	15	25	28	30	8'-4"	A1	15	25	27	29	7'-5"	A1	16	24	26	28	6'-8"	A2	16	23	25	27	5'-8"	A2	16	22	25	26	4'-10"	A2	17	21	24	25	4'-3"	A2	17	21	24	26	4'-0"	A2	17	22	24	26
Double 3"x8"	L1/L12	14'-3"	A2	17	28	31	33	12'-7"	A2	18	27	30	32	11'-4"	B	18	27	30	31	10'-5"	C	18	26	29	31	9'-7"	C	19	25	28	30	8'-11"	C	19	25	28	29	7'-11"	D	20	24	26	28	6'-9"	D	20	24	27	28
Double 2"x6.625"	L2/L12	12'-8"	A2	16	26	29	31	11'-3"	A2	17	25	28	30	10'-3"	A2	17	25	27	29	9'-5"	A2	18	24	27	28	8'-8"	C	18	24	26	28	7'-8"	C	19	23	25	27	6'-10"	C	19	23	26	27	6'-3"	C	20	23	26	28
16 G Steel C	L18	16'-11"	B	18	29	33	35	14'-6"	C	18	28	31	33	12'-9"	C	19	27	30	32	11'-2"	C	19	27	29	31	9'-10"	C	19	26	28	30	8'-9"	C	19	25	28	30	7'-10"	C	19	24	27	28	6'-11"	C	19	23	25	27
14 G Steel C	L18	20'-2"	C	19	31	34	36	17'-5"	C	20	30	33	35	15'-4"	D	20	29	32	34	1																													

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 42 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Structures are Attached to Existing Building

Table 2.32a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"											
		trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length				
On Slab	On Slab	10'-4" A1				8'-3" A1				6'-10" A1				5'-10" A1				4'-7" A1				3'-9" A1				3'-5" A1				2'-11" A1							
0.042"x3"x8"	L1	9'-6" A1	16	19	21	22	23	8'-4" A1	16	19	22	23	7'-5" A1	16	20	22	23	6'-8" A2	17	20	22	24	5'-3" A1	17	21	23	24	4'-10" A2	17	21	24	25	4'-0" A2	18	22	25	26
Double 3"x8"	L1/L12	14'-3" A2	18	21	23	25	27	12'-3" A2	18	21	23	25	11'-4" B	19	22	24	26	10'-5" C	19	22	25	26	9'-2" C	20	23	25	27	8'-11" C	20	23	26	27	7'-11" D	21	24	26	28
Double 2"x6.625"	L2/L12	12'-8" A2	17	20	23	24	25	11'-3" A2	18	21	23	25	10'-3" A2	18	21	24	25	9'-5" A2	19	22	24	26	8'-8" C	19	22	25	26	7'-8" C	20	23	25	27	6'-10" C	20	23	26	27
16 G Steel C	L18	16'-11" B	19	22	24	26	27	14'-6" C	19	22	25	26	12'-9" C	20	23	25	27	11'-2" C	20	23	25	27	9'-10" C	20	23	25	27	8'-9" C	20	23	25	27	7'-2" C	20	23	25	27
14 G Steel C	L18	20'-2" C	20	23	25	27	17'-5" C	20	23	26	27	15'-4" D	21	24	26	28	13'-10" D	21	24	27	28	12'-7" D	21	24	27	29	11'-6" D	22	25	27	29	9'-8" D	22	25	27	29	
12 G Steel C	L18	25'-1" D	21	24	27	28	23'-3" D	23	25	28	30	22'-0" E	24	26	29	31	20'-1" E	24	26	29	31	18'-5" E	25	27	30	32	17'-1" E	25	27	30	32	15'-0" E	25	28	31	32	
Double 16 G Steel C	L18/L8	26'-1" D	22	25	27	29	24'-2" D	23	25	28	30	22'-11" E	24	26	29	31	21'-9" E	25	27	30	32	20'-9" E	25	28	31	32	20'-0" F1	26	28	31	32	19'-3" F1	27	29	32	34	
Double 14 G Steel C	L18/L8	27'-10" D	22	25	28	29	25'-10" E	23	26	29	30	24'-5" E	24	27	30	31	23'-2" E	25	27	30	32	22'-2" F1	26	28	31	33	21'-4" F1	27	29	32	34	20'-7" F1	28	30	33	35	
Double 12 G Steel C	L18/L8	31'-7" E	23	26	29	30	29'-4" E	24	27	30	31	27'-9" E	25	28	31	32	26'-4" F1	26	28	31	33	25'-2" F1	27	29	32	34	24'-3" F1	28	30	33	35	23'-4" F1	28	30	33	35	

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

Ground Snow Load: 42 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Freestanding Structures

Table 2.32b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"											
		trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length				
On Slab	On Slab	10'-4" A1				8'-3" A1				6'-10" A1				5'-10" A1				4'-7" A1				3'-9" A1				3'-5" A1				2'-11" A1							
0.042"x3"x8"	L1	9'-6" A1	14	17	19	21	22	8'-4" A1	15	18	20	21	7'-5" A1	15	18	20	21	6'-8" A2	15	18	20	21	5'-3" A1	16	19	21	22	4'-10" A2	16	19	21	22	4'-0" A2	16	19	21	22
Double 3"x8"	L1/L12	14'-3" A2	16	19	21	23	25	12'-3" A2	17	20	22	23	11'-4" B	17	20	22	23	10'-5" C	18	21	23	25	9'-2" C	18	21	23	25	8'-11" C	18	21	23	25	7'-11" D	19	22	24	26
Double 2"x6.625"	L2/L12	12'-8" A2	16	19	21	23	25	11'-3" A2	17	20	22	23	10'-3" A2	17	20	22	23	9'-5" A2	17	20	22	23	8'-8" C	18	21	23	25	7'-8" C	18	21	23	25	6'-10" C	19	22	24	26
16 G Steel C	L18	16'-11" B	17	19	21	23	25	14'-6" C	18	20	22	23	12'-9" C	18	20	22	23	11'-2" C	18	20	22	23	9'-10" C	18	20	22	23	8'-9" C	18	20	22	23	7'-2" C	18	20	22	23
14 G Steel C	L18	20'-2" C	18	20	22	24	26	17'-5" C	19	21	23	25	15'-4" D	19	21	23	25	13'-10" D	20	22	24	26	12'-7" D	20	22	24	26	11'-6" D	20	22	24	26	9'-8" D	20	22	24	26
12 G Steel C	L18	25'-1" D	20	22	24	26	23	23'-3" D	21	23	25	27	22'-0" E	22	24	26	29	20'-1" E	22	24	26	29	18'-5" E	23	25	27	30	17'-1" E	23	25	27	30	15'-0" E	23	25	27	30
Double 16 G Steel C	L18/L8	26'-1" D	20	22	24	26	28	24'-2" D	21	23	25	27	22'-11" E	22	24	26	29	21'-9" E	23	25	27	30	20'-9" E	23	25	27	30	20'-0" F1	24	26	29	31	19'-3" F1	25	27	30	32
Double 14 G Steel C	L18/L8	27'-10" D	20	22	24	26	28	25'-10" E	22	24	26	29	24'-5" E	22	24	26	29	23'-2" E	23	25	27	30	22'-2" F1	24	26	29	31	21'-4" F1	25	27	30	32	20'-7" F1	25	27	30	32
Double 12 G Steel C	L18/L8	31'-7" E	21	23	25	27	29	29'-4" E	22	24	26	29	27'-9" E	23	25	27	30	26'-4" F1	24	26	29	31	25'-2" F1	25	27	30	32	24'-3" F1	26	28	31	33	23'-4" F1	26	28	31	33

Ground Snow Load: 42 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Structures are Attached to Existing Building

Table 2.32c

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"											
		trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift	Constrained Footing (in) Max Post Length				
On Slab	On Slab	10'-4" A1				8'-3" A1				6'-10" A1				5'-10" A1				4'-7" A1				3'-9" A1				3'-5" A1				2'-11" A1							
0.042"x3"x8"	L1	9'-6" A1	16	19	21	22	23	8'-4" A1	17	19	21	22	7'-5" A1	17	19	21	22	6'-8" A2	17	19	21	22	5'-3" A1	17	19	21	22	4'-10" A2	18	21	23	24	4'-0" A2	18	21	23	24
Double 3"x8"	L1/L12	14'-3" A2	18	21	23	25	27	12'-3" A2	19	22	24	26	11'-4" B	20	22	24	26	10'-5" C	20	22	24	26	9'-2" C	20	22	24	26	8'-11" C	21	23	25	27	7'-11" D	21	23	25	27
Double 2"x6.625"	L2/L12	12'-8" A2	18	20	23	24	25	11'-3" A2	18	21	23	25	10'-3" A2	19	21	24	25	9'-5" A2	19	22	24	26	8'-8" C	20	22	25	26	7'-8" C	20	22	25	27	6'-10" C	21	23	26	27
16 G Steel C	L18	16'-11" B	19	22	24	26	27	14'-6" C	20	22	25	26	12'-9" C	20	22	25	27	11'-2" C	20	22	25	27	9'-10" C	20	22	25	27	8'-9" C	20	22	25	27	7'-2" C	20	22	25	27
14 G Steel C	L18	20'-2" C	21	23	25	27	17'-5" C	21	23	26	27	15'-4" D	22	24	26	28	13'-10" D	22	24	27	29	12'-7" D	22	24	27	29	11'-6" D	23	25	27	29	9'-8" D	23	25	27	29	
12 G Steel C	L18	25'-1" D	22	24	27	28	23'-3" D	23	25	28	30	22'-0" E	24	26	29	31	20'-1" E	25	26	29	31	18'-5" E	25	27	30	31	17'-1" E	26	27	30	32	15'-0" E	26	28	31	32	
Double 16 G Steel C	L18/L8	26'-1" D	22	25	27	29	24'-2" D	24	25	28	30	22'-11" E	25	26	29	31	21'-9" E	25	27	30	32	20'-9" E	26	28	31	32	20'-0" F1	27	28	31	33	19'-3" F1	28	29	32	34	
Double 14 G Steel C	L18/L8	27'-10" D	23	25	28	29	25'-10" E	24	26	29	30	24'-5" E	25	27	30	31	23'-2" E	26	27	30	32	22'-2" F1	27	28	31	33	21'-4" F1	28	29	32	34	20'-7" F1	28	29	32	34	
Double 12 G Steel C	L18/L8	31'-7" E	24	26	29	30	29'-4" E	25	27	30	31	27'-9" E	26	28	31	32	26'-4" F1	27	28	31	33	25'-2" F1	28	29	32	34	24'-3" F1	29	30	33	35	23'-4" F1	29	30	33	35	



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 42 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.34a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																																	
		trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)																																		
		2'	Type	(in)	8' 12' 15'	2.5'	Type	(in)	8' 12' 15'	3'	Type	(in)	8' 12' 15'	3.5'	Type	(in)	8' 12' 15'	4'	Type	(in)	8' 12' 15'	4.5'	Type	(in)	8' 12' 15'	5'	Type	(in)	8' 12' 15'	5.5'	Type	(in)	8' 12' 15'	6'	Type	(in)	8' 12' 15'	6.5'	Type	(in)	8' 12' 15'	7'	Type	(in)	8' 12' 15'																																		
On Slab	On Slab	10'-4"	A1			8'-3"	A1			6'-10"	A1			5'-10"	A1			5'-2"	A1			4'-7"	A1			4'-1"	A1			3'-9"	A1			3'-5"	A1			2'-11"	A1																																								
0.042"x3"x8"	L1	9'-6"	A1	17	24	27	28	8'-4"	A1	18	25	27	29	7'-5"	A1	18	25	28	30	6'-8"	A2	18	25	28	30	6'-1"	A2	19	26	29	30	5'-8"	A2	19	26	29	31	4'-10"	A2	19	26	29	31	4'-3"	A2	19	27	30	31	4'-0"	A2	20	27	30	31																								
Double 3"x8"	L1/L12	14'-3"	A2	20	27	30	31	11'-4"	B	21	28	31	32	11'-4"	B	21	28	31	32	9'-7"	C	22	29	32	34	8'-5"	C	22	29	32	34	8'-11"	C	23	30	33	35	7'-11"	D	23	30	33	35	7'-6"	D	23	30	34	35	6'-9"	D	23	30	34	35																								
Double 2"x6.625"	L2/L12	12'-8"	A2	19	26	29	30	11'-3"	A2	19	27	30	31	10'-3"	A2	20	27	30	32	9'-5"	A2	20	28	31	33	8'-8"	C	21	28	31	33	8'-2"	C	21	29	32	33	7'-8"	C	22	29	32	34	7'-3"	C	22	29	32	34	6'-10"	C	22	29	33	34	6'-6"	C	22	30	33	35	6'-3"	C	23	30	33	35												
16 G Steel C	L18	16'-11"	B	21	28	31	33	14'-6"	C	21	28	32	33	12'-9"	C	22	29	32	34	11'-2"	C	22	29	32	34	9'-10"	C	22	29	32	34	8'-9"	C	22	29	32	34	7'-10"	C	22	29	32	34	7'-2"	C	22	29	32	34	6'-1"	C	22	29	32	34	5'-7"	C	22	29	32	34																		
14 G Steel C	L18	20'-2"	C	22	29	32	34	17'-5"	C	22	30	33	35	15'-4"	D	23	30	33	35	13'-10"	D	23	31	34	36	12'-7"	D	24	31	34	36	11'-6"	D	24	31	35	37	10'-8"	D	24	31	35	37	9'-8"	D	24	31	35	37	8'-2"	D	24	31	35	37	7'-7"	D	24	31	35	37																		
12 G Steel C	L18	25'-1"	D	24	31	34	36	23'-3"	D	25	32	36	38	22'-0"	E	26	33	37	39	20'-1"	E	26	34	38	40	18'-5"	E	27	34	38	40	17'-1"	E	27	34	38	40	16'-0"	E	28	35	39	41	15'-0"	E	28	35	39	41	14'-2"	F1	28	35	39	41	13'-5"	F1	28	36	39	42	12'-9"	F1	29	36	40	42	12'-9"	F1	29	36	40	42						
Double 16 G Steel C	L18/L8	26'-11"	D	24	31	35	37	24'-2"	D	25	32	36	38	22'-11"	E	26	33	37	39	21'-9"	E	27	34	38	40	20'-9"	E	28	35	39	41	20'-0"	F1	29	36	40	42	19'-3"	F1	29	36	40	42	18'-4"	F1	30	37	41	43	17'-5"	F1	30	37	41	43	16'-8"	F1	30	38	42	44	16'-0"	F1	31	38	42	44	15'-9"	F1	31	38	42	44						
Double 14 G Steel C	L18/L8	27'-10"	D	24	32	35	37	25'-10"	E	26	33	36	39	24'-5"	E	27	34	38	40	23'-2"	F1	28	35	39	41	22'-2"	F1	28	36	40	42	21'-4"	F1	29	36	40	42	20'-7"	F1	30	37	41	43	19'-11"	F1	31	38	42	45	18'-10"	F2	32	39	43	46	18'-5"	F2	32	39	43	46	18'-5"	F2	32	39	43	46	18'-5"	F2	32	39	43	46	18'-5"	F2	32	39	43	46
Double 12 G Steel C	L18/L8	31'-7"	E	25	33	36	38	29'-4"	E	26	34	38	40	27'-9"	E	27	35	39	41	26'-4"	F1	27	36	40	42	25'-2"	F1	28	37	41	43	24'-3"	F1	28	38	42	44	23'-4"	F1	29	38	42	45	22'-8"	F2	30	39	43	46	22'-0"	F2	31	40	44	47	21'-5"	F2	32	41	45	48	20'-11"	F3	34	41	45	47												

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

Ground Snow Load: 42 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.34b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																					
		trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)																		
		2'	Type	(in)	8' 12' 15'	2.5'	Type	(in)	8' 12' 15'	3'	Type	(in)	8' 12' 15'	3.5'	Type	(in)	8' 12' 15'	4'	Type	(in)	8' 12' 15'	4.5'	Type	(in)	8' 12' 15'	5'	Type	(in)	8' 12' 15'	5.5'	Type	(in)	8' 12' 15'	6'	Type	(in)	8' 12' 15'	6.5'	Type	(in)	8' 12' 15'	7'	Type	(in)	8' 12' 15'																						
On Slab	On Slab	10'-4"	A1			8'-3"	A1			6'-10"	A1			5'-10"	A1			5'-2"	A1			4'-7"	A1			4'-1"	A1			3'-9"	A1			3'-5"	A1			2'-11"	A1																												
0.042"x3"x8"	L1	9'-6"	A1	16	27	29	31	8'-3"	A1	16	26	29	30	7'-5"	A1	17	25	28	29	6'-8"	A2	17	25	28	30	6'-1"	A2	17	26	29	30	5'-8"	A2	17	26	29	30	4'-10"	A2	18	26	29	31	4'-3"	A2	18	27	30	31	4'-0"	A2	18	27	30	31												
Double 3"x8"	L1/L12	14'-3"	A2	18	29	33	35	12'-7"	A2	19	29	32	34	11'-4"	B	19	28	31	33	10'-5"	C	20	29	32	34	9'-7"	C	20	29	32	34	8'-11"	C	20	29	32	34	8'-5"	C	21	30	33	35	7'-11"	D	21	30	34	35	7'-6"	D	21	30	34	35	6'-9"	D	21	30	34	35						
Double 2"x6.625"	L2/L12	12'-8"	A2	17	27	30	31	11'-3"	A2	18	27	30	31	10'-3"	A2	19	28	31	33	9'-5"	A2	19	28	31	33	8'-8"	C	19	28	31	33	8'-2"	C	20	29	32	33	7'-8"	C	20	29	32	34	7'-3"	C	20	29	32	34	6'-10"	C	20	29	33	34	6'-6"	C	21	30	33	35	6'-3"	C	21	30	34	35
16 G Steel C	L18	16'-11"	B	19	31	34	36	14'-6"	C	20	30	33	35	12'-9"	C	20	29	32	34	11'-2"	C	20	29	32	34	9'-10"	C	20	29	32	34	8'-9"	C	20	29	32	34	7'-10"	C	20	29	32	34	7'-2"	C	20	29	32	34	6'-1"	C	20	29	32	34	5'-7"	C	20	29	32	34						
14 G Steel C	L18	20'-2"	C	20	32	36	38	17'-5"	C	21	33	37	39	15'-4"	D	21	30	33	35	13'-10"	D	21	31	34	36	12'-7"	D	22	31	34	36	11'-6"	D	22	31	35	37	10'-8"	D	22	31	35	37	9'-8"	D	22	31	35	37	8'-10"	D	22	31	35	37	8'-2"	D	22	31	35	37	7'-7"	D	22	31	35	37
12 G Steel C	L18	25'-1"	D	22	34	38	40	23'-3"	D	23	33	37	39	22'-0"	E	24	33	37	39	20'-1"	E	24	34	38	40	18'-5"	E	25	34	38	40	17'-1"	E	25	34	38	40	16'-0"	E	25	35	39	41	15'-0"	E	26	35	39	41	14'-2"	F1	26	36	39	42	12'-9"	F1	26	36	40	42	12'-9"	F1	26	36	40	42
Double 16 G Steel C	L18/L8	26'-11"	D	22	34	38	40	24'-2"	D	23	34	37	40	22'-11"	E	24	33	37	39	21'-9"	E	25	34	38	40	20'-9"	E	26	35	39	41	20'-0"	F1	27	36	40	42	19'-3"	F1	27	36	40	42	18'-4"	F1	28	37	41	43	17'-5"	F1	28	37	41	43	16'-8"	F1	28	38	42	44	16'-0"	F1	28	38	42	44
Double 14 G Steel C	L18/L8	27'-10"	D	23	35	39	41	25'-10"	E	24	34	38	40	24'-5"	E	25	34	38	40	23'-2"	F1	26	35	39	41	22'-2"	F1	26	36	40	42	21'-4"	F1	27	36	40	42	20'-7"	F1	28	37	41	43	19'-11"	F1	28	38	42	44	18'-10"	F2	29	39	43	45	18'-5"	F2	30	40	44	46	18'-5"	F2	30	40	44	46
Double 12 G Steel C	L18/L8	31'-7"	E	23	36	40	42	29'-4"	E	25	35	39	41	27'-9"	E	26	35	39	41	26'-4"	F1	27	36	40	42	25'-2"	F1	27	37	41	43	24'-3"	F1	28	38	42	44	23'-4"	F1	29	38	42	45	22'-8"	F2	29	39	43	45	22'-0"	F2	30	39	43	45	21'-5"	F2	31	40	44	47	20'-11"	F3	31	41	45	47

Ground Snow Load: 42 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Structures are Attached to Existing Building

Table 2.34c

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																	
		trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post
		2'	Type	(in)	8' 12' 15'	2.5'	Type	(in)	8' 12' 15'	3'	Type	(in)	8' 12' 15'	3.5'	Type</																																

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 60 psf Live Load: 20 psf Roof Design Load 51 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Structures are Attached to Existing Building

Table 2.37a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																															
		trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)																								
		1'	Type	8'	12'	15'	1.5'	Type	8'	12'	15'	2'	Type	8'	12'	15'	2.5'	Type	8'	12'	15'	3'	Type	8'	12'	15'	3.5'	Type	8'	12'	15'	4'	Type	8'	12'	15'	4.5'	Type	8'	12'	15'	5'	Type	8'	12'	15'	5.5'	Type	8'	12'	15'	6'	Type	8'	12'	15'					
On Slab	On Slab	14'-7"	A1				9'-8"	A1				7'-3"	A1				5'-10"	A1				4'-10"	A1			4'-2"	A1				3'-7"	A1			2'-7"	A1			2'-5"	A1																					
0.042"x3"x8"	L1	11'-9"	A1	14	18	20	21	9'-3"	A1	14	19	21	22	7'-8"	A1	15	19	22	23	6'-8"	A2	15	20	22	23	5'-10"	A2	16	20	22	24	4'-9"	A2	16	21	23	24	4'-0"	A2	16	21	24	25	3'-8"	A2	16	22	24	26	3'-5"	A2	17	22	25	26						
Double 3"x8"	L1/L12	17'-3"	A2	16	20	22	24	13'-10"	A2	17	21	23	25	11'-9"	B	17	22	24	25	10'-4"	C	18	22	25	26	9'-3"	C	18	23	25	27	8'-5"	C	19	23	26	27	7'-2"	D	19	24	26	28	6'-3"	D	20	24	27	28	5'-10"	D	20	24	27	28						
Double 2"x6.625"	L2/L12	15'-4"	A1	15	19	22	23	12'-4"	A2	16	20	23	24	10'-7"	A2	17	21	23	25	9'-4"	A2	17	22	24	25	8'-5"	C	18	22	25	26	7'-8"	C	18	23	25	27	6'-7"	C	19	23	26	27	5'-10"	C	19	24	26	28	5'-6"	D	19	24	26	28						
16 G Steel C	L18	21'-7"	A2	17	21	24	25	16'-4"	B	17	22	24	26	13'-3"	C	18	22	25	26	11'-0"	C	18	23	25	27	9'-2"	C	18	23	25	27	7'-11"	C	18	23	25	27	6'-2"	C	18	23	25	27	5'-0"	C	18	23	25	27	4'-7"	C	18	23	25	27						
14 G Steel C	L18	24'-7"	B	17	22	24	26	19'-5"	C	19	23	25	27	16'-0"	C	19	23	26	28	13'-8"	D	20	24	26	28	11'-11"	D	20	24	27	28	10'-9"	D	20	24	27	29	9'-5"	D	20	24	27	29	8'-4"	D	20	24	27	29	6'-3"	D	20	24	27	29						
12 G Steel C	L18	28'-0"	C	18	23	25	27	24'-8"	D	20	24	27	29	22'-4"	E	21	26	29	31	19'-11"	E	22	26	29	31	17'-8"	E	23	27	30	31	16'-11"	E	23	27	30	32	14'-9"	E	23	27	30	32	13'-7"	F1	24	28	31	33	11'-10"	F1	24	28	31	33						
Double 16 G Steel C	L18/L8	29'-1"	C	18	23	25	27	25'-7"	D	20	25	27	29	23'-3"	E	22	26	29	30	21'-6"	E	23	27	30	31	20'-4"	F1	24	28	31	32	19'-3"	F1	24	28	31	33	18'-0"	F1	25	29	32	34	16'-10"	F1	25	29	32	34	14'-11"	F1	26	30	33	35	14'-2"	F2	26	30	33	35
Double 14 G Steel C	L18/L8	31'-0"	C	19	23	26	27	27'-4"	D	21	25	28	29	24'-9"	E	22	26	29	31	22'-11"	E	23	27	30	32	21'-8"	F1	24	28	31	33	20'-7"	F1	25	29	32	34	19'-8"	F1	26	30	33	35	18'-11"	F2	27	31	34	36	17'-4"	F2	27	31	34	36	16'-7"	F2	28	31	35	37
Double 12 G Steel C	L18/L8	35'-3"	D	20	24	27	28	31'-1"	E	22	26	29	30	28'-2"	E	23	27	30	32	26'-1"	F1	24	28	31	33	24'-8"	F1	25	29	32	34	23'-4"	F1	26	30	33	35	22'-5"	F2	27	31	34	36	21'-6"	F2	28	32	35	37	20'-9"	F3	29	33	36	38	19'-6"	F3	29	33	36	38

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

Ground Snow Load: 60 psf Live Load: 20 psf Roof Design Load 51 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Freestanding Structures

Table 2.37b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																															
		trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)																								
		1'	Type	8'	12'	15'	1.5'	Type	8'	12'	15'	2'	Type	8'	12'	15'	2.5'	Type	8'	12'	15'	3'	Type	8'	12'	15'	3.5'	Type	8'	12'	15'	4'	Type	8'	12'	15'	4.5'	Type	8'	12'	15'	5'	Type	8'	12'	15'	5.5'	Type	8'	12'	15'	6'	Type	8'	12'	15'					
On Slab	On Slab	14'-7"	A1				9'-8"	A1				7'-3"	A1				5'-10"	A1				4'-10"	A1			4'-2"	A1				3'-7"	A1			2'-7"	A1			2'-5"	A1																					
0.042"x3"x8"	L1	11'-9"	A1	13	17	20	21	9'-3"	A1	13	17	20	21	7'-8"	A1	14	18	21	22	6'-8"	A2	14	18	21	22	5'-10"	A2	15	19	22	23	4'-9"	A2	15	19	22	23	4'-0"	A2	15	19	22	23	3'-8"	A2	15	19	22	23	3'-5"	A2	16	20	23	24						
Double 3"x8"	L1/L12	17'-3"	A2	14	18	20	22	13'-10"	A2	15	19	21	23	11'-9"	B	16	20	22	24	10'-4"	C	17	21	23	25	9'-3"	C	17	21	23	25	8'-5"	C	17	21	23	25	7'-2"	D	18	22	24	26	6'-3"	D	18	22	24	26	5'-10"	D	18	22	24	26						
Double 2"x6.625"	L2/L12	15'-4"	A1	14	18	20	22	12'-4"	A2	15	19	21	23	10'-7"	A2	16	20	22	24	9'-4"	A2	16	20	22	24	8'-5"	C	17	21	23	25	7'-8"	C	17	21	23	25	6'-7"	C	17	21	23	25	5'-10"	C	18	22	24	26	5'-6"	D	18	22	24	26						
16 G Steel C	L18	21'-7"	A2	15	19	22	23	16'-4"	B	16	20	23	24	13'-3"	C	17	21	24	25	11'-0"	C	17	21	24	25	9'-2"	C	17	21	24	25	7'-11"	C	17	21	24	25	6'-2"	C	17	21	24	25	5'-0"	C	17	21	24	25	4'-7"	C	17	21	24	25						
14 G Steel C	L18	24'-7"	B	16	20	22	24	19'-5"	C	17	21	24	26	16'-0"	C	18	22	25	27	13'-8"	D	18	22	25	27	11'-11"	D	18	22	25	27	10'-9"	D	19	23	26	28	9'-5"	D	19	23	26	28	8'-4"	D	19	23	26	28	6'-3"	D	19	23	26	28						
12 G Steel C	L18	28'-0"	C	17	21	24	25	24'-8"	D	18	22	25	27	22'-4"	E	20	24	27	29	19'-11"	E	21	25	28	30	17'-8"	E	21	25	28	30	16'-11"	E	21	25	28	30	14'-9"	E	22	26	29	31	13'-7"	F1	22	26	29	31	11'-10"	F1	22	26	29	31						
Double 16 G Steel C	L18/L8	29'-1"	C	17	21	24	25	25'-7"	D	19	23	26	27	23'-3"	E	20	24	27	29	21'-6"	E	21	25	28	30	20'-4"	F1	22	26	29	31	19'-3"	F1	23	27	30	32	18'-0"	F1	24	28	31	33	16'-10"	F1	24	28	31	33	14'-11"	F1	24	28	31	33	14'-2"	F2	24	28	31	33
Double 14 G Steel C	L18/L8	31'-0"	C	17	21	24	25	27'-4"	D	19	23	26	27	24'-9"	E	20	24	27	29	22'-11"	E	21	25	28	30	21'-8"	F1	22	26	29	31	20'-7"	F1	23	27	30	32	19'-8"	F1	24	28	31	33	18'-11"	F2	25	29	32	34	17'-4"	F2	25	29	32	34	16'-7"	F2	26	30	33	35
Double 12 G Steel C	L18/L8	35'-3"	D	18	22	25	27	31'-1"	E	20	24	27	28	28'-2"	E	21	25	28	30	26'-1"	F1	22	26	29	31	24'-8"	F1	23	27	30	32	23'-4"	F1	24	28	31	33	22'-5"	F2	25	29	32	34	21'-6"	F2	26	30	33	35	20'-9"	F3	27	31	34	36	19'-6"	F3	27	31	34	36

Ground Snow Load: 60 psf Live Load: 20 psf Roof Design Load 51 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Freestanding and Attached

Table 2.37c

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																										
		trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)																			
		1'	Type	8'	12'	15'	1.5'	Type	8'	12'	15'	2'	Type	8'	12'	15'	2.5'	Type	8'	12'	15'	3'	Type	8'	12'	15'	3.5'	Type	8'	12'	15'	4'	Type	8'	12'	15'	4.5'	Type	8'	12'	15'	5'	Type	8'	12'	15'	5.5'	Type	8'	12'	15'	6'	Type	8'	12'	15'
On Slab	On Slab	14'-7"	A1				9'-8"	A1				7'-3"	A1				5'-10"	A1				4'-10"	A1			4'-2"	A1				3'-7"	A1			2'-7"	A1			2'-5"	A1																
0.042"x3"x8"	L1	11'-9"	A1	13	17	20	21	9'-3"	A1	13	17	20	21	7'-8"	A1	14	18	21	22	6'-8"	A2	14	18	21	22	5'-10"	A2	15	19	22	23	4'-9"	A2	15	19	22	23	4'-0"	A2	15	19	22	23	3'-8"	A2	15	19	22	23	3'-5"	A2	16	20	23	24	
Double 3"x8"	L1/L12	17'-3"	A2	14	18	20	22	13'-10"	A2	15	19	21	23	11'-9"	B	16	20	22	24	10'-4"	C	17	21	23	25	9'-3"	C	17	21	23	25	8'-5"	C	17	21	23	25	7'-2"																		


SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%


Ground Snow Load: 60 psf Live Load: 20 psf Roof Design Load 51 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.38a


Header	Detail	cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"																																																																																																																																																																																																																																																																																																						
		trib	Min Post	Uplift	Footings (in)	Max Post Length	trib	Min Post	Uplift	Footings (in)	Max Post Length	trib	Min Post	Uplift	Footings (in)	Max Post Length	trib	Min Post	Uplift	Footings (in)	Max Post Length	trib	Min Post	Uplift	Footings (in)	Max Post Length	trib	Min Post	Uplift	Footings (in)	Max Post Length	trib	Min Post	Uplift	Footings (in)	Max Post Length	trib	Min Post	Uplift	Footings (in)	Max Post Length	trib	Min Post	Uplift	Footings (in)	Max Post Length	trib	Min Post	Uplift	Footings (in)	Max Post Length																																																																																																																																																																																																																																																																																								
On Slab	On Slab	1'-7"	A1				1'-8"	A1				1'-9"	A1				1'-10"	A1				1'-11"	A1				1'-12"	A1				1'-13"	A1				1'-14"	A1				1'-15"	A1				1'-16"	A1				1'-17"	A1				1'-18"	A1				1'-19"	A1				1'-20"	A1																																																																																																																																																																																																																																																																							
0.042"x3"x8"	L1	11'-9"	A1	15	23	26	27	9'-3"	A1	15	24	27	28	7'-8"	A1	16	25	28	30	6'-8"	A2	16	25	28	30	5'-10"	A2	17	26	28	30	4'-9"	A2	17	26	29	31	3'-7"	A1	17	26	29	31	2'-11"	A1	17	27	29	31	1'-11"	A1	17	27	29	31	1'-10"	A2	17	27	29	31	1'-9"	A2	17	27	29	31	1'-8"	A2	17	27	29	31	1'-7"	A2	17	27	29	31	1'-6"	A2	17	27	29	31	1'-5"	A2	17	27	29	31	1'-4"	A2	17	27	29	31	1'-3"	A2	17	27	29	31	1'-2"	A2	17	27	29	31	1'-1"	A2	17	27	29	31																																																																																																																																																																																																																								
Double 3"x8"	L1/L12	17'-3"	A2	15	26	28	30	13'-10"	A2	18	27	30	31	11'-9"	B	18	28	31	33	10'-4"	C	19	28	31	33	9'-3"	C	19	29	32	34	8'-5"	C	20	29	32	34	7'-2"	D	20	30	33	35	6'-8"	D	21	30	33	35	5'-10"	D	21	30	33	35	5'-6"	D	21	30	33	35	5'-2"	D	21	30	33	35	4'-10"	D	21	30	33	35	4'-6"	D	21	30	33	35	4'-2"	D	21	30	33	35	3'-10"	D	21	30	33	35	3'-6"	D	21	30	33	35	3'-2"	D	21	30	33	35	2'-10"	D	21	30	33	35	2'-6"	D	21	30	33	35	2'-2"	D	21	30	33	35	1'-10"	D	21	30	33	35	1'-6"	D	21	30	33	35	1'-2"	D	21	30	33	35																																																																																																																																																																																																
Double 2"x6.625"	L2/L12	15'-4"	A1	16	25	27	29	12'-4"	A2	17	26	29	31	10'-7"	A2	18	27	30	32	9'-4"	A2	18	28	31	32	8'-5"	C	19	28	31	33	7'-8"	C	19	29	32	34	6'-7"	C	20	29	32	34	5'-10"	C	20	29	32	34	5'-6"	C	20	29	32	34	5'-2"	C	20	29	32	34	4'-10"	C	20	29	32	34	4'-6"	C	20	29	32	34	4'-2"	C	20	29	32	34	3'-10"	C	20	29	32	34	3'-6"	C	20	29	32	34	3'-2"	C	20	29	32	34	2'-10"	C	20	29	32	34	2'-6"	C	20	29	32	34	2'-2"	C	20	29	32	34	1'-10"	C	20	29	32	34	1'-6"	C	20	29	32	34	1'-2"	C	20	29	32	34																																																																																																																																																																																																						
16 G Steel C	L18	21'-7"	A2	18	27	30	32	16'-4"	B	19	28	31	33	13'-3"	C	19	28	32	33	11'-0"	C	19	29	32	34	9'-2"	C	19	29	32	34	7'-11"	C	19	29	32	34	6'-11"	C	19	29	32	34	5'-6"	C	19	29	32	34	5'-2"	C	19	29	32	34	4'-10"	C	19	29	32	34	4'-6"	C	19	29	32	34	4'-2"	C	19	29	32	34	3'-10"	C	19	29	32	34	3'-6"	C	19	29	32	34	3'-2"	C	19	29	32	34	2'-10"	C	19	29	32	34	2'-6"	C	19	29	32	34	2'-2"	C	19	29	32	34	1'-10"	C	19	29	32	34	1'-6"	C	19	29	32	34	1'-2"	C	19	29	32	34																																																																																																																																																																																																												
14 G Steel C	L18	24'-7"	B	19	28	31	33	19'-5"	C	20	29	32	34	16'-0"	C	20	29	32	34	13'-8"	D	21	30	34	36	11'-11"	D	21	31	34	36	10'-9"	D	21	31	34	36	9'-5"	D	21	31	34	36	8'-4"	D	21	31	34	36	7'-6"	D	21	31	34	36	6'-10"	D	21	31	34	36	6'-6"	D	21	31	34	36	6'-2"	D	21	31	34	36	5'-10"	D	21	31	34	36	5'-6"	D	21	31	34	36	5'-2"	D	21	31	34	36	4'-10"	D	21	31	34	36	4'-6"	D	21	31	34	36	4'-2"	D	21	31	34	36	3'-10"	D	21	31	34	36	3'-6"	D	21	31	34	36	3'-2"	D	21	31	34	36	2'-10"	D	21	31	34	36	2'-6"	D	21	31	34	36	2'-2"	D	21	31	34	36	1'-10"	D	21	31	34	36	1'-6"	D	21	31	34	36	1'-2"	D	21	31	34	36																																																																																																																																																																								
12 G Steel C	L18	28'-0"	C	19	29	32	34	24'-8"	D	21	31	34	36	22'-4"	E	23	33	37	39	19'-11"	E	23	33	37	39	17'-8"	E	24	34	38	40	16'-11"	E	24	34	38	40	14'-9"	E	25	35	39	41	13'-7"	F1	25	35	39	41	12'-8"	F1	25	35	39	41	11'-10"	F1	25	35	39	41	11'-6"	F1	25	35	39	41	11'-2"	F1	25	35	39	41	10'-10"	F1	25	35	39	41	10'-6"	F1	25	35	39	41	10'-2"	F1	25	35	39	41	9'-10"	F1	25	35	39	41	9'-6"	F1	25	35	39	41	9'-2"	F1	25	35	39	41	8'-10"	F1	25	35	39	41	8'-6"	F1	25	35	39	41	8'-2"	F1	25	35	39	41	7'-10"	F1	25	35	39	41	7'-6"	F1	25	35	39	41	7'-2"	F1	25	35	39	41	6'-10"	F1	25	35	39	41	6'-6"	F1	25	35	39	41	6'-2"	F1	25	35	39	41	5'-10"	F1	25	35	39	41	5'-6"	F1	25	35	39	41	5'-2"	F1	25	35	39	41	4'-10"	F1	25	35	39	41	4'-6"	F1	25	35	39	41	4'-2"	F1	25	35	39	41	3'-10"	F1	25	35	39	41	3'-6"	F1	25	35	39	41	3'-2"	F1	25	35	39	41	2'-10"	F1	25	35	39	41	2'-6"	F1	25	35	39	41	2'-2"	F1	25	35	39	41	1'-10"	F1	25	35	39	41	1'-6"	F1	25	35	39	41	1'-2"	F1	25	35	39	41																																																																														
Double 16 G Steel C	L18/L8	29'-1"	C	20	29	32	34	25'-7"	D	22	31	35	37	23'-3"	E	23	33	36	38	21'-6"	E	24	34	38	40	20'-4"	F1	25	35	39	41	19'-3"	F1	26	36	40	42	18'-0"	F1	27	37	41	43	16'-10"	F1	27	37	41	43	16'-6"	F1	27	37	41	43	16'-2"	F1	27	37	41	43	15'-10"	F1	27	37	41	43	15'-6"	F1	27	37	41	43	15'-2"	F1	27	37	41	43	14'-10"	F1	27	37	41	43	14'-6"	F1	27	37	41	43	14'-2"	F1	27	37	41	43	13'-10"	F1	27	37	41	43	13'-6"	F1	27	37	41	43	13'-2"	F1	27	37	41	43	12'-10"	F1	27	37	41	43	12'-6"	F1	27	37	41	43	12'-2"	F1	27	37	41	43	11'-10"	F1	27	37	41	43	11'-6"	F1	27	37	41	43	11'-2"	F1	27	37	41	43	10'-10"	F1	27	37	41	43	10'-6"	F1	27	37	41	43	10'-2"	F1	27	37	41	43	9'-10"	F1	27	37	41	43	9'-6"	F1	27	37	41	43	9'-2"	F1	27	37	41	43	8'-10"	F1	27	37	41	43	8'-6"	F1	27	37	41	43	8'-2"	F1	27	37	41	43	7'-10"	F1	27	37	41	43	7'-6"	F1	27	37	41	43	7'-2"	F1	27	37	41	43	6'-10"	F1	27	37	41	43	6'-6"	F1	27	37	41	43	6'-2"	F1	27	37	41	43	5'-10"	F1	27	37	41	43	5'-6"	F1	27	37	41	43	5'-2"	F1	27	37	41	43	4'-10"	F1	27	37	41	43	4'-6"	F1	27	37	41	43	4'-2"	F1	27	37	41	43	3'-10"	F1	27	37	41	43	3'-6"	F1	27	37	41	43	3'-2"	F1	27	37	41	43	2'-10"	F1	27	37	41	43	2'-6"	F1	27	37	41	43	2'-2"	F1	27	37	41	43	1'-10"	F1	27	37	41	43	1'-6"	F1	27	37	41	43	1'-2"	F1	27	37	41	43
Double 14 G Steel C	L18/L8	31'-0"	C	20	30	33	35	27'-4"	D	22	32	35	37	24'-9"	E	23	33	37	39	22'-11"	E	25	35	38	41	21'-8"	F1	26	36	40	42	20'-7"	F1	27	37	41	43	19'-3"	F1	27	37	41	43	18'-11"	F1	27	37	41	43	18'-7"	F1	27	37	41	43	18'-3"	F1	27	37	41	43	17'-11"	F1	27	37	41	43	17'-7"	F1	27	37	41	43	17'-3"	F1	27	37	41	43	17'-0"	F1	27	37	41	43	16'-10"	F1	27	37	41	43	16'-6"	F1	27	37	41	43	16'-2"	F1	27	37	41	43	15'-10"	F1	27	37	41	43	15'-6"	F1	27	37	41	43	15'-2"	F1	27	37	41	43	14'-10"	F1	27	37	41	43	14'-6"	F1	27	37	41	43	14'-2"	F1	27	37	41	43	13'-10"	F1	27	37	41	43	13'-6"	F1	27	37	41	43	13'-2"	F1	27	37	41	43	12'-10"	F1	27	37	41	43	12'-6"	F1	27	37	41	43	12'-2"	F1	27	37	41	43	11'-10"	F1	27	37	41	43	11'-6"	F1	27	37	41	43	11'-2"	F1	27	37	41	43	10'-10"	F1	27	37	41	43	10'-6"	F1	27	37	41	43	10'-2"	F1	27	37	41	43	9'-10"	F1	27	37	41	43	9'-6"	F1	27	37	41	43	9'-2"	F1	27	37	41	43	8'-10"	F1	27	37	41	43	8'-6"	F1	27	37	41	43	8'-2"	F1	27	37	41	43	7'-10"	F1	27	37	41	43	7'-6"	F1	27	37	41	43	7'-2"	F1	27																																																																					

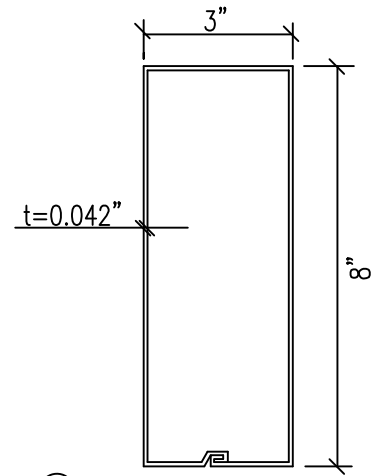

(L1) HEADER
(3004-H34 ALUM. ALLOY)

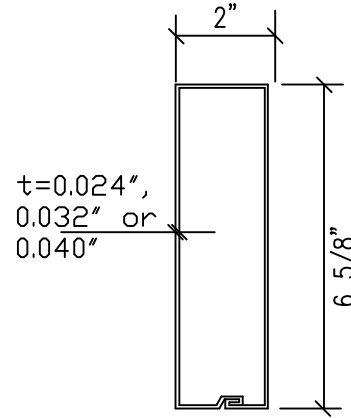


(L2) RAFTER & SIDEPLATES
(3004-H34 ALUM. ALLOY)

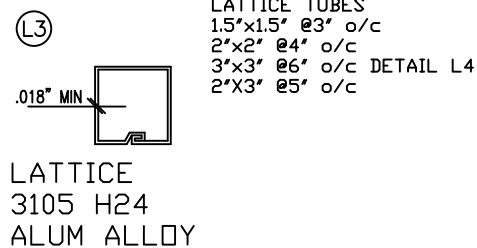


(L3) LATTICE
3105 H24
ALUM ALLOY


LATTICE TUBES
1.5"x1.5" @3" o/c
2"x2" @4" o/c
3"x3" @6" o/c
2"x3" @5" o/c

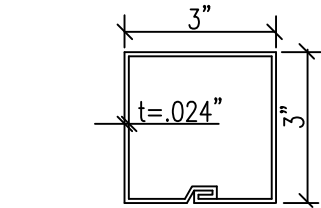

(L4) POST/RAFTER/LATTICE TUBE
(3004-H34 ALUM. ALLOY)

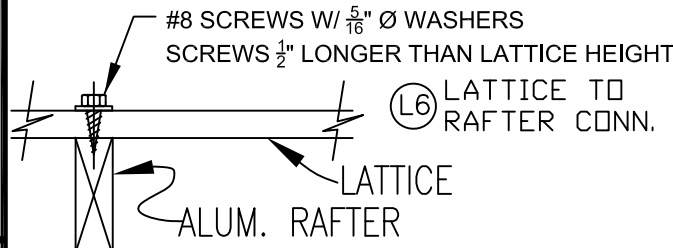


(L6) LATTICE TO RAFTER CONN.

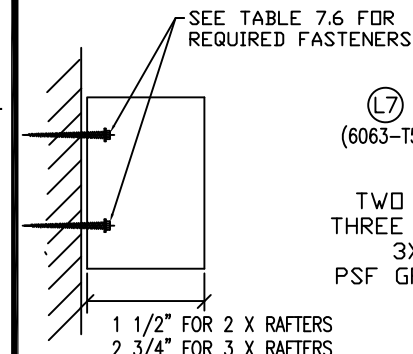


(L7) RAFTER HANGER
(6063-T5 ALUM. ALLOY, 't'= 0.078")

TWO #8 SMS EACH SIDE
THREE #8 SMS EACH SIDE
3X8 RAFTERS IN 50+
PSF GROUND SNOW LOADS

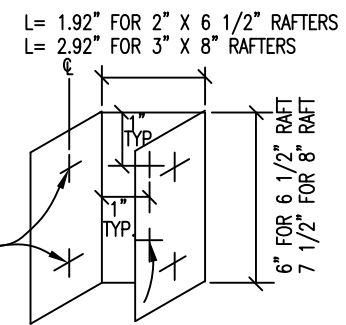

L = 1.92" FOR 2" X 6 1/2" RAFTERS
L = 2.92" FOR 3" X 8" RAFTERS


Beam Type	Required # of 1/4" Bolts (# of #14 Self Drilling Screws)				170 mph Exp C	130 mph Exp C	110 mph Exp C
	60 psf	50 psf	42 psf	25 psf	10 psf (Live)	10 psf (Live)	10 psf (Live)
All C Beams "On Slab"	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)
14g & 16G Steel 3x8	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)
12G Steel 3x8	6 (8)	6 (8)	6 (8)	6 (7)	6 (7)	5 (7)	5 (6)
Double 16G Steel 3x8	5 (12)	4 (12)	4 (10)	4 (10)	4 (10)	4 (8)	4 (8)
Double 14G Steel 3x8	5 (14)	5 (14)	5 (12)	4 (12)	4 (12)	4 (10)	4 (10)
Double 12G Steel 3x8	7 (18)	6 (16)	6 (16)	5 (14)	5 (14)	5 (12)	4 (12)

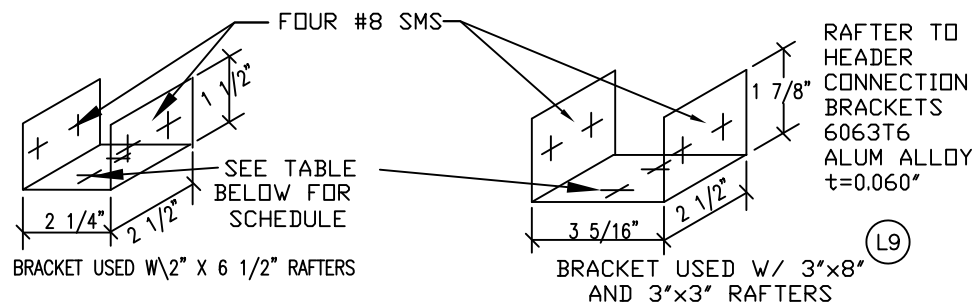


(L9)

CONTINUOUS 2"x6" OR 2x8" DOUGLAS FIR LEDGER OR PROVIDE SIMPSON STRONG TIE MSTA36 (ICC ESR 2105) AT SPLICE LOCATION COVER W/ 0.019" ALUMINUM


1/4" LAG SCREW OR #14 SCREW W/ 2.5" EMBED INTO WOOD STUD SEE TABLE 7.5 COLUMN ANC4 FOR QUANTITY

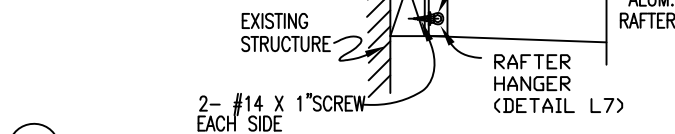

(L10) ALTERNATE RAFTER TO WALL CONN.

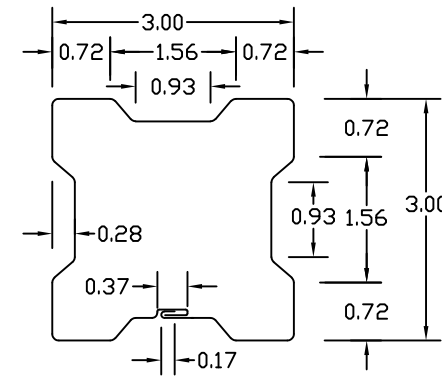


(L11)

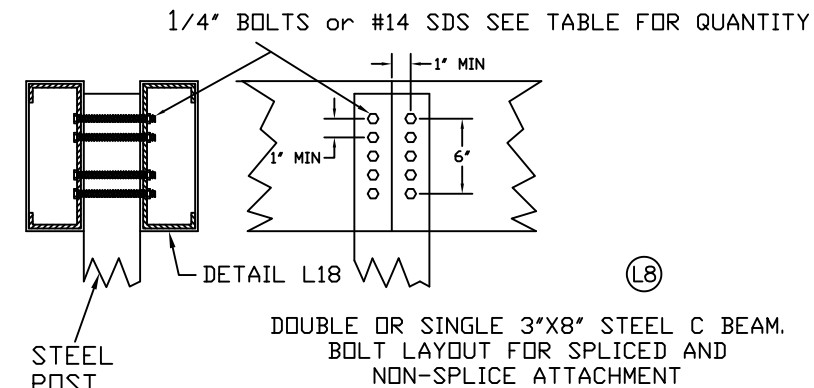

(L8)


Wind Speed	t (in)	Header	Allowable Trib Width				
			No. of #8 Screws				
110 MPH EXPC	0.040	Double 2x6	9'	14'	18'	5	
	0.042	0.042"x3"x8"	5'	7'	9'	12'	
	0.042	Double 3x8	9'	14'	18'		
115 MPH EXPC	0.040	Double 2x6	8'	12'	16'	18'	
	0.042	0.042"x3"x8"	4'	6'	9'	11'	
	0.042	Double 3x8	9'	13'	17'	18'	
			#14 Screws				
130 MPH EXPC	0.040	Double 2x6	10'	15'	18'	5	
	0.042	0.042"x3"x8"	5'	8'	10'	13'	
	0.042	Double 3x8	10'	15'	18'	18'	
150 MPH EXPC	16G min	8" Steel C	10'	14'	18'		
	16G min	Double Steel C	18'				
	16G min	Double Steel C	15'	18'			
170 MPH EXPC	16G min	8" Steel C	7'	11'	15'	18'	
	16G min	Double Steel C					
	16G min	Double Steel C	15'	18'			

DOUBLE HEADERS USE ONE BRACKET PER HEADER

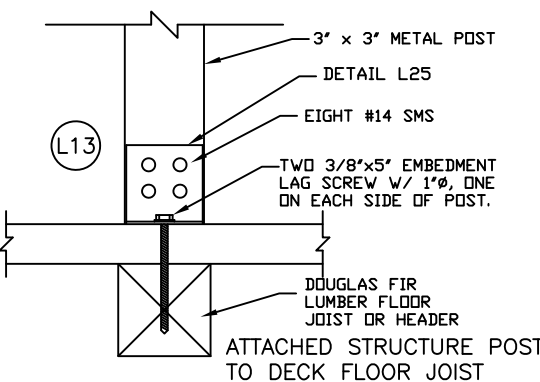


SEE GENERAL NOTE #19 AND LATTICE NOTE #3 UNITS MUST COMPLY WITH TABLES L1 AND L2 ON SHEET M5

MAX WIND SPEED IS 130 mph EXPOSURE C

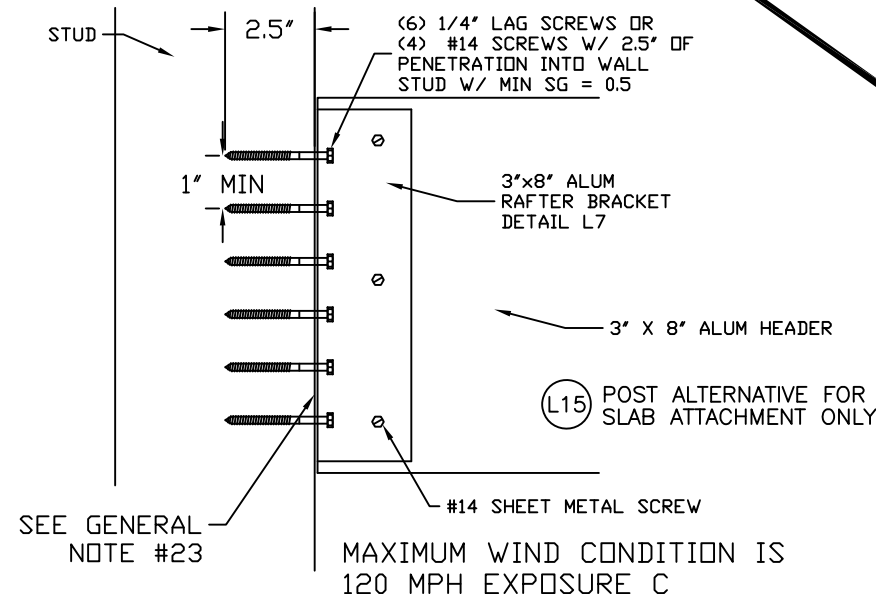

(L15) POST ALTERNATIVE FOR SLAB ATTACHMENT ONLY

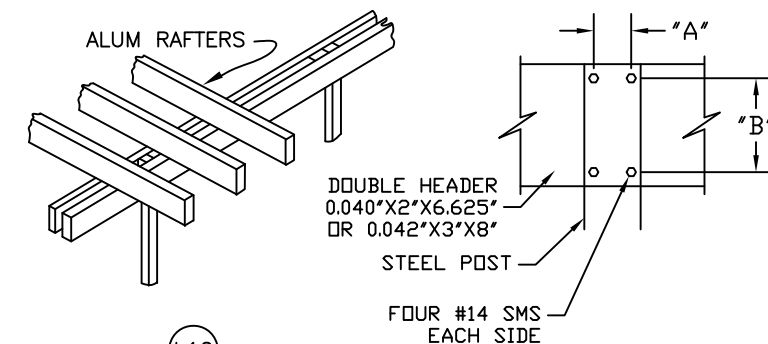

(L12)


NOTE: SEE SHEET MISC5a OR MISC5b FOR MOMENT CONNECTION SPECS



MAY 03 2019

Amerimax 28921 US Hwy 74 Romoland, CA 92585
EXTERIOR HOME PRODUCTS


DRAWN BY: BEJ/CP TYPE:
SCALE: NTS Component Parts & Connection Details For Patio & Commercial Lattice Structures
DATE: FILE#: LT01-2018 SHEET: 1 of 4

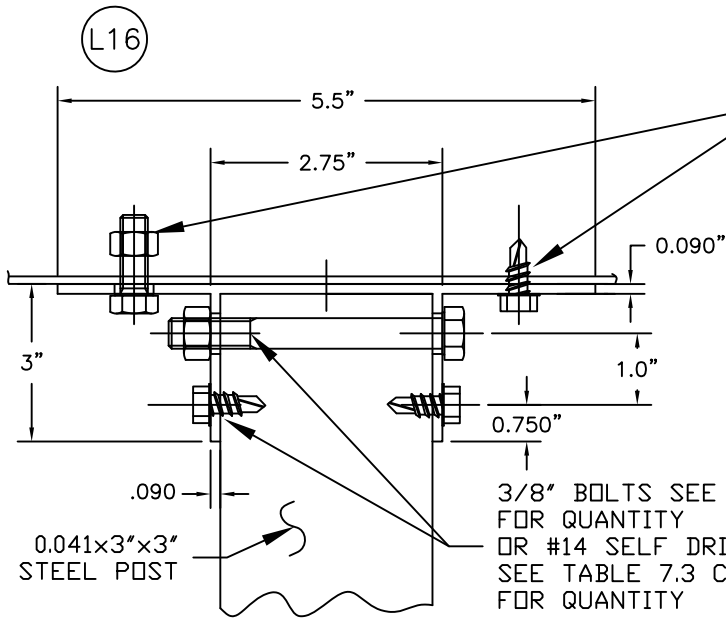

3/8" BOLTS W/ 1" DIA. x 3/32" THK. STL. WASHER TO 8" STEEL "C" BEAM SEE TABLE 7.4 COLUMN "N" FOR QUANTITY FOR #14 SELF DRILLING SCREWS SEE TABLE 7.4 COLUMN "O".

ALTERNATE 3" SQ POST CONNECTOR BRACKET (6063T6 ALUM) IF DETAIL L29 IS NOT USED ATTACH SIDE PLATES AS PER DETAIL L26

3/8" BOLTS SEE TABLE 7.3 COLUMN "J" FOR QUANTITY OR #14 SELF DRILLING SCREWS SEE TABLE 7.3 COLUMN "I" FOR QUANTITY

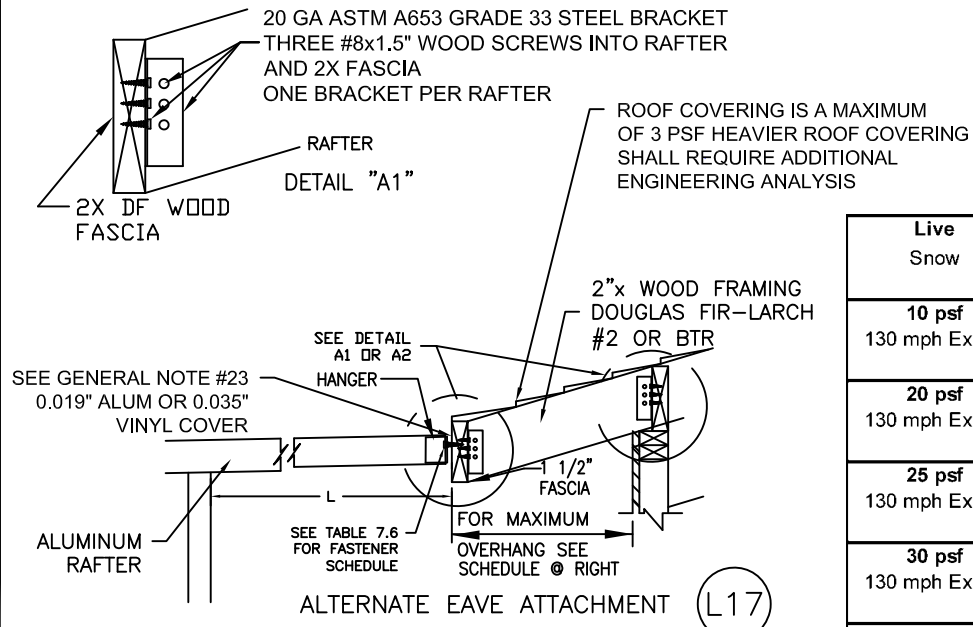


ROOF COVERING IS A MAXIMUM OF 3 PSF HEAVIER ROOF COVERING SHALL REQUIRE ADDITIONAL ENGINEERING ANALYSIS



SEE GENERAL NOTE #23 0.019" ALUM OR 0.035" VINYL COVER

SEE TABLE 7.6 FOR FASTENER SCHEDULE FOR MAXIMUM OVERHANG SEE SCHEDULE @ RIGHT


Live Snow	RAFTER SIZE	MAX DISTANCE TO FIRST ROW OF POSTS "L"					Number of #14 Screws
		6"	12"	18"	24"	30"	
10 psf 130 mph Exp C	2x4	26'-0"	18'-7"	10'-6"	5'-11"	2'-8"	3
	2x6	26'-0"	26'-0"	26'-0"	21'-2"	14'-10"	
	2x8	26'-0"	26'-0"	26'-0"	26'-0"	26'-0"	
20 psf 130 mph Exp C	2x4	19'-0"	9'-9"	5'-6"	3'-1"	1'-4"	4
	2x6	19'-0"	19'-0"	16'-2"	11'-1"	7'-9"	
	2x8	19'-0"	19'-0"	19'-0"	19'-0"	15'-8"	
25 psf 130 mph Exp C	2x4	18'-0"	10'-7"	5'-11"	3'-3"	1'-5"	4
	2x6	18'-0"	18'-0"	17'-8"	12'-1"	8'-5"	
	2x8	18'-0"	18'-0"	18'-0"	18'-0"	17'-1"	
30 psf 130 mph Exp C	2x4	17'-0"	8'-9"	4'-8"	2'-4"	0'-8"	4
	2x6	17'-0"	17'-0"	14'-7"	9'-9"	6'-7"	
	2x8	17'-0"	17'-0"	17'-0"	17'-0"	13'-11"	
36 psf 130 mph Exp C	2x4	16'-0"	7'-2"	3'-8"	1'-8"	0'-2"	4
	2x6	16'-0"	16'-0"	12'-0"	7'-10"	5'-1"	
	2x8	16'-0"	16'-0"	16'-0"	15'-7"	11'-4"	
42 psf 130 mph Exp C	2x4	13'-11"	6'-0"	2'-11"	1'-1"	0'-0"	5
	2x6	14'-0"	14'-0"	10'-0"	6'-5"	3'-11"	
	2x8	14'-0"	14'-0"	14'-0"	13'-0"	9'-3"	
50 psf 130 mph Exp C	2x4	11'-7"	4'-10"	2'-2"	0'-6"	0'-0"	5
	2x6	13'-0"	13'-0"	8'-2"	5'-0"	2'-10"	
	2x8	13'-0"	13'-0"	13'-0"	10'-7"	7'-4"	
60 psf 130 mph Exp C	2x4	9'-7"	3'-10"	1'-6"	0'-1"	0'-0"	5
	2x6	12'-0"	11'-5"	6'-7"	3'-10"	1'-11"	
	2x8	12'-0"	12'-0"	12'-0"	8'-6"	5'-8"	

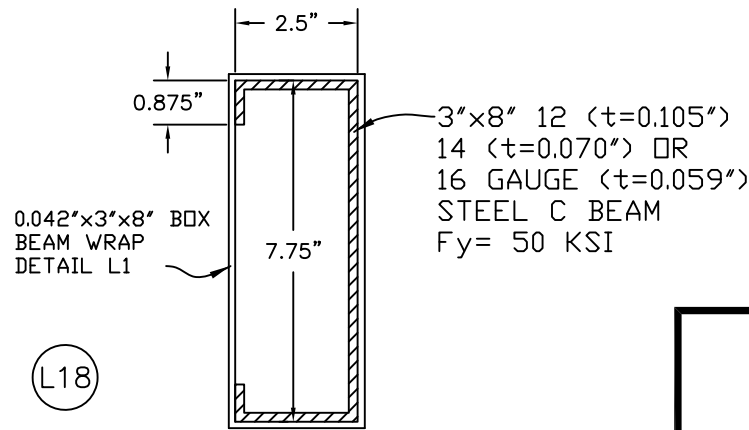


12, 14 and 16 GA 3"x8" STEEL C BEAM W/ 0.042"X3"X8" ALUM WRAP

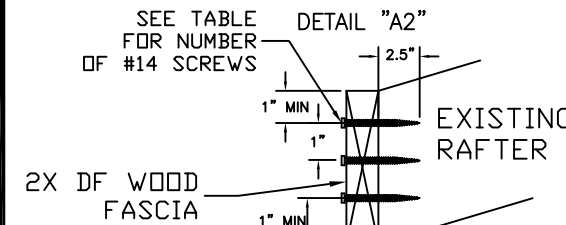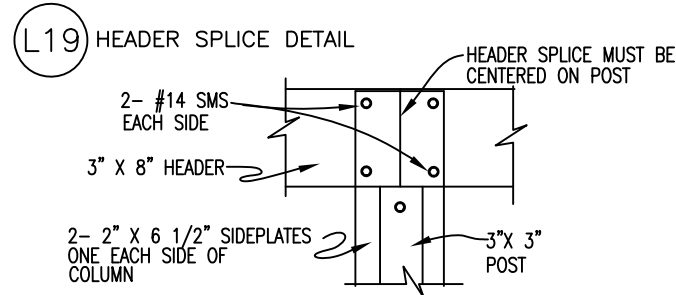

L22 STUCCO ATTACHMENT DETAIL WITH LEDGER BOARD

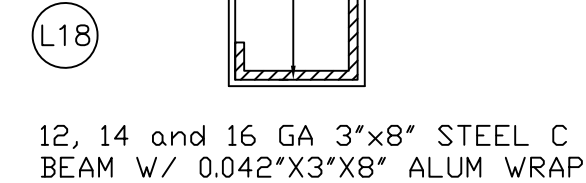

3", 4", 5" OR 6" ASTM A500 GRADE B STEEL POST SEE GENERAL NOTE #9 FOR CORROSION PROTECTION

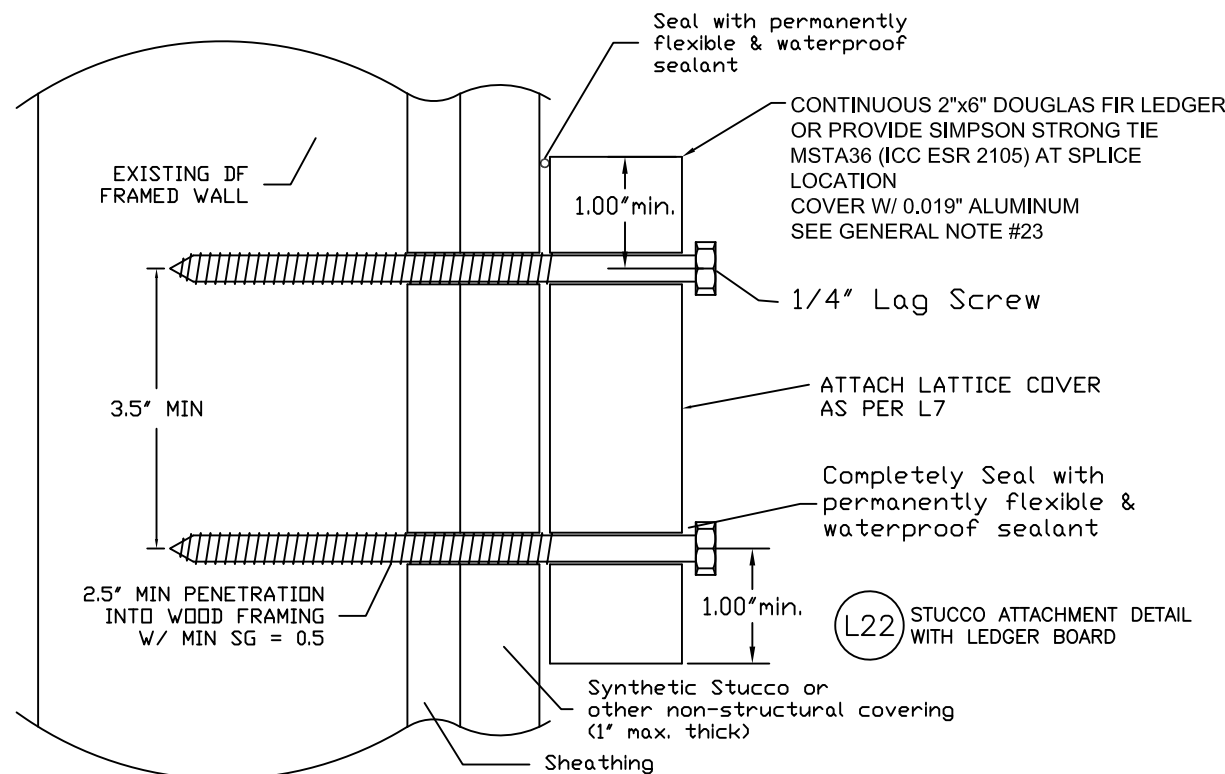


SEE ALLOWABLE DISTANCE TO FIRST ROW OF POSTS IN TABLE 7.7




MAY 03 2019

Amerimax 28921 US Hwy 74 Romoland, CA 92585
 EXTERIOR HOME PRODUCTS


DRAWN BY: BEJ/CP TYPE:
 SCALE: NTS Component Parts & Connection Details For Patio & Commercial Lattice Structures
 DATE: FILE#: LT02-2018 SHEET: 2 of 4

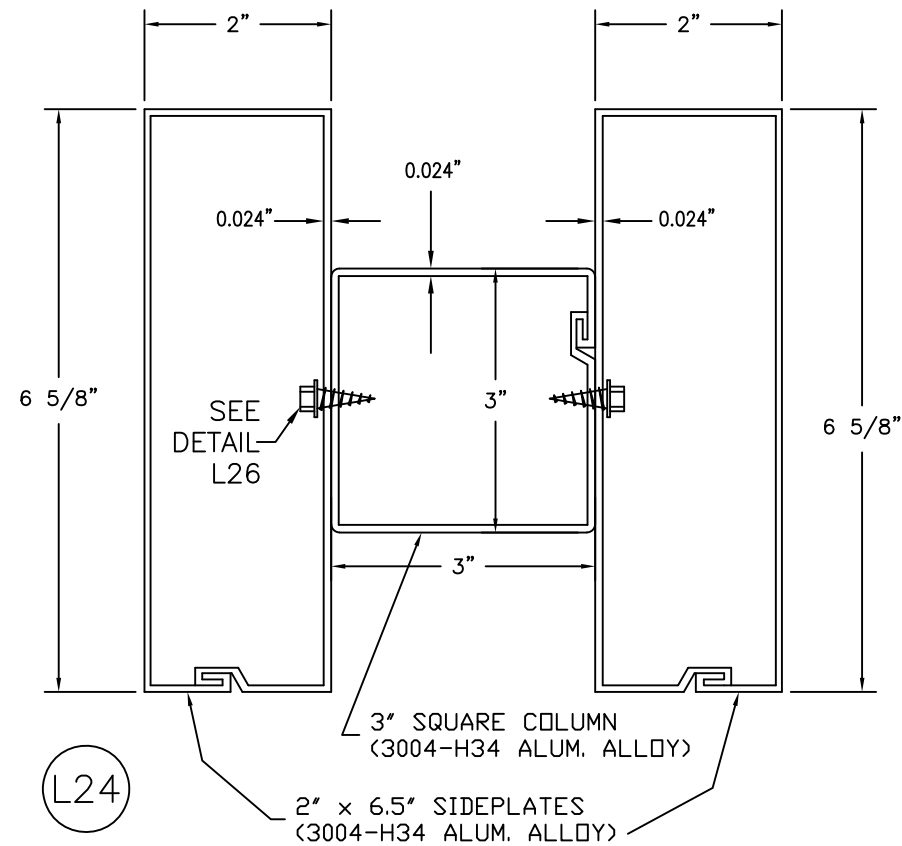


L24

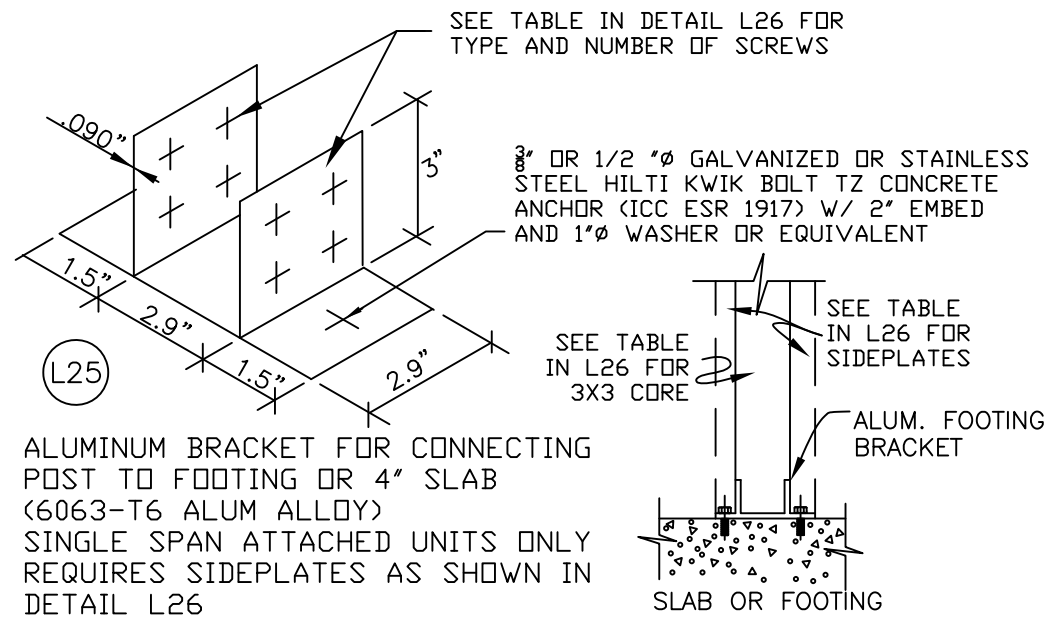

ALUMINUM BRACKET FOR CONNECTING POST TO FOOTING OR 4\"/>

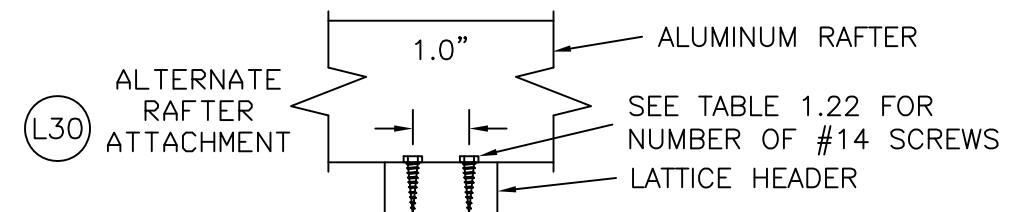

L30

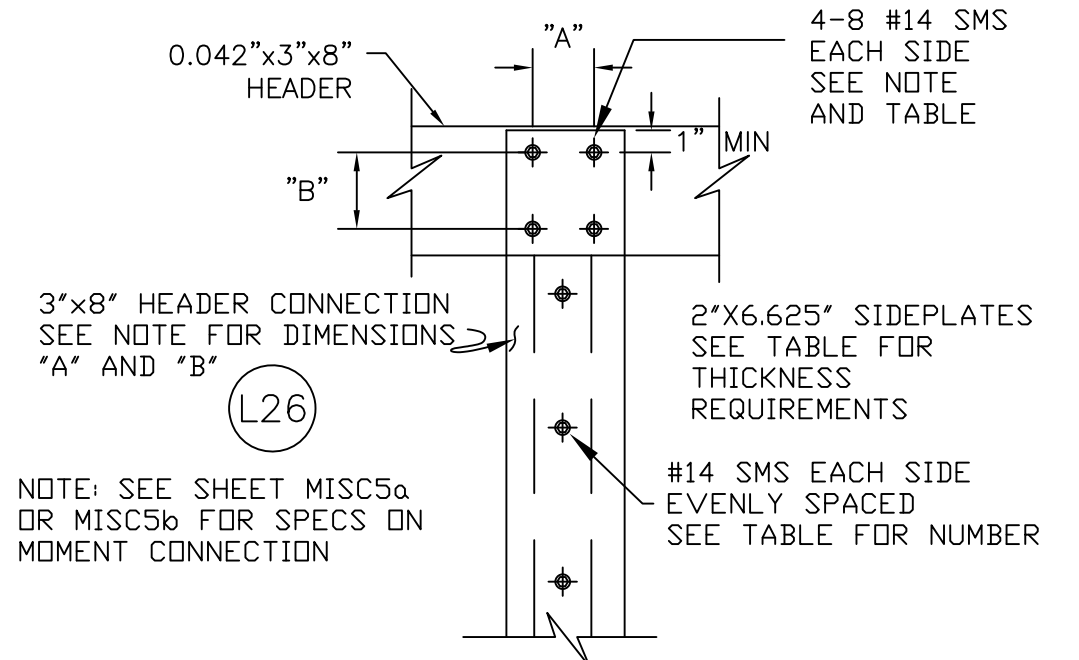


3\"/>

L26


NOTE: SEE SHEET MISC5a OR MISC5b FOR SPECS ON MOMENT CONNECTION

FOOTING d (in)	Number of #14 SMS	Side Plates	3\"/>
26	8	0.024\"/>	
29	8	0.032\"/>	
30	12	0.024\"/>	

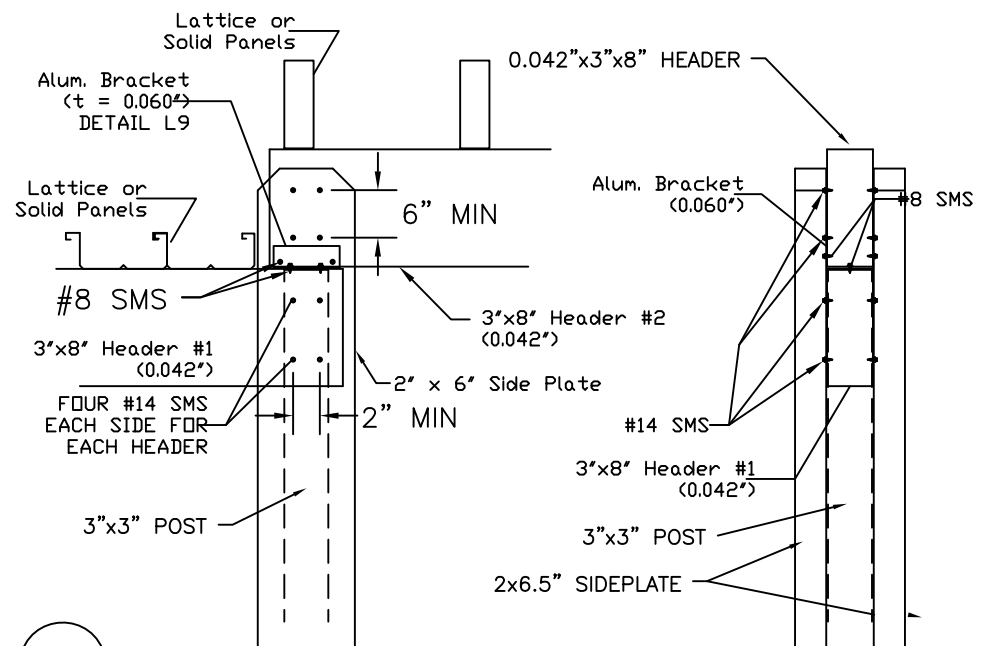


L27

ALTERNATIVE SPLICE FOR ATTACHED UNITS
 USE SAME TABLE IN L26 FOR FOOTING SIZES.
 USE TABLE IN N22 FOR \"ON SLAB\" CONNECTIONS

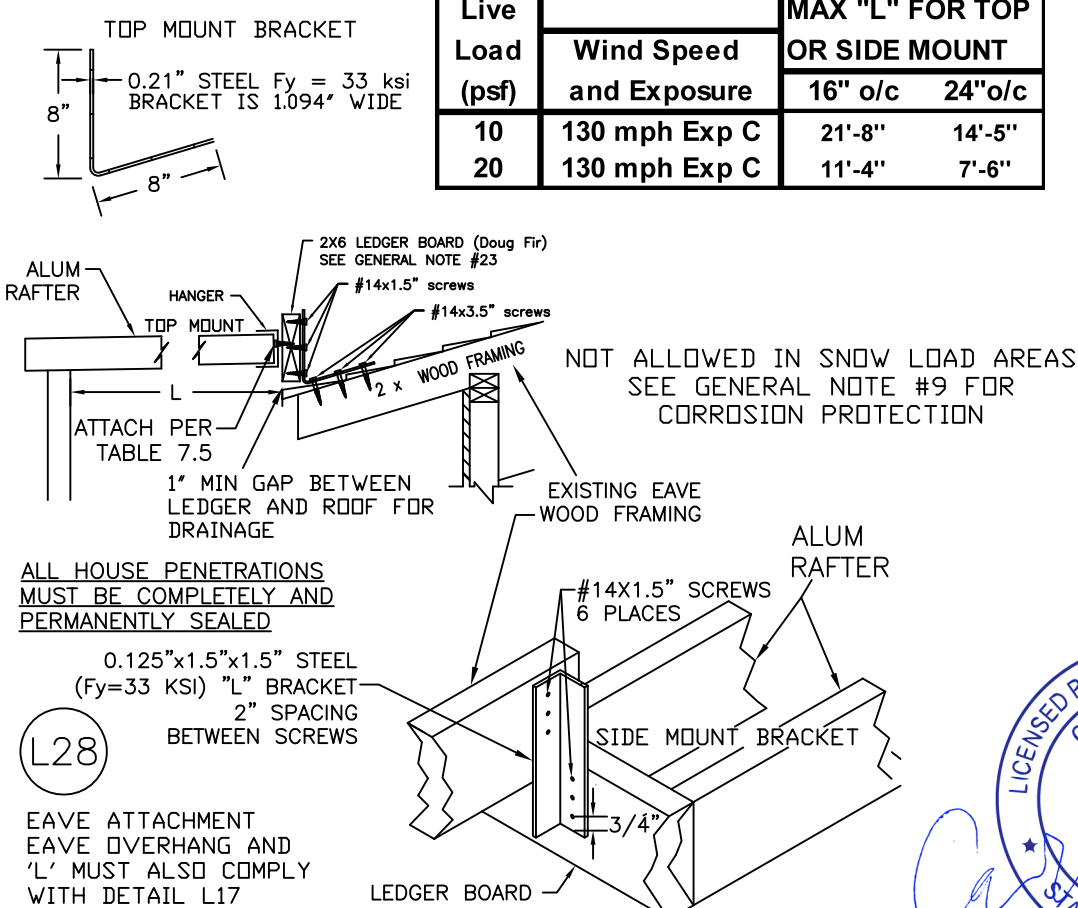

L28

EAVE ATTACHMENT
 EAVE OVERHANG AND 'L' MUST ALSO COMPLY WITH DETAIL L17

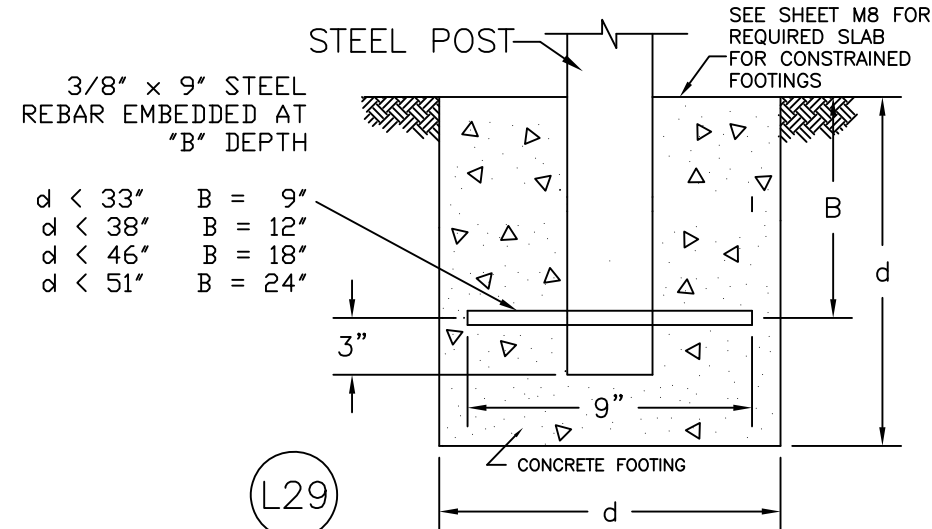

L29


FREESTANDING OR ATTACHED STRUCTURE COLUMN TO FOOTING CONNECTION DETAIL



Amerimax 28921 US Hwy 74 Romoland, CA 92585
 EXTERIOR HOME PRODUCTS


DRAWN BY: BEJ/CP TYPE:
 SCALE: NTS Component Parts & Connection Details For Patio & Commercial Lattice Structures
 DATE: FILE#: LT03-2018 SHEET: 3 of 4

(L31) UNDERHUNG DOUBLE RAFTERS

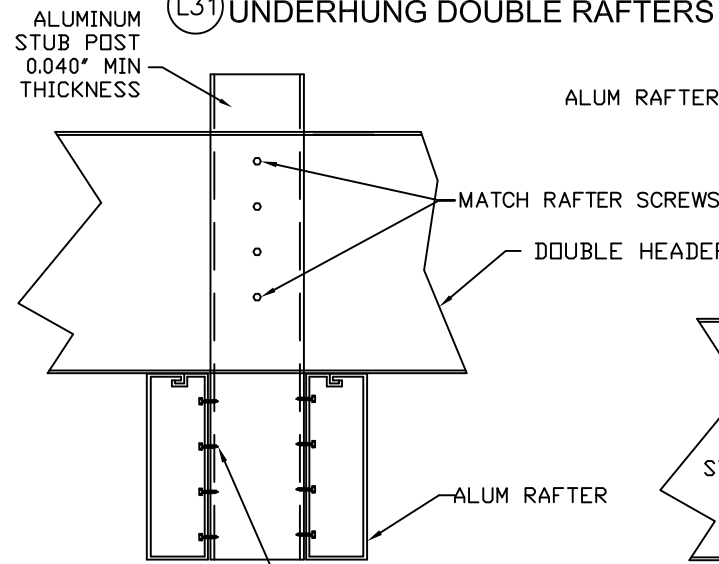


2"X6.625" RAFTERS USE
 2 #14 SMS FOR 36 PSF GSL* AND 170 MPH EXP C
 3 #14 SMS FOR 60 PSF GSL AND 170 MPH EXP C
 3"X8" RAFTERS USE
 3 #14 SMS FOR 30 PSF GSL* AND 170 MPH EXP C
 4 #14 SMS FOR 60 PSF GSL* AND 170 MPH EXP C
 *GSL = GROUND SNOW LOAD


(L32) DOUBLE RAFTERS

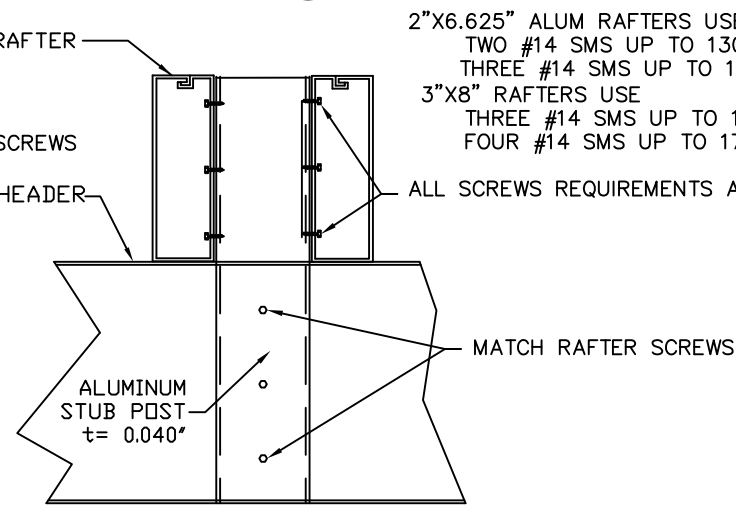

2"X6.625" ALUM RAFTERS USE
 TWO #14 SMS UP TO 130 MPH EXP C
 THREE #14 SMS UP TO 170 MPH EXP C
 3"X8" RAFTERS USE
 THREE #14 SMS UP TO 130 MPH EXP C
 FOUR #14 SMS UP TO 170 MPH EXP C
 ALL SCREWS REQUIREMENTS ARE PER RAFTER

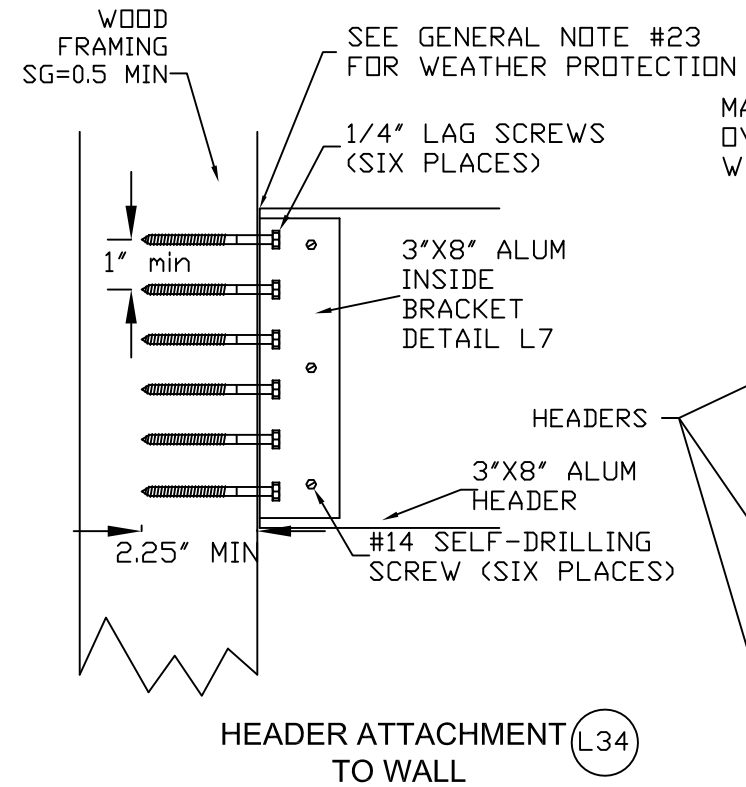


MAY NOT ATTACH HEADER OVER WINDOW OR OTHER WALL OPENING

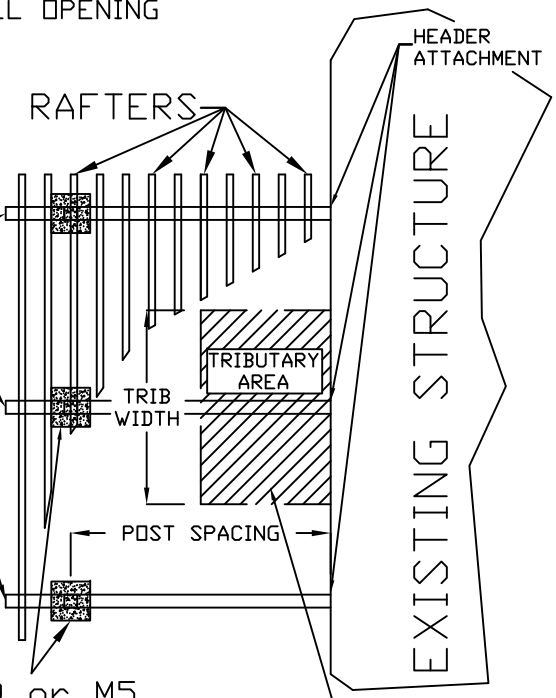

MAX TRIBUTARY AREA
 79 SQ. FT FOR 10 PSF
 62 SQ FT FOR 15 PSF GSL*
 41 SQ FT FOR 20 PSF
 47 SQ FT FOR 25 PSF GSL*
 40 SQ FT FOR 30 PSF GSL*
 *GROUND SNOW LOAD


CHECK ALLOWABLE POST SPACING FOR HEADER IN TABLES

(L33) CRIPPLE RESISTANT CONNECTION FOR RAFTERS

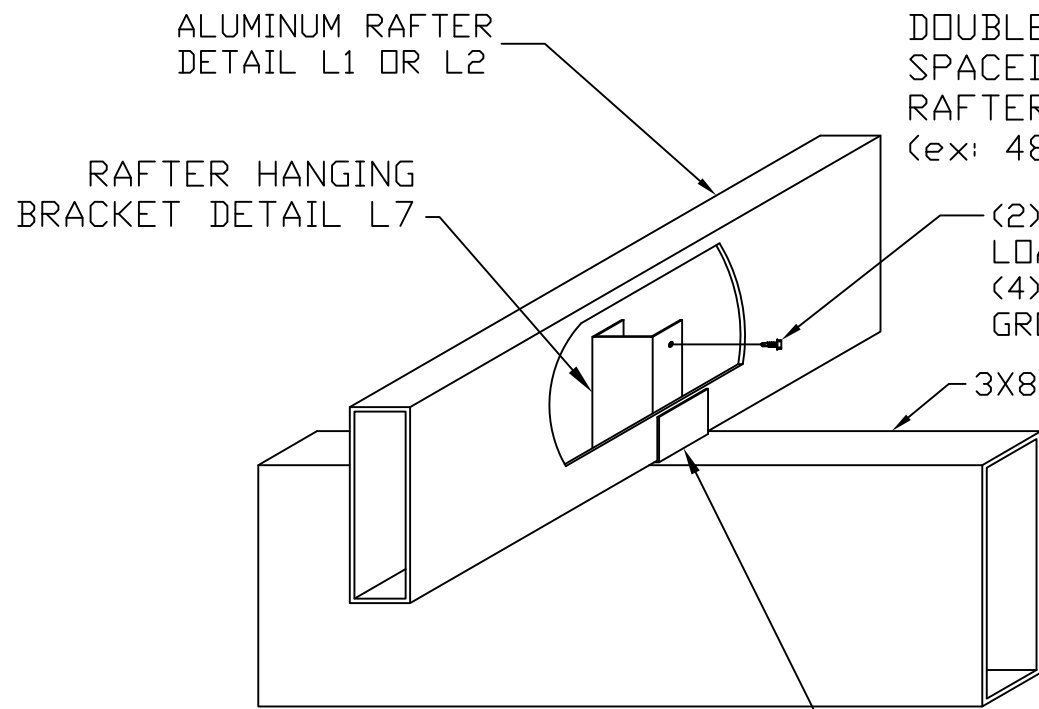

DOUBLE RAFTERS USING THIS DETAIL MAY BE SPACED AS PER TABLES 1.13-1.20 OR SINGLE RAFTERS MAY USE HALF OF THAT SPACING (ex: 48" FOR DOUBLE, 24" FOR SINGLE)

(2) #8 SCREWS FOR ALL GROUND SNOW LOADS UP TO 42 PSF
 (4) #8 SCREWS FOR 42 to 60 PSF GROUND SNOW LOAD

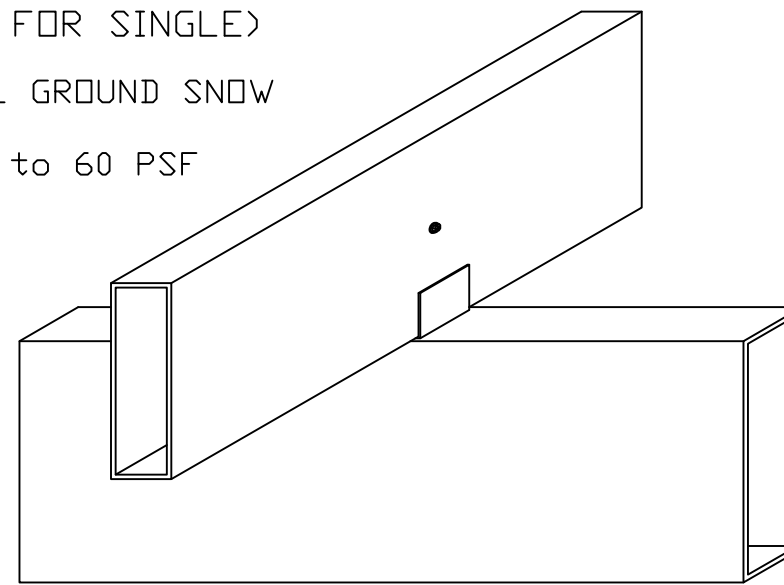

SECTIONED VIEW

ASSEMBLED VIEW

RAFTER MOUNTING BRACKET ATTACHED AS PER DETAIL L9



MAY 03 2019

Amerimax 28921 US Hwy 74 Romoland, CA 92585
 EXTERIOR HOME PRODUCTS

DRAWN BY: CP	TYPE:
SCALE: NTS	Component Parts & Connection Details For Patio & Commercial Lattice Structures
DATE:	FILE#: LT04-2018 SHEET: 4 of 4

SECTION 4.0 SOLID COVER PANEL SPANS FOR ATTACHED COMMERCIAL AND PATIO STRUCTURES

2.5" x6" Super Six (Single Span) Detail N3, A 3.5" x12 Super 12 (Single Span) Detail B 2.5" x 12" Mark X (Single Span) Detail B 2"x6" Flat Panel (Single Span) Detail N2, C

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C			
		95	100	105	110	95	100	105	110
10	0.018	12'-6"	12'-0"	11'-4"	10'-6"	9'-11"	9'-5"	8'-11"	
LIVE	0.024	15'-10"	15'-5"	14'-7"	13'-6"	12'-8"	12'-0"	11'-5"	
	0.032	17'-4"	17'-4"	17'-4"	17'-4"	16'-7"	15'-8"	14'-10"	
	0.036	18'-0"	18'-0"	18'-0"	18'-0"	18'-0"	17'-5"	16'-6"	

TABLE 4.4

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C			
		95	100	105	110	95	100	105	110
20	0.018	10'-2"	10'-2"	10'-2"	9'-11"	9'-9"	9'-5"	8'-11"	
LIVE	0.024	13'-0"	13'-0"	13'-0"	13'-0"	12'-8"	12'-0"	11'-5"	
	0.032	15'-2"	15'-2"	15'-2"	15'-2"	15'-2"	14'-9"	14'-7"	
	0.036	15'-9"	15'-9"	15'-9"	15'-9"	15'-9"	15'-6"	15'-4"	

TABLE 4.5

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C			
		95	100	105	110	95	100	105	110
25	0.018	10'-4"	10'-4"	10'-4"	10'-0"	9'-7"	9'-3"	8'-11"	8'-7"
LIVE	0.024	11'-10"	11'-10"	11'-10"	11'-8"	11'-5"	11'-2"	11'-0"	10'-9"
	0.032	13'-11"	13'-11"	13'-11"	13'-11"	13'-8"	13'-5"	13'-2"	14'-1"
	0.036	14'-11"	14'-11"	14'-11"	14'-11"	14'-7"	14'-4"	14'-1"	

TABLE 4.6

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C			
		95	100	105	110	95	100	105	110
20	0.018	8'-11"	8'-11"	8'-11"	8'-9"	8'-7"	8'-5"	8'-3"	8'-1"
LIVE	0.024	11'-5"	11'-5"	11'-5"	11'-3"	11'-0"	10'-9"	10'-7"	10'-5"
	0.032	12'-8"	12'-8"	12'-8"	12'-8"	12'-8"	12'-6"	12'-4"	12'-2"
	0.040	13'-7"	13'-7"	13'-7"	13'-7"	13'-5"	13'-3"	13'-1"	

TABLE 4.7

NOTE: PANELS MAY OVERHANG 25% OF THEIR CLEARSPAN

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C			
		95	100	105	110	95	100	105	110
10	0.018	10'-6"	10'-6"	10'-6"	10'-6"	10'-6"	10'-0"	9'-6"	
LIVE	0.024	13'-0"	13'-0"	13'-0"	13'-0"	13'-0"	12'-5"	11'-10"	
	0.032	16'-4"	16'-4"	16'-4"	16'-4"	16'-4"	15'-10"	15'-1"	
	0.036	17'-11"	17'-11"	17'-11"	17'-11"	17'-11"	17'-4"	16'-7"	

TABLE 4.8

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C			
		95	100	105	110	95	100	105	110
20	0.018	8'-5"	8'-5"	8'-5"	8'-5"	8'-5"	8'-3"	8'-1"	
LIVE	0.024	10'-6"	10'-6"	10'-6"	10'-6"	10'-6"	10'-4"	10'-1"	
	0.032	13'-4"	13'-4"	13'-4"	13'-4"	13'-4"	13'-1"	12'-9"	
	0.036	14'-7"	14'-7"	14'-7"	14'-7"	14'-7"	14'-4"	14'-0"	

TABLE 4.9

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C			
		95	100	105	110	95	100	105	110
25	0.018	6'-7"	6'-7"	6'-7"	6'-7"	6'-5"	6'-4"	6'-2"	6'-2"
LIVE	0.024	8'-9"	8'-9"	8'-9"	8'-9"	8'-9"	8'-7"	8'-5"	8'-5"
	0.032	11'-0"	11'-0"	11'-0"	11'-0"	11'-0"	10'-9"	10'-6"	10'-6"
	0.036	11'-4"	11'-4"	11'-4"	11'-4"	11'-4"	11'-2"	10'-11"	10'-11"


TABLE 4.10

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C			
		95	100	105	110	95	100	105	110
20	0.018	8'-11"	8'-11"	8'-11"	8'-11"	8'-11"	8'-9"	8'-7"	8'-5"
LIVE	0.024	11'-5"	11'-5"	11'-5"	11'-5"	11'-5"	11'-3"	11'-0"	11'-0"
	0.032	12'-8"	12'-8"	12'-8"	12'-8"	12'-8"	12'-8"	12'-6"	12'-4"
	0.040	13'-7"	13'-7"	13'-7"	13'-7"	13'-7"	13'-7"	13'-5"	13'-3"

TABLE 4.11

Amerimax Exterior
Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
(434) 384-2514
carlputnam@comcast.net

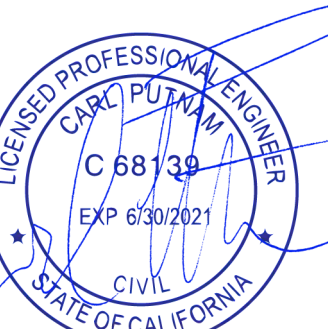

MAY 03 2019

SECTION 4.0 SOLID COVER PANEL SPANS FOR ATTACHED COMMERCIAL AND PATIO STRUCTURES

2.5" x6" Super Six (Single Span) Detail N3, A

3.5" x12 Super 12 (Single Span) Detail B

2.5" x 12" Mark X (Single Span) Detail B

2"x6" Flat Panel (Single Span) Detail N2, C

Table with 4 columns: Ground Snow Load, Panel Gauge, Wind Speed and Exposure, Exposure C. Rows include LIVE, 20, 25, 30, 36, 42, 50, 60 with various wind speed and exposure values.

Table with 4 columns: Ground Snow Load, Panel Gauge, Wind Speed and Exposure, Exposure C. Rows include LIVE, 20, 25, 30, 36, 42, 50, 60 with various wind speed and exposure values.

Table with 4 columns: Ground Snow Load, Panel Gauge, Wind Speed and Exposure, Exposure C. Rows include LIVE, 20, 25, 30, 36, 42, 50, 60 with various wind speed and exposure values.

Table with 4 columns: Ground Snow Load, Panel Gauge, Wind Speed and Exposure, Exposure C. Rows include LIVE, 20, 25, 30, 36, 42, 50, 60 with various wind speed and exposure values.

TABLE 4.12

TABLE 4.13

TABLE 4.14

TABLE 4.15

NOTE: PANELS MAY OVERHANG 25% OF THEIR CLEARSPAN

2.5" x6" Super Six (Multispan) Detail N3, A

3.5" x12 Super 12 (Multi Span) Detail B

2.5" x 12" Mark X (Multispan) Detail B

2"x6" Flat Panel (Multispan) Detail N2, C

Table with 4 columns: Ground Snow Load, Panel Gauge, Wind Speed and Exposure, Exposure C. Rows include LIVE, 20, 25, 30, 36, 42, 50, 60 with various wind speed and exposure values.

Table with 4 columns: Ground Snow Load, Panel Gauge, Wind Speed and Exposure, Exposure C. Rows include LIVE, 20, 25, 30, 36, 42, 50, 60 with various wind speed and exposure values.

Table with 4 columns: Ground Snow Load, Panel Gauge, Wind Speed and Exposure, Exposure C. Rows include LIVE, 20, 25, 30, 36, 42, 50, 60 with various wind speed and exposure values.

Table with 4 columns: Ground Snow Load, Panel Gauge, Wind Speed and Exposure, Exposure C. Rows include LIVE, 20, 25, 30, 36, 42, 50, 60 with various wind speed and exposure values.

TABLE 4.16

TABLE 4.17

TABLE 4.18

TABLE 4.19

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 (434) 384-2514

carlputnam@comcast.net



MAY 03 2019

SECTION 4.0 SOLID COVER PANEL SPANS FOR FREESTANDING COMMERCIAL AND PATIO STRUCTURES

2.5" x6" Super Six (Single Span) Detail N3, A

3.5"x12" Super 12 (Single Span) Detail D

2.5" x 12" Mark X (Single Span) Detail B

2"x6" Flat Panel (Single Span) Detail N2, C

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C													
		100	110	115	95	100	105	110	95			100	105	110	100	110	115	95	100			105	110	100	110	115	95	100	105			110	100	110	115	95	100	105	110
10	0.018	12'-6"	12'-6"	12'-1"	12'-1"	12'-1"	11'-9"	11'-5"	10	0.018	12'-9"	12'-9"	12'-5"	12'-5"	12'-0"	11'-8"	10	0.018	9'-2"	8'-2"	7'-10"	8'-8"	8'-2"	7'-10"	7'-5"	10	0.018	11'-0"	11'-0"	10'-8"	10'-8"	10'-8"	10'-4"	8'-11"					
LIVE	0.024	15'-10"	15'-10"	15'-2"	15'-5"	15'-5"	15'-0"	14'-4"	LIVE	0.024	14'-7"	14'-7"	14'-2"	14'-2"	13'-9"	13'-5"	LIVE	0.024	12'-5"	12'-5"	12'-2"	12'-2"	12'-2"	11'-11"	11'-8"	LIVE	0.024	13'-3"	13'-3"	12'-11"	12'-11"	12'-11"	12'-8"	12'-6"					
	0.032	17'-4"	17'-4"	17'-0"	17'-0"	17'-0"	16'-8"	16'-5"		0.032	17'-2"	17'-2"	16'-7"	16'-7"	16'-2"	15'-8"		0.032	13'-7"	13'-7"	13'-4"	13'-4"	13'-4"	13'-1"	12'-10"		0.032	14'-6"	14'-6"	14'-2"	14'-2"	14'-2"	13'-11"	13'-8"					
	0.036	18'-0"	18'-0"	17'-8"	17'-8"	17'-8"	17'-4"	17'-0"		0.036	18'-4"	18'-4"	17'-9"	17'-9"	17'-3"	16'-9"		0.036	14'-1"	14'-1"	13'-10"	13'-10"	13'-10"	13'-7"	13'-4"		0.040	15'-6"	15'-6"	15'-3"	15'-3"	15'-3"	14'-11"	14'-8"					

Amerimax Exterior Home Products
 28921 US Hwy 74
 Romoland, CA 92585

Carl Putnam, P. E.
 3441 Ivylink Place
 Lynchburg, VA 24503
 (434) 384-2514
 carlputnam@comcast.net



TABLE 4.20

TABLE 4.21

TABLE 4.22

TABLE 4.23

NOTE: PANELS MAY OVERHANG 25% OF THEIR CLEARSPAN

2.5" x6" Super Six (Multispan) Detail N3, A

3.5"x12" Super 12 (Multispan) Detail D

2.5" x 12" Mark X (Multispan) Detail B

2"x6" Flat Panel (Multispan) Detail N2, C

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C													
		100	110	115	95	100	105	110	95			100	105	110	100	110	115	95	100			105	110	100	110	115	95	100	105			110	100	110	115	95	100	105	110
10	0.018	10'-6"	10'-6"	10'-2"	10'-2"	10'-2"	9'-10"	9'-7"	10	0.018	8'-4"	8'-4"	7'-11"	7'-11"	7'-11"	7'-3"	10	0.018	8'-3"	8'-3"	8'-0"	8'-0"	8'-0"	7'-9"	7'-6"	10	0.018	11'-0"	11'-0"	10'-8"	10'-8"	10'-8"	10'-4"	10'-1"					
LIVE	0.024	13'-0"	13'-0"	12'-7"	12'-7"	12'-7"	12'-3"	11'-11"	LIVE	0.024	11'-5"	11'-5"	10'-11"	10'-11"	10'-11"	10'-1"	LIVE	0.024	10'-11"	10'-11"	10'-7"	10'-7"	10'-7"	10'-3"	9'-11"	LIVE	0.024	13'-3"	13'-3"	12'-11"	12'-11"	12'-11"	12'-8"	12'-6"					

TABLE 4.24

TABLE 4.25

TABLE 4.26

TABLE 4.27

SECTION 4.0 SOLID COVER PANEL SPANS FOR FREESTANDING COMMERCIAL AND PATIO STRUCTURES

2.5" x 6" Super Six (Single Span) Detail N3, A

3.5"x12" Super 12 (Single Span) Detail D

2.5" x 12" Mark X (Single Span) Detail B

2"x6" Flat Panel (Single Span) Detail N2, C

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure C				Exposure C						Exposure C				Exposure C						Exposure C				Exposure C													
		115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170				
10	0.018	11'-0"	10'-6"	7'-10"	7'-4"	6'-10"	6'-4"	6'-0"	10	0.018	11'-5"	11'-1"	10'-7"	7'-3"	6'-6"	5'-10"	5'-4"	10	0.018	7'-1"	6'-10"	6'-3"	5'-10"	5'-5"	3'-7"	3'-4"	10	0.018	8'-7"	8'-5"	7'-10"	7'-6"	7'-1"	6'-7"	6'-3"				
LIVE	0.024	13'-9"	13'-2"	12'-1"	11'-2"	10'-5"	7'-11"	7'-6"	LIVE	0.024	13'-0"	12'-9"	12'-2"	11'-5"	11'-0"	10'-5"	8'-3"	LIVE	0.024	11'-4"	11'-0"	8'-3"	7'-8"	7'-1"	6'-8"	6'-3"	LIVE	0.024	12'-3"	12'-1"	11'-8"	11'-0"	10'-7"	8'-7"	8'-0"				
	0.032	16'-1"	15'-10"	15'-4"	14'-3"	13'-3"	12'-5"	11'-8"		0.032	15'-4"	14'-11"	14'-3"	13'-5"	12'-11"	12'-3"	11'-8"		0.032	12'-7"	12'-5"	12'-0"	11'-6"	10'-11"	8'-3"	7'-10"		0.032	13'-5"	13'-3"	12'-10"	12'-4"	12'-0"	11'-7"	11'-3"				
	0.036	16'-9"	16'-5"	16'-0"	15'-4"	14'-7"	13'-8"	12'-10"		0.036	16'-4"	16'-0"	15'-3"	14'-4"	13'-10"	13'-1"	12'-6"		0.036	13'-1"	12'-11"	12'-6"	12'-0"	11'-3"	10'-7"	8'-1"		0.040	14'-5"	14'-2"	13'-9"	13'-3"	12'-11"	12'-6"	12'-1"				

Amerimax Exterior
Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
(434) 384-2514
carlputnam@comcast.net



TABLE 4.28

TABLE 4.29

TABLE 4.30

TABLE 4.31

NOTE: PANELS MAY OVERHANG 25% OF THEIR CLEARSPAN

2.5" x 6" Super Six (Multispan) Detail N3, A

3.5"x12" Super 12 (Multispan) Detail D

2.5" x 12" Mark X (Multispan) Detail B

2"x6" Flat Panel (Multispan) Detail N2, C

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure C				Exposure C						Exposure C				Exposure C						Exposure C				Exposure C													
		115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170				
10	0.018	9'-4"	9'-1"	7'-5"	7'-0"	6'-8"	6'-4"	7'-0"	10	0.018	6'-11"	6'-7"	4'-8"	4'-4"	3'-11"	3'-7"	3'-3"	10	0.018	7'-4"	7'-1"	5'-9"	5'-5"	5'-1"	4'-10"	5'-5"	10	0.018	9'-10"	9'-7"	7'-10"	7'-6"	7'-1"	6'-9"	7'-6"				
LIVE	0.024	11'-7"	11'-4"	9'-3"	8'-10"	8'-4"	7'-11"	8'-10"	LIVE	0.024	9'-8"	9'-4"	6'-10"	6'-4"	5'-10"	5'-4"	6'-4"	LIVE	0.024	9'-8"	9'-5"	7'-8"	7'-3"	6'-10"	6'-6"	7'-3"	LIVE	0.024	12'-3"	12'-1"	10'-1"	9'-7"	9'-1"	8'-7"	9'-7"				
	0.032	14'-7"	14'-3"	11'-8"	11'-2"	10'-7"	10'-2"	11'-2"		0.032	13'-6"	13'-1"	10'-0"	9'-4"	8'-8"	8'-0"	9'-4"		0.032	12'-1"	11'-9"	9'-7"	9'-2"	8'-8"	8'-2"	9'-2"		0.032	13'-5"	13'-3"	11'-7"	11'-3"	10'-10"	10'-6"	11'-3"				
	0.036	16'-0"	15'-8"	12'-10"	12'-3"	11'-7"	11'-0"	12'-3"		0.036	15'-3"	14'-9"	11'-5"	10'-9"	9'-11"	9'-3"	10'-9"		0.036	12'-6"	12'-2"	9'-11"	9'-6"	8'-11"	8'-6"	9'-6"		0.040	14'-5"	14'-2"	12'-6"	12'-1"	11'-8"	11'-3"	12'-1"				

TABLE 4.32

TABLE 4.33

TABLE 4.34

TABLE 4.35

Headers	Panel Thickness (in)	100 MPH EXP B				105 MPH EXP B			110 MPH EXP B			100 MPH EXP C or 115 MPH EXP B					105 MPH EXP C or 120 MPH EXP B						110 MPH EXP C or 130 MPH EXP B						
		1	2	3	4	1	2	3	1	2	3	1	2	3	4	5	1	2	3	4	5	6	1	2	3	4	5	6	7
		Number of #10 Sheet Metal Screws Required per foot at Header/Panel Connection																											
Dble Headers	0.018	6'	12'	MAX	MAX	5'	11'	MAX	5'	10'	MAX	4'	8'	12'	MAX	MAX	4'	8'	11'	MAX	MAX	MAX	3'	7'	10'	MAX	MAX	MAX	MAX
Single 3x8	0.018	3'	6'	9'	12'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	6'	8'	9'	11'	2'	3'	5'	7'	9'	10'	12'
0.060" Alum	0.018	3'	6'	9'	12'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	6'	8'	9'	11'	2'	3'	5'	7'	9'	10'	12'
All others	0.018	3'	6'	9'	12'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	6'	8'	9'	11'	2'	3'	5'	7'	9'	10'	12'
Dble Headers	0.024	8'	16'	MAX	MAX	7'	14'	MAX	6'	13'	MAX	6'	11'	MAX	MAX	MAX	5'	10'	15'	MAX	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	MAX
Single 3x8	0.024	4'	8'	12'	16'	4'	7'	11'	3'	6'	10'	3'	6'	8'	11'	14'	3'	5'	8'	10'	13'	15'	2'	5'	7'	9'	11'	14'	MAX
0.060" Alum	0.024	4'	8'	12'	16'	4'	7'	11'	3'	6'	10'	3'	6'	8'	11'	14'	3'	5'	8'	10'	13'	15'	2'	5'	7'	9'	11'	14'	MAX
All others	0.024	4'	8'	12'	16'	4'	7'	11'	3'	6'	10'	3'	6'	8'	11'	14'	3'	5'	8'	10'	13'	15'	2'	5'	7'	9'	11'	14'	MAX
Dble Headers	0.032	10'	MAX	MAX	MAX	9'	MAX	MAX	9'	17'	MAX	7'	15'	MAX	MAX	MAX	7'	13'	MAX	MAX	MAX	MAX	6'	12'	MAX	MAX	MAX	MAX	MAX
Single 3x8	0.032	5'	10'	16'	MAX	5'	9'	14'	4'	9'	13'	4'	7'	11'	15'	MAX	3'	7'	10'	13'	17'	MAX	3'	6'	9'	12'	15'	MAX	MAX
0.060" Alum	0.032	5'	10'	16'	MAX	5'	9'	14'	4'	9'	13'	4'	7'	11'	15'	MAX	3'	7'	10'	13'	17'	MAX	3'	6'	9'	12'	15'	MAX	MAX
All others	0.032	5'	10'	16'	MAX	5'	9'	14'	4'	9'	13'	4'	7'	11'	15'	MAX	3'	7'	10'	13'	17'	MAX	3'	6'	9'	12'	15'	MAX	MAX
Dble Headers	0.036	11'	MAX	MAX	MAX	10'	MAX	MAX	9'	17'	MAX	7'	15'	MAX	MAX	MAX	7'	14'	MAX	MAX	MAX	MAX	6'	12'	MAX	MAX	MAX	MAX	MAX
Single 3x8	0.036	6'	11'	17'	MAX	5'	10'	15'	5'	9'	14'	4'	8'	12'	16'	MAX	4'	7'	11'	14'	18'	MAX	3'	6'	10'	13'	16'	MAX	MAX
0.060" Alum	0.036	6'	12'	18'	MAX	5'	11'	16'	5'	10'	15'	4'	8'	12'	17'	MAX	4'	8'	11'	15'	MAX	MAX	3'	7'	10'	14'	17'	MAX	MAX
All others	0.036	6'	12'	18'	MAX	5'	11'	16'	5'	10'	15'	4'	8'	12'	17'	MAX	4'	8'	11'	15'	MAX	MAX	3'	7'	10'	14'	17'	MAX	MAX

Table 4.36a Maximum Tributary Width for Each Header/Panel and Number of #10 Screw Combination

Headers	Panel Thickness (in)	100 MPH EXP B			105 MPH EXP B			110 MPH EXP B			100 MPH EXP C or 115 MPH EXP B					105 MPH EXP C or 120 MPH EXP B						110 MPH EXP C or 130 MPH EXP B						
		1	2	3	1	2	3	1	2	3	1	2	3	4	5	1	2	3	4	5	6	1	2	3	4	5	6	
		Number of #14 Sheet Metal Screws Required per foot at Header/Panel Connection																										
Dble Headers	0.018	11'	MAX	MAX	10'	MAX	MAX	9'	MAX	MAX	8'	MAX	MAX	MAX	MAX	7'	MAX	MAX	MAX	MAX	MAX	6'	MAX	MAX	MAX	MAX	MAX	
Single 3x8	0.018	6'	11'	MAX	5'	10'	MAX	5'	9'	MAX	4'	8'	12'	MAX	MAX	4'	7'	11'	MAX	MAX	MAX	3'	6'	10'	MAX	MAX	MAX	
0.060" Alum	0.018	6'	11'	MAX	5'	10'	MAX	5'	9'	MAX	4'	8'	12'	MAX	MAX	4'	7'	11'	MAX	MAX	MAX	3'	6'	10'	MAX	MAX	MAX	
All others	0.018	6'	11'	MAX	5'	10'	MAX	5'	9'	MAX	4'	8'	12'	MAX	MAX	4'	7'	11'	MAX	MAX	MAX	3'	6'	10'	MAX	MAX	MAX	
Dble Headers	0.024	14'	MAX	MAX	13'	MAX	MAX	11'	MAX	MAX	10'	MAX	MAX	MAX	MAX	9'	MAX	MAX	MAX	MAX	MAX	8'	MAX	MAX	MAX	MAX	MAX	
Single 3x8	0.024	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	MAX	MAX	MAX	
0.060" Alum	0.024	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	MAX	MAX	MAX	
All others	0.024	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	MAX	MAX	MAX	
Dble Headers	0.032	14'	MAX	MAX	13'	MAX	MAX	11'	MAX	MAX	10'	MAX	MAX	MAX	MAX	9'	MAX	MAX	MAX	MAX	MAX	8'	16'	MAX	MAX	MAX	MAX	
Single 3x8	0.032	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	17'	MAX	MAX	
0.060" Alum	0.032	10'	MAX	MAX	9'	MAX	MAX	8'	16'	MAX	7'	14'	MAX	MAX	MAX	6'	13'	MAX	MAX	MAX	MAX	6'	11'	17'	MAX	MAX	MAX	
All others	0.032	10'	MAX	MAX	9'	MAX	MAX	8'	16'	MAX	7'	14'	MAX	MAX	MAX	6'	13'	MAX	MAX	MAX	MAX	6'	11'	17'	MAX	MAX	MAX	
Dble Headers	0.036	14'	MAX	MAX	13'	MAX	MAX	11'	MAX	MAX	10'	MAX	MAX	MAX	MAX	9'	18'	MAX	MAX	MAX	MAX	8'	16'	MAX	MAX	MAX	MAX	
Single 3x8	0.036	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	17'	MAX	MAX	
0.060" Alum	0.036	10'	MAX	MAX	9'	18'	MAX	8'	16'	MAX	7'	14'	MAX	MAX	MAX	6'	13'	MAX	MAX	MAX	MAX	6'	11'	17'	MAX	MAX	MAX	
All others	0.036	11'	MAX	MAX	10'	MAX	MAX	9'	MAX	MAX	8'	16'	MAX	MAX	MAX	7'	14'	MAX	MAX	MAX	MAX	6'	13'	MAX	MAX	MAX	MAX	

Table 4.37a Maximum Tributary Width for Each Header/Panel and Number of #14 Screw Combination

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
(434) 384-2514
carlputnam@comcast.net



Headers	Panel Thickness (in)	115 MPH EXP C or 130 MPH EXP B				120 MPH EXP C or 140 MPH EXP B			130 MPH EXP C or 150 MPH EXP B			140 MPH EXP C or 160 MPH EXP B					150 MPH EXP C or 170 MPH EXP B						160 MPH EXP C or 170 MPH EXP B						
		1	2	3	4	1	2	3	1	2	3	1	2	3	4	5	1	2	3	4	5	6	1	2	3	4	5	6	7
Number of #10 Sheet Metal Screws Required per foot at Header/Panel Connection																													
Dble Headers	0.018	3'	6'	9'	12'	3'	6'	9'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	5'	7'	9'	11'	2'	3'	5'	6'	8'	10'	11'
Single 3x8	0.018	2'	3'	5'	6'	1'	3'	4'	1'	2'	4'	1'	2'	3'	4'	5'	1'	2'	3'	4'	5'	5'	1'	2'	2'	3'	4'	5'	6'
0.060" Alum	0.018	2'	3'	5'	6'	1'	3'	4'	1'	2'	4'	1'	2'	3'	4'	5'	1'	2'	3'	4'	5'	5'	1'	2'	2'	3'	4'	5'	6'
All others	0.018	2'	3'	5'	6'	1'	3'	4'	1'	2'	4'	1'	2'	3'	4'	5'	1'	2'	3'	4'	5'	5'	1'	2'	2'	3'	4'	5'	6'
Dble Headers	0.024	4'	8'	12'	MAX	4'	8'	11'	3'	6'	10'	3'	6'	8'	11'	14'	2'	5'	7'	10'	12'	15'	2'	4'	6'	8'	11'	13'	15'
Single 3x8	0.024	2'	4'	6'	8'	2'	4'	6'	2'	3'	5'	1'	3'	4'	6'	7'	1'	2'	4'	5'	6'	7'	1'	2'	3'	4'	5'	6'	7'
0.060" Alum	0.024	2'	4'	6'	8'	2'	4'	6'	2'	3'	5'	1'	3'	4'	6'	7'	1'	2'	4'	5'	6'	7'	1'	2'	3'	4'	5'	6'	7'
All others	0.024	2'	4'	6'	8'	2'	4'	6'	2'	3'	5'	1'	3'	4'	6'	7'	1'	2'	4'	5'	6'	7'	1'	2'	3'	4'	5'	6'	7'
Dble Headers	0.032	6'	11'	17'	MAX	5'	10'	15'	4'	9'	13'	4'	7'	11'	15'	MAX	3'	6'	10'	13'	16'	MAX	3'	6'	8'	11'	14'	17'	MAX
Single 3x8	0.032	3'	6'	8'	11'	3'	5'	8'	2'	4'	6'	2'	4'	6'	7'	9'	2'	3'	5'	6'	8'	10'	1'	3'	4'	6'	7'	8'	10'
0.060" Alum	0.032	3'	6'	8'	11'	3'	5'	8'	2'	4'	6'	2'	4'	6'	7'	9'	2'	3'	5'	6'	8'	10'	1'	3'	4'	6'	7'	8'	10'
All others	0.032	3'	6'	8'	11'	3'	5'	8'	2'	4'	6'	2'	4'	6'	7'	9'	2'	3'	5'	6'	8'	10'	1'	3'	4'	6'	7'	8'	10'
Dble Headers	0.036	6'	11'	17'	MAX	5'	10'	15'	4'	9'	13'	4'	8'	11'	15'	MAX	3'	7'	10'	13'	16'	MAX	3'	6'	9'	11'	14'	17'	MAX
Single 3x8	0.036	3'	6'	9'	12'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	3'	5'	7'	9'	10'	2'	3'	5'	6'	8'	9'	11'
0.060" Alum	0.036	3'	6'	9'	12'	3'	6'	9'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	5'	7'	9'	11'	2'	3'	5'	6'	8'	10'	11'
All others	0.036	3'	6'	9'	12'	3'	6'	9'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	5'	7'	9'	11'	2'	3'	5'	6'	8'	10'	11'

Table 4.36b Maximum Tributary Width for Each Header/Panel and Number of #10 Screw Combination

Headers	Panel Thickness (in)	115 MPH EXP C or 130 MPH EXP B			120 MPH EXP C or 140 MPH EXP B			130 MPH EXP C or 150 MPH EXP B			140 MPH EXP C or 160 MPH EXP B					150 MPH EXP C or 170 MPH EXP B						160 MPH EXP C or 170 MPH EXP B					
		1	2	3	1	2	3	1	2	3	1	2	3	4	5	1	2	3	4	5	6	1	2	3	4	5	6
Number of #14 Sheet Metal Screws Required per foot at Header/Panel Connection																											
Dble Headers	0.018	6'	12'	MAX	5'	11'	MAX	5'	9'	MAX	4'	8'	12'	MAX	MAX	3'	7'	10'	MAX	MAX	MAX	3'	6'	9'	12'	MAX	MAX
Single 3x8	0.018	3'	6'	9'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	3'	5'	7'	9'	10'	2'	3'	5'	6'	8'	9'
0.060" Alum	0.018	3'	6'	9'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	3'	5'	7'	9'	10'	2'	3'	5'	6'	8'	9'
All others	0.018	3'	6'	9'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	3'	5'	7'	9'	10'	2'	3'	5'	6'	8'	9'
Dble Headers	0.024	7'	15'	MAX	7'	14'	MAX	6'	12'	MAX	5'	10'	15'	MAX	MAX	4'	9'	13'	MAX	MAX	MAX	4'	8'	11'	15'	MAX	MAX
Single 3x8	0.024	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'
0.060" Alum	0.024	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'
All others	0.024	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'
Dble Headers	0.032	7'	15'	MAX	7'	14'	MAX	6'	12'	17'	5'	10'	15'	MAX	MAX	4'	9'	13'	17'	MAX	MAX	4'	8'	11'	15'	MAX	MAX
Single 3x8	0.032	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'
0.060" Alum	0.032	5'	10'	16'	5'	10'	14'	4'	8'	12'	3'	7'	10'	14'	MAX	3'	6'	9'	12'	15'	MAX	3'	5'	8'	11'	13'	16'
All others	0.032	5'	10'	16'	5'	10'	14'	4'	8'	12'	3'	7'	10'	14'	MAX	3'	6'	9'	12'	15'	MAX	3'	5'	8'	11'	13'	16'
Dble Headers	0.036	7'	15'	MAX	7'	14'	MAX	6'	12'	17'	5'	10'	15'	MAX	MAX	4'	9'	13'	17'	MAX	MAX	4'	8'	11'	15'	MAX	MAX
Single 3x8	0.036	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'
0.060" Alum	0.036	5'	10'	16'	5'	10'	14'	4'	8'	12'	3'	7'	10'	14'	17'	3'	6'	9'	12'	15'	MAX	3'	5'	8'	11'	13'	16'
All others	0.036	6'	12'	18'	5'	11'	16'	5'	9'	14'	4'	8'	12'	16'	MAX	3'	7'	10'	14'	17'	MAX	3'	6'	9'	12'	15'	MAX

Table 4.37b Maximum Tributary Width for Each Header/Panel and Number of #14 Screw Combination

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
(434) 384-2514
carlputnam@comcast.net



MAY 03 2019

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.1a: Detailed table for structures attached to existing buildings. Columns include material (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), footing type (trib, Min Post, Uplift, Footing), and footing size (8', 10', 12'). Rows cover various materials and configurations.

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 17 psf Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.1b: Detailed table for freestanding structures. Columns include material (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), footing type (trib, Min Post, Uplift, Footing), and footing size (8', 10', 12'). Rows cover various materials and configurations.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585
Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

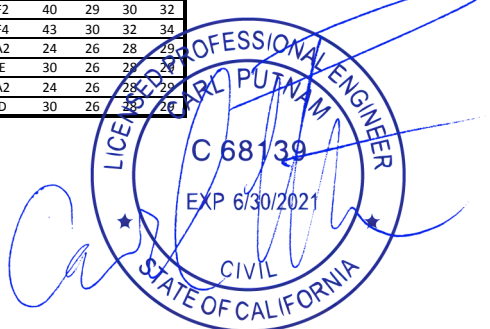

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150% Seismic Design Category D

Structures are Attached to Existing Building

Table 5.2a: Data for structures attached to existing buildings, including columns for footing types, dimensions, and maximum post lengths.

Table 5.2b: Data for freestanding structures, including columns for footing types, dimensions, and maximum post lengths.

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 100 MPH EXPOSURE B


Seismic Ss= 150% Seismic Design Category D

Freestanding Structures

Table 5.2b: Data for freestanding structures, including columns for footing types, dimensions, and maximum post lengths.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

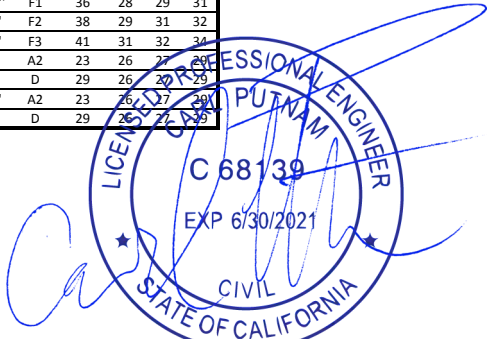

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 16 psf Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.3a: Grid showing post spacing, footing size, and uplift requirements for various materials under different load conditions. Columns include material details (e.g., On Slab, 0.042"x3"x8", Double 2"x6.625"), post type, min post, uplift, and footing dimensions for constrained footings. Materials listed include California Fascia, Classic Fascia, 16 G Steel C, 12 G Steel C, Double 16 G Steel C, Steel Cloverleaf, and 4x3 I Beam.

Table 5.3b: Continuation of Table 5.3a, providing a detailed grid of post spacing and footing requirements for the same materials and load conditions as Table 5.3a.


Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 18 psf Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.3c: Grid showing post spacing, footing size, and uplift requirements for various materials under different load conditions, specifically for Freestanding Structures. The format is similar to Tables 5.3a and 5.3b.

Table 5.3d: Continuation of Table 5.3c, providing a detailed grid of post spacing and footing requirements for the same materials and load conditions as Table 5.3c.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

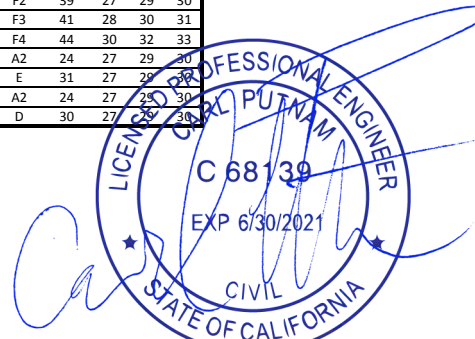

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 18 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.5a: Grid of post spacing and footing size data for attached buildings under various load conditions. Columns include member type, post type, uplift, and footing dimensions for different load levels.

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 20 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.5b: Grid of post spacing and footing size data for freestanding structures under various load conditions. Columns include member type, post type, uplift, and footing dimensions for different load levels.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 18 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.6a: Multi-column table providing post spacing, post type, and footing size data for structures attached to existing buildings under various load conditions.

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 21 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.6b: Multi-column table providing post spacing, post type, and footing size data for freestanding structures under various load conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net



MAY 03 2019

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 19 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.7a


Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																									
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)														
On Slab	On Slab	2'-8"	C			3'-5"	C			4'	C			4'-5"	C			5'	C			5'-5"	C			6'	C			6'-5"	C			7'	C			7'-5"	C			8'	C												
0.042"x3"x8"	N30	9'-10"	A1	24	19	21	22	8'-11"	A1	24	20	21	22	8'-4"	A1	25	21	22	23	7'-8"	A1	25	22	23	24	7'-2"	A1	25	22	23	25	6'-8"	A1	25	23	24	25	6'-4"	A1	26	23	25	26	5'-8"	A1	26	24	26	27	5'-2"	A1	26	25	26	28

Table 5.7b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																									
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)						
On Slab	On Slab	2'-8"	C			3'-5"	C			4'	C			4'-5"	C			5'	C			5'-5"	C			6'	C			6'-5"	C			7'	C			7'-5"	C			8'	C												
0.042"x3"x8"	N30	9'-10"	A1	22	27	29	30	9'-11"	A1	22	26	28	29	8'-7"	A1	23	25	27	28	7'-9"	A1	23	25	26	28	7'-3"	A1	23	25	26	28	6'-9"	A1	24	24	25	27	6'-5"	A2	24	24	25	26	5'-9"	A2	24	23	25	26	5'-3"	A2	24	24	25	26

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

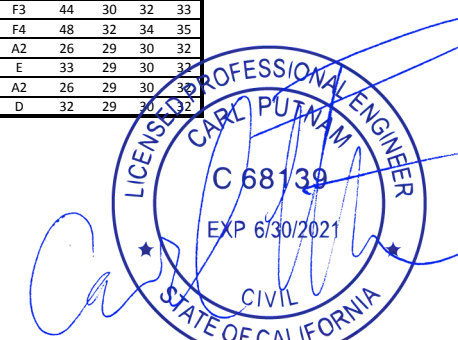

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 21 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.8a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)				
On Slab	On Slab	2'-8"	C			3'-5"	C			4'	C			4'-5"	C			5'	C			5'-5"	C			6'	C			6'-5"	C			7'	C			7'-5"	C			8'	C						
0.042"x3"x8"	N30	8'-11"	A1	24	20	21	22	8'-11"	A1	25	21	22	23	7'-5"	A1	25	22	23	24	6'-11"	A1	25	22	24	25	6'-5"	A1	26	23	24	26	6'-0"	A1	26	24	25	26	5'-8"	A1	26	24	26	27	5'-4"	A1	26	25	26	27


Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 25 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.8b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)
On Slab	On Slab	2'-8"	D			3'-5"	D			4'	D			4'-5"	D			5'	D			5'-5"	D			6'	D			6'-5"	D			7'	D			7'-5"	D			8'	D						
0.042"x3"x8"	N30	9'-4"	A1	23	28	29	31	8'-7"	A1	23	27	29	30	7'-9"	A1	23	26	28	29	7'-3"	A1	24	26	27	29	6'-9"	A1	24	25	26	28	6'-4"	A2	24	25	26	28	5'-11"	A2	25	25	26	27	5'-8"	A2	25	24	26	27

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

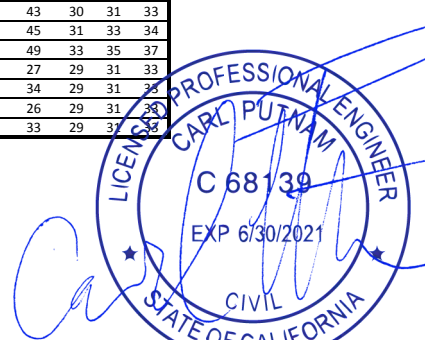

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 23 psf

Wind Speed: 140 MPH EXPOSURE C or 160 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.9a


Header		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"															
Detail	On Slab	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)
		2'-8"	Type	(in)	8' 10' 12'	3'-5"	Type	(in)	8' 10' 12'	4'	Type	(in)	8' 10' 12'	4'-5"	Type	(in)	8' 10' 12'	5'	Type	(in)	8' 10' 12'	5'-5"	Type	(in)	8' 10' 12'	6'	Type	(in)	8' 10' 12'	6'-5"	Type	(in)	8' 10' 12'	7'	Type	(in)	8' 10' 12'	7'-5"	Type	(in)	8' 10' 12'	8'	Type	(in)	8' 10' 12'				
On Slab	On Slab	2'-8"	C			3'-5"	C			4'	C			4'-5"	C			5'	C			5'-5"	C			6'	C			6'-5"	C			7'	C			7'-5"	C			8'	C						
0.042"x3"x8"	N30	8'-1"	A1	25	21 22 23	7'-4"	A1	25	22 23 24	6'-9"	A1	25	23 24 25	6'-3"	A1	26	23 25 26	5'-9"	A1	26	24 25 27	5'-5"	A1	26	25 26 27	5'-1"	A1	26	25 27 28	4'-9"	A1	27	26 27 28	4'-6"	A1	27	26 28 29	4'-3"	A1	27	27 28 29	4'-1"	A1	27	27 29 30				

Table 5.9b

Header		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
Detail	On Slab	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)
		2'-8"	Type	(in)	8' 10' 12'	3'-5"	Type	(in)	8' 10' 12'	4'	Type	(in)	8' 10' 12'	4'-5"	Type	(in)	8' 10' 12'	5'	Type	(in)	8' 10' 12'	5'-5"	Type	(in)	8' 10' 12'	6'	Type	(in)	8' 10' 12'	6'-5"	Type	(in)	8' 10' 12'	7'	Type	(in)	8' 10' 12'	7'-5"	Type	(in)	8' 10' 12'	8'	Type	(in)	8' 10' 12'								
On Slab	On Slab	2'-8"	D			3'-5"	D			4'	D			4'-5"	D			5'	D			5'-5"	D			6'	D			6'-5"	D			7'	D			7'-5"	D			8'	D										
0.042"x3"x8"	N30	8'-1"	A1	23	28 30 31	8'-0"	A1	24	28 29 31	7'-4"	A1	24	27 29 30	6'-9"	A1	24	26 28 29	6'-4"	A2	25	26 27 29	5'-11"	A2	25	27 28	5'-6"	A2	25	27 28	5'-3"	A2	25	25 26 27	5'-0"	A2	26	25 27 28	4'-9"	A2	26	26 27 28	4'-6"	A2	26	26 28 29								

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

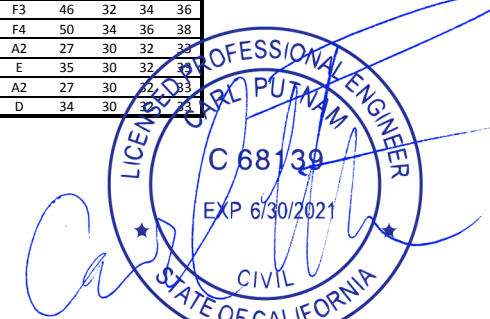

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 25 psf Wind Speed: 150 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Structures are Attached to Existing Building

Table 5.10a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"											
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)
On Slab	On Slab	2'-8"	D			3'-5"	D			4'	D			4'-5"	D			5'	D			5'-5"	D			6'	D			6'-5"	D			7'	D			7'-5"	D			8'	D		
0.042"x3"x8"	N30	7'-5"	A1	25	22 23 24	6'-8"	A1	25	23 24 25	6'-1"	A1	26	23 25 26	5'-8"	A1	26	24 26 27	5'-3"	A1	26	25 26 28	4'-10"	A1	27	25 27 28	4'-7"	A1	27	26 28 29	4'-3"	A1	27	27 28 29	4'-0"	A1	27	29 30	3'-10"	A1	27	28 29 31	3'-7"	A1	27	28 30 31


Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 31 psf Wind Speed: 150 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Freestanding Structures

Table 5.10b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"									
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post
On Slab	On Slab	2'-8"	D			3'-5"	D			4'	D			4'-5"	D			5'	D			5'-5"	D			6'	D			6'-5"	D			7'	D			7'-5"	D			8'	D				
0.042"x3"x8"	N30	8'-4"	A1	24	29 30 32	7'-6"	A1	24	28 30 31	6'-10"	A1	25	27 29 30	6'-4"	A2	25	27 28 30	5'-11"	A2	25	26 28 29	5'-6"	A2	26	26 27 28	4'-10"	A2	26	26 27 28	4'-7"	A2	26	26 27 28	4'-4"	A2	26	27 28 29	4'-2"	A2	26	27 28 29	4'-2"	A2	26	27 28 29		

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

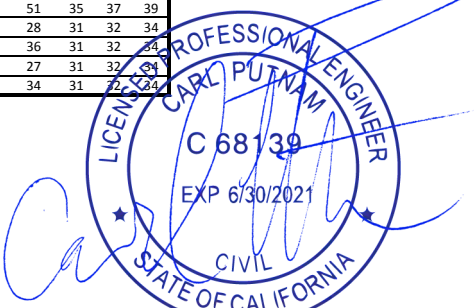

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 23 psf Wind Speed: 100 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.14a: Detailed table for structures attached to existing buildings. Columns include member type (On Slab, Double 3"x8", etc.), footing size (trib, Min Post, Uplift, Footing), and length (8', 12', 15'). Rows list various materials and configurations.

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 23 psf Wind Speed: 100 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.14b: Detailed table for freestanding structures. Columns include member type (On Slab, Double 3"x8", etc.), footing size (trib, Min Post, Uplift, Footing), and length (8', 12', 15'). Rows list various materials and configurations.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

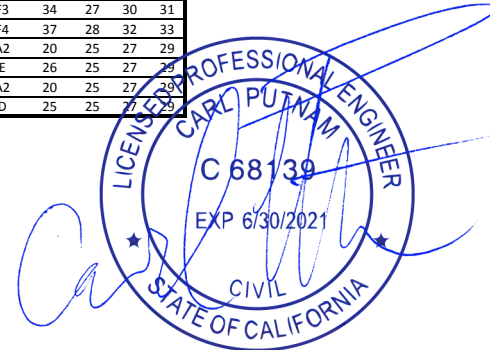

MAY 03 2019

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 23 psf Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.15a: Multi-column table with 20 columns for different footing types (trib, Min Post, Uplift, Footing) and 20 rows for various materials like On Slab, Double 3"x8", etc.

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.15b: Multi-column table similar to 5.15a but for freestanding structures, with 20 columns and 20 rows.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 23 psf Wind Speed: 105 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.16a		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																			
Header		trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)																								
Detail																																										3'	Type	8'	12'	15'	3.5'	Type	8'	12'	15'	4'	Type	8'	12'	15'	4.5'	Type	8'	12'	15'	5'	Type	8'	12'
On Slab	On Slab	11'-10"	A1			10'-2"	A1			8'-11"	A1			7'-11"	A1			6'-5"	A1			5'-11"	A1			4'-9"	A1			3'-11"	A1			2'-11"	A1			2'-8"	A1			2'-4"	A1			2'-4"	A1			2'-4"	A1			2'-4"	A1			2'-4"	A1			2'-4"	A1		
0.042"x3"x8"	N30	9'-10"	A1	19	17	18	20	17	19	20	18	20	21	7'-7"	A1	20	18	21	22	6'-8"	A1	21	19	22	23	6'-4"	A2	21	20	22	23	5'-11"	A2	21	20	23	24	5'-8"	A2	21	21	23	24	5'-4"	A2	21	21	23	25	5'-2"	A2	21	21	24	25	5'-2"	A2	21	21	24	25				
Double 3"x8"	N25	14'-8"	A2	22	18	19	21	13'-5"	A2	22	18	20	21	12'-5"	A2	23	18	21	22	10'-11"	C	24	19	22	23	9'-10"	C	24	20	22	23	8'-7"	C	24	20	23	24	8'-11"	C	25	21	23	24	8'-7"	C	25	21	23	25	8'-3"	C	25	21	24	25										
Double 2"x6.625"	N25	13'-1"	A2	21	17	19	20	12'-0"	A2	22	17	19	20	11'-2"	A2	22	18	20	21	10'-5"	A2	22	18	21	22	9'-10"	A2	23	19	21	22	8'-11"	B	23	20	22	23	8'-6"	C	24	21	23	24	7'-10"	C	24	21	23	25	7'-7"	C	24	21	24	25										

Table 5.16b		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
Header		trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post	Uplift Footing (in)	Constrained Footing (in)								
Detail																																																		8.5'	Type	8'	12'	15'	9'	Type	8'
On Slab	On Slab	4'-2"	A1			3'-11"	A1			3'-6"	A1			3'-4"	A1			3'-2"	A1			3'-1"	A1			2'-11"	A1			2'-8"	A1			2'-6"	A1			2'-6"	A1			2'-4"	A1			2'-4"	A1			2'-4"	A1			2'-4"	A1		
0.042"x3"x8"	N30	4'-10"	A2	21	22	24	26	4'-8"	A2	22	22	24	26	4'-4"	A2	26	23	25	27	4'-2"	A2	22	23	25	27	4'-0"	A2	22	24	26	28	3'-9"	A2	22	24	26	28	3'-6"	A2	22	24	27	28	3'-3"	A2	22	25	27	29	3'-1"	A2	22	25	28	30		
Double 3"x8"	N25	7'-11"	C	25	22	24	26	7'-8"	C	25	22	24	26	7'-4"	C	31	23	25	27	6'-11"	D	26	23	25	27	6'-8"	D	31	23	26	28	6'-4"	D	26	24	26	28	6'-0"	D	26	24	27	28	5'-8"	D	27	25	27	29	5'-4"	D	27	25	28	30		

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

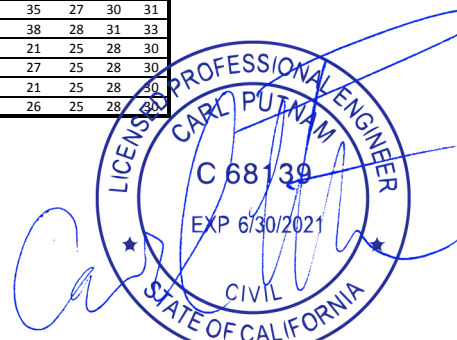

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 25 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.17a: Post spacing and footing size data for roof solidity 100%. Columns include member details (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), tributary area (trib), and footing dimensions (min, uplift, constrained) for various post types (A1-A2, B, C, D, E, F1, F2, F3, F4, F5) and footing types (A1-A2, B, C, D, E, F1, F2, F3, F4, F5).

Table 5.17b: Post spacing and footing size data for roof solidity 100%. Columns include member details (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), tributary area (trib), and footing dimensions (min, uplift, constrained) for various post types (A1-A2, B, C, D, E, F1, F2, F3, F4, F5) and footing types (A1-A2, B, C, D, E, F1, F2, F3, F4, F5).

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 28 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.17c: Post spacing and footing size data for freestanding structures. Columns include member details (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), tributary area (trib), and footing dimensions (min, uplift, constrained) for various post types (A1-A2, B, C, D, E, F1, F2, F3, F4, F5) and footing types (A1-A2, B, C, D, E, F1, F2, F3, F4, F5).

Table 5.17d: Post spacing and footing size data for freestanding structures. Columns include member details (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), tributary area (trib), and footing dimensions (min, uplift, constrained) for various post types (A1-A2, B, C, D, E, F1, F2, F3, F4, F5) and footing types (A1-A2, B, C, D, E, F1, F2, F3, F4, F5).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 100% Seismic Design Category D Structures are Attached to Existing Building

Table 5.18a: A large table with 18 columns for different footing types and 18 rows for various structural details like On Slab, Double 3"x8", etc. Each cell contains a grid of values for different post types and footing dimensions.

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 29 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 100% Seismic Design Category D Freestanding Structures

Table 5.18b: A large table similar to 5.18a but for freestanding structures, with 18 columns and 18 rows of structural details and footing specifications.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 27 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.19a: Detail table for Section 5.0 (Attached to Existing Building) with 27 columns and 25 rows of data including product types, post types, and footing dimensions.

Table 5.19a: Detail table for Section 5.0 (Attached to Existing Building) with 27 columns and 25 rows of data including product types, post types, and footing dimensions.

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 30 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.19b: Detail table for Section 5.0 (Freestanding Structures) with 27 columns and 25 rows of data including product types, post types, and footing dimensions.

Table 5.19b: Detail table for Section 5.0 (Freestanding Structures) with 27 columns and 25 rows of data including product types, post types, and footing dimensions.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 31 psf Wind Speed: 140 MPH EXPOSURE C or 160 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.21a: Grid of post spacing and footing size requirements for structures attached to existing buildings under various load conditions.

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 35 psf Wind Speed: 140 MPH EXPOSURE C or 160 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.21b: Grid of post spacing and footing size requirements for freestanding structures under various load conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

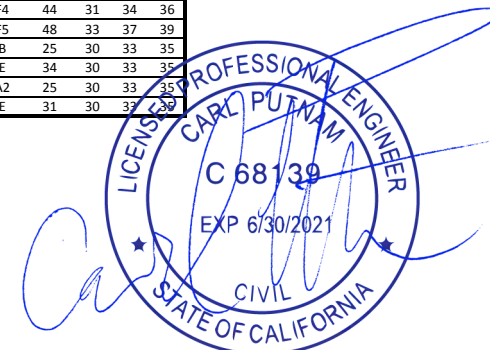

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 33 psf Wind Speed: 150 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Structures are Attached to Existing Building

Table 5.22a: Table with columns for material (On Slab, Double 3"x8", Double 2"x6.625", 5.5" Extruded Fascia, California Fascia, Classic Fascia, 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C, Steel Coverleaf, DBL Steel Coverleaf, 4x3 I Beam, 7x4 I Beam) and rows for various footing types (trib, Min Post, Uplift, Footing) across different dimensions (8', 12', 15').

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 38 psf Wind Speed: 150 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Freestanding Structures

Table 5.22b: Similar to Table 5.22a, but for Freestanding Structures. Columns and rows are the same, detailing footing requirements for various materials and dimensions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

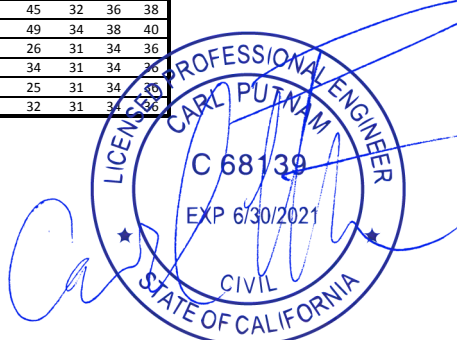

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 35 psf Wind Speed: 160 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Structures are Attached to Existing Building

Table 5.23a: Grid of footing dimensions and post types for attached structures. Columns include footing type (trib, Min Post, Uplift, Footing), size (3.5' to 7.5'), and material (On Slab, N30, N25, etc.).

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 41 psf Wind Speed: 160 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Freestanding Structures

Table 5.23b: Grid of footing dimensions and post types for freestanding structures. Columns include footing type (trib, Min Post, Uplift, Footing), size (3.5' to 7.5'), and material (On Slab, N30, N25, etc.).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

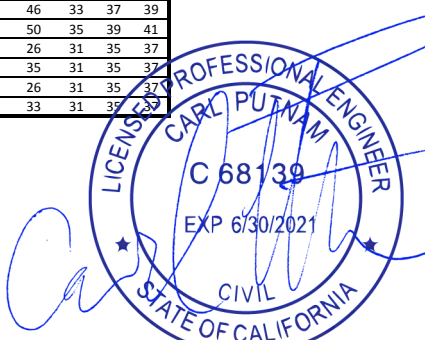

MAY 03 2019

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 38 psf Wind Speed: 170 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Structures are Attached to Existing Building

Table 5.24a: Table with columns for detail, footing type, and various footing dimensions (trib, min post, uplift, footing) for different roof types (On Slab, Double 3"x8", etc.) and post types (1.5", 2", 2.5", 3", 3.5", 4", 4.5", 5", 5.5", 6", 6.5").

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 44 psf Wind Speed: 170 MPH EXPOSURE C or 170 MPH EXPOSURE B Seismic Ss= 25% Seismic Design Category B Freestanding Structures

Table 5.24b: Table with columns for detail, footing type, and various footing dimensions (trib, min post, uplift, footing) for different roof types (On Slab, Double 3"x8", etc.) and post types (1.5", 2", 2.5", 3", 3.5", 4", 4.5", 5", 5.5", 6", 6.5").

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

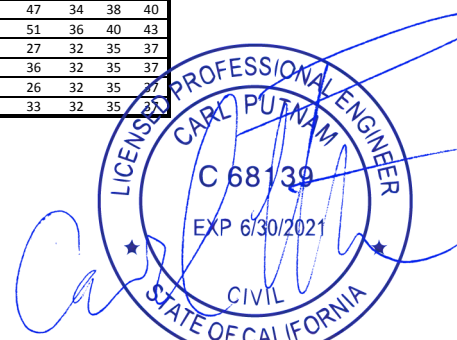

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 24 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.25a: Design table for attached structures with columns for footing type, min post, uplift, and footing dimensions across various load and seismic categories.

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 24 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.25b: Design table for freestanding structures with columns for footing type, min post, uplift, and footing dimensions across various load and seismic categories.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

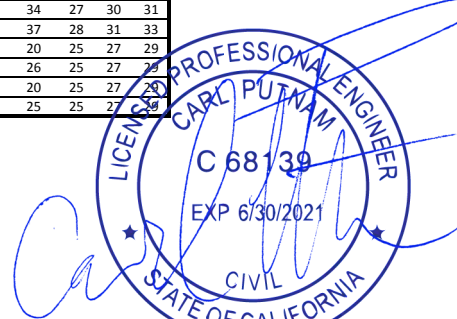

MAY 03 2019

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: **25 psf** Live Load: **20 psf** Roof Design Load **24 psf** Wind Speed: **100 MPH EXPOSURE C** or **115 MPH EXPOSURE B** Seismic Ss= **150%** Seismic Design Category **D** Structures are Attached to Existing Building

Table 5.26a		cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		
Header	Detail	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing (in)	Constrained Footing (in) Max Post Length																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																										
On Slab	On Slab	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1	3'-4" A1																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			
0.042"x3"x8"	N30	9'-6" A1	21	18	20	21	8'-8" A1	21	18	20	22	8'-0" A1	21	19	21	22	7'-5" A1	22	20	22	23	6'-11" A1	22	20	22	24	6'-6" A1	22	21	23	24	5'-9" A1	22	21	23	25	5'-6" A1	22	22	24	26	5'-3" A1	22	22	25	26	5'-0" A1	22	23	25	27	4'-6" A1	22	23	25	27	4'-3" A1	22	24	26	28	3'-9" A1	22	25	27	29	3'-6" A1	22	26	28	30	3'-3" A1	22	27	29	31	3'-0" A1	22	28	30	32	2'-9" A1	22	30	32	34	2'-6" A1	22	31	33	35	2'-3" A1	22	32	34	36	2'-0" A1	22	33	35	37	1'-9" A1	22	35	37	39	1'-6" A1	22	36	38	40	1'-3" A1	22	37	39	41	1'-0" A1	22	38	40	42	9" A1	22	39	41	43	6" A1	22	40	42	44	3" A1	22	41	43	45	1" A1	22	42	44	46	9" A1	22	43	45	47	6" A1	22	44	46	48	3" A1	22	45	47	49	1" A1	22	46	48	50	9" A1	22	47	49	51	6" A1	22	48	50	52	3" A1	22	49	51	53	1" A1	22	50	52	54	9" A1	22	51	53	55	6" A1	22	52	54	56	3" A1	22	53	55	57	1" A1	22	54	56	58	9" A1	22	55	57	59	6" A1	22	56	58	60	3" A1	22	57	59	61	1" A1	22	58	60	62	9" A1	22	59	61	63	6" A1	22	60	62	64	3" A1	22	61	63	65	1" A1	22	62	64	66	9" A1	22	63	65	67	6" A1	22	64	66	68	3" A1	22	65	67	69	1" A1	22	66	68	70	9" A1	22	67	69	71	6" A1	22	68	70	72	3" A1	22	69	71	73	1" A1	22	70	72	74	9" A1	22	71	73	75	6" A1	22	72	74	76	3" A1	22	73	75	77	1" A1	22	74	76	78	9" A1	22	75	77	79	6" A1	22	76	78	80	3" A1	22	77	79	81	1" A1	22	78	80	82	9" A1	22	79	81	83	6" A1	22	80	82	84	3" A1	22	81	83	85	1" A1	22	82	84	86	9" A1	22	83	85	87	6" A1	22	84	86	88	3" A1	22	85	87	89	1" A1	22	86	88	90	9" A1	22	87	89	91	6" A1	22	88	90	92	3" A1	22	89	91	93	1" A1	22	90	92	94	9" A1	22	91	93	95	6" A1	22	92	94	96	3" A1	22	93	95	97	1" A1	22	94	96	98	9" A1	22	95	97	99	6" A1	22	96	98	100	3" A1	22	97	99	101	1" A1	22	98	100	102	9" A1	22	99	101	103	6" A1	22	100	102	104	3" A1	22	101	103	105	1" A1	22	102	104	106	9" A1	22	103	105	107	6" A1	22	104	106	108	3" A1	22	105	107	109	1" A1	22	106	108	110	9" A1	22	107	109	111	6" A1	22	108	110	112	3" A1	22	109	111	113	1" A1	22	110	112	114	9" A1	22	111	113	115	6" A1	22	112	114	116	3" A1	22	113	115	117	1" A1	22	114	116	118	9" A1	22	115	117	119	6" A1	22	116	118	120	3" A1	22	117	119	121	1" A1	22	118	120	122	9" A1	22	119	121	123	6" A1	22	120	122	124	3" A1	22	121	123	125	1" A1	22	122	124	126	9" A1	22	123	125	127	6" A1	22	124	126	128	3" A1	22	125	127	129	1" A1	22	126	128	130	9" A1	22	127	129	131	6" A1	22	128	130	132	3" A1	22	129	131	133	1" A1	22	130	132	134	9" A1	22	131	133	135	6" A1	22	132	134	136	3" A1	22	133	135	137	1" A1	22	134	136	138	9" A1	22	135	137	139	6" A1	22	136	138	140	3" A1	22	137	139	141	1" A1	22	138	140	142	9" A1	22	139	141	143	6" A1	22	140	142	144	3" A1	22	141	143	145	1" A1	22	142	144	146	9" A1	22	143	145	147	6" A1	22	144	146	148	3" A1	22	145	147	149	1" A1	22	146	148	150	9" A1	22	147	149	151	6" A1	22	148	150	152	3" A1	22	149	151	153	1" A1	22	150	152	154	9" A1	22	151	153	155	6" A1	22	152	154	156	3" A1	22	153	155	157	1" A1	22	154	156	158	9" A1	22	155	157	159	6" A1	22	156	158	160	3" A1	22	157	159	161	1" A1	22	158	160	162	9" A1	22	159	161	163	6" A1	22	160	162	164	3" A1	22	161	163	165	1" A1	22	162	164	166	9" A1	22	163	165	167	6" A1	22	164	166	168	3" A1	22	165	167	169	1" A1	22	166	168	170	9" A1	22	167	169	171	6" A1	22	168	170	172	3" A1	22	169	171	173	1" A1	22	170	172	174	9" A1	22	171	173	175	6" A1	22	172	174	176	3" A1	22	173	175	177	1" A1	22	174	176	178	9" A1	22	175	177	179	6" A1	22	176	178	180	3" A1	22	177	179	181	1" A1	22	178	180	182	9" A1	22	179	181	183	6" A1	22	180	182	184	3" A1	22	181	183	185	1" A1	22	182	184	186	9" A1	22	183	185	187	6" A1	22	184	186	188	3" A1	22	185	187	189	1" A1	22	186	188	190	9" A1	22	187	189	191	6" A1	22	188	190	192	3" A1	22	189	191	193	1" A1	22	190	192	194	9" A1	22	191	193	195	6" A1	22	192	194	196	3" A1	22	193	195	197	1" A1	22	194	196	198	9" A1	22	195	197	199	6" A1	22	196	198	200	3" A1	22	197	199	201	1" A1	22	198	200	202	9" A1	22	199	201	203	6" A1	22	200	202	204	3" A1	22	201	203	205	1" A1	22	202	204	206	9" A1	22	203	205	207	6" A1	22	204	206	208	3" A1	22	205	207	209	1" A1	22	206	208	210	9" A1	22	207	209	211	6" A1	22	208	210	212	3" A1	22	209	211	213	1" A1	22	210	212	214	9" A1	22	211	213	215	6" A1	22	212	214	216	3" A1	22	213	215	217	1" A1	22	214	216	218	9" A1	22	215	217	219	6" A1	22	216	218	220	3" A1	22	217	219	221	1" A1	22	218	220	222	9" A1	22	219	221	223	6" A1	22	220	222	224	3" A1	22	221	223	225	1" A1	22	222	224	226	9" A1	22	223	225	227	6" A1	22	224	226	228	3" A1	22	225	227	229	1" A1	22	226	228	230	9" A1	22	227	229	231	6" A1	22	228	230	232	3" A1	22	229	231	233	1" A1	22	230	232	234	9" A1	22	231	233	235	6" A1	22	232	234	236	3" A1	22	233	235	237	1" A1	22	234	236	238	9" A1	22	235	237	239	6" A1	22	236	238	240	3" A1	22	237	239	241	1" A1	22	238	240	242	9" A1	22	239	241	243	6" A1	22	240	242	244	3" A1	22	241	243	245	1" A1	22	242	244	246	9" A1	22	243	245	247	6" A1	22	244	246	248	3" A1	22	245	247	249	1" A1	22	246	248	250	9" A1	22	247	249	251	6" A1	22	248	250	252	3" A1	22	249	251	253	1" A1	22	250	252	254	9" A1	22	251	253	255	6" A1	22	252	254	256	3" A1	22	253	255	257	1" A1	22	254	256	258	9" A1	22	255	257	259	6" A1	22	256	258	260	3" A1	22	257	259	261	1" A1	22	258	260	262	9" A1	22

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 24 psf Wind Speed: 105 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building


Table 5.27a: A large table with columns for 'trib' (tributary area), 'Min Post' (minimum post length), 'Uplift Footing' (uplift footing length), and 'Constrained Footing (in)' (constrained footing length). It lists various materials like On Slab, Double 3"x8", Double 2"x6.625", 5.5" Extruded Fascia, California Fascia, Classic Fascia, 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C, Steel Cloverleaf, DBL Steel Cloverleaf, 4x3 I Beam, and 7x4 I Beam. The table is organized into two main sections, each with a header row and a detail row, and multiple rows of material specifications.

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 24 psf Wind Speed: 105 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.27b: A large table with columns for 'trib', 'Min Post', 'Uplift Footing', and 'Constrained Footing (in)'. It lists various materials like On Slab, Double 3"x8", Double 2"x6.625", 5.5" Extruded Fascia, California Fascia, Classic Fascia, 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C, Steel Cloverleaf, DBL Steel Cloverleaf, 4x3 I Beam, and 7x4 I Beam. The table is organized into two main sections, each with a header row and a detail row, and multiple rows of material specifications.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

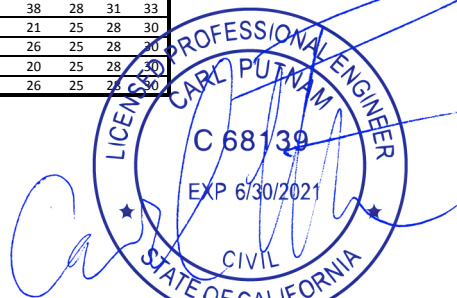

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 26 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.28a: Grid of post spacing and footing size data for attached structures. Columns include product details (On Slab, Double 3"x8", etc.), roof design load (26 psf), wind speed (110 MPH), seismic (Ss=150%), and design category (D). Rows list various post types and footing dimensions.

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 29 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.28b: Grid of post spacing and footing size data for freestanding structures. Columns include product details, roof design load (29 psf), wind speed (110 MPH), seismic (Ss=150%), and design category (D). Rows list various post types and footing dimensions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

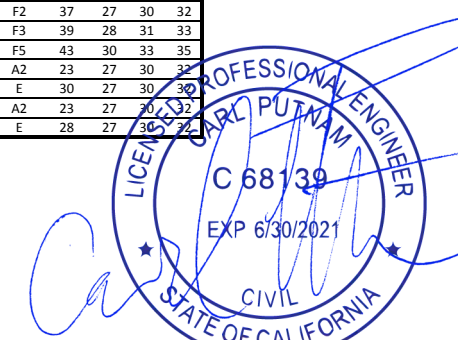

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 27 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.29a	cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"																													
	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)																			
Header Detail	3'-4" A2	3'-4" A2	3'-4" A2	3'-4" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2																		
On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab																		
0.042"x3"x8"	N30	9'-1" A1	22	19	21	22	8'-2" A1	23	20	22	23	7'-6" A1	23	20	23	24	7'-0" A1	23	21	23	25	6'-6" A1	24	22	24	25	6'-1" A2	24	22	25	26	5'-9" A2	24	23	25	27	5'-5" A2	24	23	26	27	5'-1" A2	24	24	26	28	4'-10" A2	25	24	27	28
Double 3"x8"	N25	13'-8" A2	26	19	21	22	12'-5" A2	26	20	22	23	11'-6" B	27	20	23	24	10'-10" C	27	21	23	25	10'-6" C	27	22	25	26	9'-11" C	28	23	25	27	8'-7" C	28	23	26	27	8'-2" C	28	23	26	27	7'-11" C	29	24	27	28	7'-7" C	29	24	27	29
Double 2"x6.625"	N25	12'-2" A2	25	19	21	22	11'-2" A2	25	20	22	23	10'-4" A2	26	20	23	24	9'-9" A2	26	21	23	25	9'-2" B	26	22	24	25	8'-8" C	27	23	25	27	7'-10" C	27	23	26	27	7'-6" C	28	24	26	28	7'-3" C	28	24	27	28	6'-11" C	28	24	27	29
5.5" Extruded Fascia	L	10'-2" A1	23	19	21	22	9'-2" A1	24	20	22	23	8'-4" A2	24	20	23	24	7'-9" A2	24	21	23	25	7'-3" A2	24	22	24	25	6'-9" A2	25	22	25	26	6'-4" A2	25	23	25	27	6'-0" A2	25	23	26	27	5'-8" A2	25	24	26	28	5'-5" A2	25	24	27	28
California Fascia	N10, G	10'-2" A1	23	19	21	22	9'-1" A1	23	20	22	23	8'-3" A1	24	20	23	24	7'-8" A2	24	21	23	25	7'-1" A2	24	22	24	25	6'-7" A2	25	22	25	26	6'-3" A2	25	23	25	27	5'-10" A2	25	23	26	27	5'-6" A2	25	24	26	28	5'-3" A2	25	24	27	28
Classic Fascia	H	14'-1" A2	26	19	21	22	13'-5" B	27	20	22	23	12'-9" C	27	20	23	24	12'-4" C	28	21	23	25	11'-11" C	29	22	24	25	11'-7" D	30	22	25	26	11'-2" D	30	23	25	27	10'-11" D	31	23	26	27	10'-8" D	31	24	26	28	10'-5" D	32	24	27	28
16 G Steel C	N9, T	16'-0" C	27	19	21	22	14'-3" C	27	20	22	23	12'-11" C	28	20	23	24	11'-11" C	28	21	23	25	10'-8" C	28	22	24	25	9'-11" C	28	22	25	26	8'-11" C	28	23	25	27	8'-3" C	28	24	26	27	7'-2" C	28	24	27	28	6'-8" C	28	24	27	29
14 G Steel C	N9, T	19'-1" C	29	19	21	22	17'-2" C	29	20	22	23	15'-7" C	29	20	23	24	14'-5" C	30	21	23	25	13'-4" D	30	22	24	25	12'-5" D	30	22	25	26	11'-9" D	31	23	25	27	11'-0" D	31	23	26	27	10'-3" D	31	24	26	28	9'-8" D	31	24	27	28
12 G Steel C	N9, T	12'-9" F1	32	20	23	24	11'-1" F1	32	21	23	25	10'-3" F1	32	21	23	25	9'-6" F1	33	21	23	25	9'-0" F1	33	22	24	25	8'-4" F1	34	22	25	26	7'-8" F1	34	23	25	27	7'-2" F1	35	23	26	27	6'-6" F1	35	24	26	28	6'-0" F1	36	24	27	28
Double 16 G Steel C	N9, N25, T	27'-1" D	32	21	23	24	25'-10" E	33	21	23	25	24'-7" E	34	22	24	25	23'-8" E	35	22	24	26	22'-11" E	36	22	25	26	21'-8" F1	36	23	25	27	20'-9" F1	37	23	25	27	19'-10" F1	37	23	26	27	19'-0" F1	38	24	26	28	18'-4" F1	38	24	27	28
Double 14 G Steel C	N9, N25, T	28'-11" E	33	21	23	24	27'-7" E	34	21	24	25	26'-2" E	35	22	24	26	25'-3" E	36	22	25	27	24'-5" F1	37	23	25	27	23'-9" F1	38	23	26	27	22'-11" F1	38	23	26	28	22'-5" F1	39	24	26	28	21'-8" F1	39	24	27	28	20'-11" F1	40	24	27	28
Double 12 G Steel C	N9, N25, T	32'-11" E	34	22	24	25	31'-4" E	35	22	25	26	29'-9" F1	36	23	25	27	28'-9" F1	37	23	26	27	27'-9" F1	38	24	26	28	26'-11" F1	39	24	27	28	25'-5" F2	41	25	27	29	24'-10" F2	41	25	28	29	23'-9" F2	42	25	28	30	22'-8" F2	43	25	28	30
Steel Coverleaf	W	8'-10" A1	22	19	21	22	8'-0" A1	22	20	22	23	7'-3" A1	23	20	23	24	6'-10" A1	23	21	23	25	6'-4" A1	23	22	24	25	5'-11" A1	24	22	25	26	5'-7" A2	24	23	25	27	5'-4" A2	24	23	26	27	5'-0" A2	24	24	26	28	4'-10" A2	24	24	27	28
DBL Steel Coverleaf	AA	12'-9" A2	25	19	21	22	12'-1" A2	26	20	22	23	11'-6" B	27	20	23	24	11'-1" C	27	21	23	25	10'-9" C	28	22	24	25	10'-5" C	29	22	25	26	10'-1" C	29	23	25	27	9'-8" D	29	23	26	27	9'-4" D	30	24	26	28	8'-7" D	30	24	27	29
4x3 I Beam	Y	11'-1" A2	24	19	21	22	9'-10" A2	24	20	22	23	8'-10" A2	24	20	23	24	8'-1" A2	25	21	23	25	7'-5" A2	25	22	24	25	6'-10" A2	25	22	25	26	6'-5" A2	25	23	25	27	5'-11" A2	25	23	26	27	5'-7" A2	25	24	26	28	5'-3" A2	25	24	27	28
7x4 I Beam	Q	17'-10" C	28	19	21	22	17'-2" C	29	20	22	23	16'-1" D	30	20	23	24	14'-11" D	30	21	23	25	13'-9" D	30	22	24	25	12'-9" D	31	22	25	26	12'-5" D	31	23	25	27	11'-2" D	31	23	26	27	10'-6" D	31	24	26	28	10'-0" D	31	24	27	28

Ground Snow Load: 25 psf Live Load: 20 psf Roof Design Load 30 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.29b	cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"			cubic footing "d"																													
	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)	trib	Min Post Type	Uplift Footing (in)	Constrained Footing (in)																			
Header Detail	3'-4" A2	3'-4" A2	3'-4" A2	3'-4" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2	4'-0" A2																		
On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab	On Slab																	
0.042"x3"x8"	N30	8'-5" A1	20	25	28	30	7'-8" A1	21	25	27	29	7'-0" A1	21	24	26	28	6'-6" A1	21	24	26	28	6'-0" A2	21	23	26	27	5'-8" A2	22	23	25	27	5'-3" A2	22	22	25	26	4'-9" A2	22	23	25	27	4'-5" A2	22	23	26	27	4'-3" A2	22	24	26	28
Double 3"x8"	N25	12'-9" A2	23	28	31	33	11'-9" B	24	27	30	32	10'-10" C	24	27	30	32	10'-1" C	25	26	29	30	9'-5" C	25	26	28	30	8'-11" C	25	26	28	30	8'-5" C	25	25	28	29	7'-8" C	26	25	28	29	7'-4" C	26	24	27	29	7'-0" C	26	24	26	28
Double 2"x6.625"	N25	11'-5" A2	22	26	29	30	10'-7" A2	23	25	28	30	9'-9" A2	23	25	28	29	9'-2" B	24	25	27	29	8'-7" C	24	24	26	28	8'-2" C	24	24	26	28	7'-8" C	25	24	26	28	7'-4" C	25	23	26	27	6'-9" C	25	23	26	27	6'-6" C	26	24	26	28
5.5" Extruded Fascia	L	9'-5" A1	21	24	26	28	8'-7" A2	21	23	26	27	7'-9" A2	22	22	24	26	7'-3" A2	22	22	24	26	6'-8" A2	22	22	24	25	6'-3" A2	22	21	24	25	5'-10" A2	22	22	24	26	5'-6" A2	23	22	25	27	5'-3" A2	23	23	26	27	4'-11" A2	23	23	26	27
California Fascia	N10, G	9'-5" A1	21	23	25	27	8'-6" A2	21	22	24	26	7'-8" A2	21	22	24	26	7'-2" A2	22	21																																

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 28 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.30a		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
Header	Detail	trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)								
					Type	8'	12'				15'	Type	8'				12'	15'	Type				8'	12'	15'				Type	8'	12'				15'	Type	8'				12'	15'	Type	8'	12'	15'	Type	8'	12'
On Slab	On Slab	11'-4"	A2				9'-8"	A2				8'-6"	A2				7'-6"	A2				6'-9"	A2				5'-8"	A2				4'-10"	A2				4'-3"	A2											
0.042"x3"x8"	N30	8'-10"	A1	23	19	22	23	8'-0"	A1	23	20	22	24	7'-4"	A1	24	21	23	25	6'-10"	A1	24	22	24	25	6'-4"	A2	24	23	25	27	5'-11"	A2	25	23	26	27	5'-3"	A2	25	24	26	28	4'-9"	A2	25	25	27	29
Double 3"x8"	N25	13'-3"	A1	24	26	29	30	12'-2"	A2	26	29	30	11'-3"	B	27	21	23	25	10'-7"	C	28	22	24	25	9'-11"	C	28	23	25	27	8'-5"	C	29	24	26	28	7'-8"	C	29	25	27	29	7'-4"	C	30	25	28	29	
Double 2"x6.625"	N25	11'-10"	A2	25	19	22	23	10'-11"	A2	26	20	22	24	10'-1"	A2	26	21	23	25	9'-7"	A2	27	22	24	25	9'-0"	B	27	22	25	26	8'-6"	C	27	23	25	27	8'-1"	C	28	24	26	28	7'-4"	C	28	24	27	28
5.5" Extruded Fascia	L	9'-11"	A1	24	19	22	23	8'-11"	A1	24	20	22	24	8'-2"	A2	24	21	23	25	7'-7"	A2	25	22	24	25	7'-1"	A2	25	22	25	26	6'-7"	A2	25	23	25	27	5'-10"	A2	26	24	26	28	5'-6"	A2	26	25	27	29
California Fascia	N10, G	9'-10"	A1	24	19	22	23	8'-10"	A1	24	20	22	24	8'-1"	A2	24	21	23	25	7'-6"	A2	25	22	24	25	7'-0"	A2	25	22	25	26	6'-6"	A2	25	23	25	27	6'-5"	A2	25	24	26	28	5'-5"	A2	26	24	27	29
Classic Fascia	H	14'-1"	A2	27	19	22	23	13'-5"	C	27	20	22	24	12'-9"	C	28	21	23	25	12'-4"	C	29	22	24	25	11'-11"	C	30	22	25	26	11'-7"	D	30	23	25	27	10'-11"	D	32	24	26	28	10'-8"	D	32	25	27	29
16 G Steel C	N9, T	15'-6"	C	27	19	22	23	13'-10"	C	28	20	22	24	12'-7"	C	28	21	23	25	11'-7"	C	28	22	24	25	10'-5"	C	28	23	25	26	9'-5"	C	28	23	25	27	8'-7"	C	28	24	26	28	7'-4"	C	28	25	27	29
16 G Steel C	N9, T	18'-6"	C	29	19	22	23	16'-8"	C	30	20	22	24	15'-2"	D	30	21	23	25	14'-1"	D	30	22	24	25	13'-1"	D	31	22	25	26	12'-2"	D	31	23	25	27	11'-5"	D	31	24	26	28	10'-0"	D	31	24	27	29
12 G Steel C	N9, T	26'-1"	D	33	20	23	24	23'-9"	E	33	21	23	24	21'-10"	E	34	21	23	25	20'-6"	E	34	22	24	25	19'-2"	E	35	22	25	26	18'-0"	E	35	23	25	27	17'-0"	E	36	24	26	28	15'-4"	E	36	24	27	29
Double 16 G Steel C	N9, N25, T	27'-1"	E	33	21	23	24	25'-10"	E	34	21	23	25	24'-7"	E	35	22	24	25	23'-8"	E	36	22	24	26	22'-6"	F1	37	22	25	26	21'-4"	F1	37	23	25	27	20'-4"	F1	38	23	26	27	19'-5"	F1	38	24	26	28
Double 14 G Steel C	N9, N25, T	28'-11"	E	34	21	23	24	27'-7"	E	35	21	24	25	26'-2"	E	36	22	24	26	25'-3"	F1	37	22	25	27	24'-5"	F1	38	23	25	27	23'-9"	F1	39	23	26	28	22'-3"	F1	40	24	26	28						
Double 12 G Steel C	N9, N25, T	32'-11"	E	35	22	24	25	31'-4"	E	36	22	25	26	29'-9"	F1	37	23	25	27	28'-9"	F1	39	23	26	27	27'-9"	F1	39	24	26	28	26'-11"	F2	41	24	27	28	25'-5"	F2	42	25	27	29	24'-10"	F2	43	25	28	30
Steel Cloverleaf	W	8'-7"	A1	23	19	22	23	7'-9"	A1	23	20	22	24	7'-1"	A1	23	21	23	25	6'-8"	A1	24	22	24	25	6'-2"	A1	24	22	25	26	5'-10"	A2	24	23	25	27	5'-2"	A2	25	24	26	28	4'-11"	A2	25	24	27	29
DBL Steel Cloverleaf	AA	12'-9"	A2	26	19	22	23	12'-1"	A2	27	20	22	24	11'-6"	C	27	21	23	25	11'-1"	C	28	22	24	25	10'-9"	C	29	22	25	26	10'-4"	C	29	23	25	27	9'-11"	C	30	23	26	27	9'-6"	D	30	24	26	28
4x3 I Beam	Y	10'-8"	A2	24	19	22	23	9'-6"	A2	25	20	22	24	8'-7"	A2	25	21	23	25	7'-11"	A2	25	22	24	25	7'-3"	A2	25	22	25	26	6'-8"	A2	25	23	25	27	6'-2"	A2	25	24	26	28	5'-5"	A2	26	25	27	29
7x4 I Beam	Q	17'-5"	C	28	19	22	23	16'-9"	C	30	20	22	24	15'-8"	D	30	21	23	25	14'-7"	D	31	22	24	25	13'-5"	D	31	22	25	26	12'-6"	D	31	23	25	27	11'-8"	D	31	23	26	27	10'-11"	D	32	24	26	28

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 31 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 5.30b		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
Header	Detail	trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)			trib	Min Post	Uplift	Constrained Footing (in)														
					Type	8'	12'				15'	Type	8'				12'	15'	Type				8'	12'	15'				Type	8'	12'				15'	Type	8'	12'	15'	Type	8'	12'	15'	Type	8'	12'	15'	Type	8'
On Slab	On Slab	11'-4"	A2				9'-8"	A2				8'-6"	A2				7'-6"	A2				6'-9"	A2				5'-8"	A2				4'-10"	A2				4'-3"	A2											
0.042"x3"x8"	N30	8'-2"	A1	21	26	28	30	7'-6"	A1	21	25	28	29	6'-10"	A1	21	24	27	28	6'-4"	A2	22	24	27	28	5'-10"	A2	22	23	26	27	5'-6"	A2	22	23	26	27	4'-10"	A2	22	23	26	27	4'-4"	A2	23	24	26	28
Double 3"x8"	N25	12'-5"	A2	24	28	32	33	11'-6"	B	24	28	31	33	10'-7"	C	25	27	30	31	9'-10"	C	25	27	30	31	8'-9"	C	26	26	29	31	8'-9"	C	26	26	29	30	7'-10"	D	27	25	27	29	6'-10"	D	27	24	27	28
Double 2"x6.625"	N25	11'-2"	A2	23	26	29	31	10'-4"	A2	23	26	29	30	9'-7"	A2	24	25	28	30	8'-11"	B	24	25	28	31	8'-5"	C	25	25	27	29	8'-0"	C	25	24	27	28	7'-7"	C	25	24	26	28	6'-11"	C	26	23	26	27
5.5" Extruded Fascia	L	9'-2"	A1	21	24	27	28	8'-4"	A2	22	23	26	27	7'-7"	A2	22	23	25	27	7'-0"	A2	22	22	24	26	6'-6"	A2	22	22	24	26	6'-1"	A2	23	22	24	26	5'-4"	A2	23	23	25	27	4'-10"	A2	23	24	26	28
California Fascia	N10, G	9'-1"	A1	21	23	25	27	8'-3"	A2	22	22	25	26	7'-6"	A2	22	22	24	26	6'-11"	A2	22	21	24	25	6'-4"	A2	22	22	24	26	6'-0"	A2	23	22	24	26	5'-3"	A2	23	23	26	27	4'-8"	A2	23	24	26	28
Classic Fascia	H	14'-1"	C	25	27	30	32	13'-5"	C	25	27	30	31	12'-9"	C	26	26	29	31	12'-4"	C	27	26	29	31	11'-11"	D	28	26	29	30	11'-7"	D	28	26	29	30	10'-11"	D	29	25	28	30	10'-8"	E	30	25	28	29
16 G Steel C	N9, T	14'-3"	C	25	29	33	35	12'-11"	C	25	29	32	34	11'-7"	C	25	26	29	31	10'-3"	C	25	26	29	31	8'-5"	C	25	26	29	30	7'-8"	C	25	25	27	29	6'-2"	C	25	24	26	28	5'-9"	E	30	25	27	29
14 G Steel C	N9, T	17'-2"	C	26	31	34	36	15'-7"	D	27	30	33	35	14'-1"	D	27	29	32	34	12'-11"	D	27	29	32	34	11'-11"	D																						

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 29 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.31a: Multi-column table detailing post spacing and footing sizes for various roof types and materials under the specified conditions. Columns include material types (e.g., On Slab, Double 3"x8", Steel C) and post/footing dimensions for different cubic footing configurations (trib, min post, uplift, footing).

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 33 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.31b: Multi-column table detailing post spacing and footing sizes for various roof types and materials under the specified conditions, specifically for freestanding structures. Columns include material types and post/footing dimensions for different cubic footing configurations.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

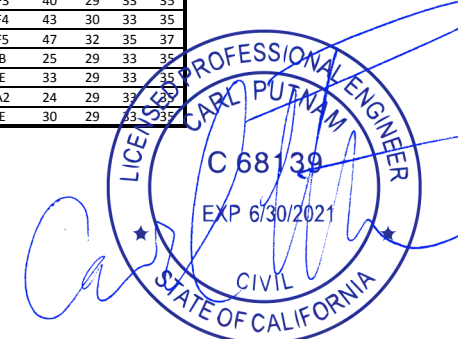

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 27 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.32a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				
		trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	
On Slab	On Slab	9'-6" A1				8'-2" A1				7'-1" A1				6'-4" A1				5'-8" A1				5'-2" A1				4'-9" A1				4'-1" A1
0.042"x3"x8"	N30	8'-11" A1	18	16	18 19	8'-1" A1	18	17	19 20	7'-5" A1	19	17	19 21	6'-11" A1	19	18	20 21	6'-5" A1	19	19	21 22	6'-0" A2	19	19	21 22	5'-8" A2	19	20	22 23	5'-1" A2
Double 3"x8"	N25	13'-5" A2	18	17	19 20	12'-4" A2	18	17	19 20	11'-4" B	21	18	20 21	10'-8" C	22	18	20 21	10'-0" C	22	19	21 22	9'-5" C	22	19	21 22	8'-11" C	23	19	22 23	7'-9" C
Double 2"x6.625"	N25	12'-0" A2	20	17	18 20	11'-0" A2	20	17	19 20	10'-3" A2	21	17	19 21	9'-8" A2	21	18	20 21	9'-1" B	21	19	21 22	8'-7" C	22	19	21 22	8'-2" C	22	19	22 23	7'-5" C
5.5" Extruded Fascia	L	10'-0" A1	19	16	18 19	9'-1" A1	19	17	19 20	8'-3" A2	19	17	19 21	7'-8" A2	20	18	20 21	7'-2" A2	20	19	21 22	6'-8" A2	20	19	21 22	6'-3" A2	20	19	22 23	5'-11" A2
California Fascia	N10, G	10'-0" A1	19	16	18 19	9'-0" A1	19	17	19 20	8'-2" A2	19	17	19 21	7'-7" A2	18	20	21	7'-1" A2	20	19	21 22	6'-7" A2	20	19	21 22	6'-2" A2	20	19	22 23	5'-2" A2
Classic Fascia	H	13'-4" A2	20	17	19 20	12'-7" A2	21	18	19 21	12'-1" C	22	18	20 21	11'-7" C	22	18	20 21	11'-2" C	23	19	21 22	10'-10" C	23	19	21 22	10'-7" D	24	19	22 23	10'-3" D
16 G Steel C	N9, T	15'-9" C	22	18	20 21	14'-1" C	22	18	20 21	12'-9" C	22	18	20 21	11'-9" C	22	18	20 21	10'-6" C	22	19	21 22	9'-7" C	22	19	21 22	8'-9" C	22	19	22 23	8'-0" C
14 G Steel C	N9, T	18'-10" C	23	19	21 22	16'-11" C	23	19	21 22	15'-4" D	24	19	21 22	14'-3" D	24	19	21 22	13'-2" D	24	19	21 22	12'-4" D	24	20	22 23	11'-6" D	25	20	22 23	10'-10" D
12 G Steel C	N9, T	24'-8" D	25	20	22 24	23'-3" D	26	21	23 24	22'-1" E	27	21	23 25	20'-8" E	27	21	24 25	19'-4" E	27	22	24 25	18'-2" E	28	22	24 25	17'-1" E	28	22	24 26	16'-3" E
Double 16 G Steel C	N9, N25, T	25'-7" D	25	20	22 24	24'-2" E	26	21	23 24	23'-3" E	27	21	23 25	22'-4" E	28	22	24 25	21'-6" E	28	22	24 26	20'-11" F1	29	22	25 26	20'-4" F1	30	23	25 27	19'-7" F1
Double 14 G Steel C	N9, N25, T	27'-4" E	26	21	23 24	25'-10" E	27	21	23 25	24'-9" E	28	22	24 25	23'-10" E	28	22	24 26	22'-3" F1	29	22	25 26	22'-3" F1	30	23	25 27	21'-8" F1	31	23	26 28	20'-7" F1
Double 12 G Steel C	N9, N25, T	31'-1" E	27	21	24 25	29'-4" E	28	22	24 26	28'-2" E	29	22	25 26	27'-1" F1	30	23	25 27	26'-11" F1	31	24	26 28	24'-8" F1	32	24	26 28	24'-0" F1	33	25	27 29	22'-10" F2
Steel Cloverleaf	W	8'-8" A1	18	16	18 19	7'-10" A1	18	17	19 20	7'-2" A1	18	17	19 21	6'-9" A1	19	18	20 21	6'-3" A1	19	19	21 22	5'-10" A2	19	19	21 22	5'-6" A2	19	20	22 23	5'-0" A2
DBL Steel Cloverleaf	AA	12'-0" A2	20	17	18 20	11'-4" A2	20	17	19 20	10'-11" A2	21	17	19 21	10'-6" A2	22	18	20 21	10'-1" C	22	19	21 22	9'-9" C	23	19	21 22	9'-6" C	23	19	22 23	9'-3" C
4x3 I Beam	Y	10'-11" A2	19	16	18 19	9'-8" A2	19	17	19 20	8'-8" A2	20	17	19 21	8'-0" A2	20	18	20 21	7'-4" A2	20	19	21 22	6'-9" A2	20	19	21 22	6'-3" A2	20	19	22 23	5'-10" A2
7x4 I Beam	Q	17'-7" C	22	18	20 22	16'-7" C	23	19	21 22	15'-11" D	24	19	21 23	14'-9" D	24	19	21 23	13'-7" D	24	20	22 23	12'-7" D	25	20	22 23	11'-9" D	25	20	22 23	11'-0" D

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 27 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D


Freestanding Structures

Table 5.32b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"					
		trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post
On Slab	On Slab	9'-6" A1				8'-2" A1				7'-1" A1				6'-4" A1				5'-8" A1				5'-2" A1				4'-9" A1				4'-1" A1	
0.042"x3"x8"	N30	8'-11" A1	17	23	25 27	8'-1" A1	17	22	25 26	7'-5" A1	17	22	24 25	6'-11" A1	18	21	24 25	6'-5" A1	18	21	23 25	6'-0" A2	18	21	23 24	5'-8" A2	18	20	22 24	5'-4" A2	
Double 3"x8"	N25	13'-5" A2	19	25	28 30	12'-4" A2	20	25	27 29	11'-4" B	20	24	27 28	10'-8" C	20	24	26 28	10'-0" C	21	23	26 27	9'-5" C	21	23	26 27	8'-11" C	21	23	25 26	7'-9" C	
Double 2"x6.625"	N25	12'-0" A2	18	23	26 27	11'-0" A2	19	23	25 27	10'-3" A2	19	22	25 26	9'-8" A2	20	22	24 26	9'-1" B	20	22	24 25	8'-7" C	20	21	24 25	8'-2" C	20	21	23 25	7'-5" C	
5.5" Extruded Fascia	L	10'-0" A1	17	21	24 25	9'-1" A1	18	21	23 24	8'-3" A2	18	20	22 24	7'-8" A2	18	20	22 23	7'-2" A2	18	19	21 22	6'-8" A2	19	19	21 22	6'-3" A2	19	20	22 23	5'-11" A2	
California Fascia	N10, G	10'-0" A1	17	20	23 24	9'-0" A1	18	20	22 23	8'-2" A2	18	19	21 23	7'-7" A2	18	19	21 22	7'-1" A2	18	19	21 22	6'-7" A2	18	19	21 22	6'-2" A2	19	20	22 23	5'-2" A2	
Classic Fascia	H	13'-4" A2	19	21	24 25	12'-7" A2	20	23	25 27	12'-1" C	20	23	25 26	11'-7" C	21	22	24 26	11'-2" C	21	22	24 26	10'-10" C	22	22	24 26	10'-7" D	23	22	24 26	10'-3" D	
16 G Steel C	N9, T	15'-9" C	20	26	29 31	14'-1" C	20	25	28 30	12'-9" C	21	25	28 29	11'-9" C	21	24	27 29	10'-6" C	21	24	26 28	9'-7" C	21	23	25 26	8'-9" C	21	22	24 26	8'-0" C	
14 G Steel C	N9, T	18'-10" C	21	27	30 32	16'-11" C	22	27	30 31	15'-4" D	22	26	29 31	14'-3" D	22	26	28 30	13'-2" D	23	25	28 29	12'-4" D	23	25	27 29	11'-6" D	23	24	26 28	10'-10" D	
12 G Steel C	N9, T	24'-8" D	23	29	33 34	23'-3" D	24	29	32 34	22'-1" E	25	29	32 34	20'-8" E	25	28	31 33	19'-4" E	26	28	31 32	18'-2" E	26	27	30 31	17'-1" E	26	27	30 31	16'-3" E	
Double 16 G Steel C	N9, N25, T	25'-7" D	24	30	33 35	24'-2" E	25	29	32 34	23'-3" E	26	29	32 34	22'-4" E	27	28	31 33	21'-6" E	27	28	31 33	20'-11" F1	27	28	31 33	20'-4" F1	28	28	31 33	19'-7" F1	
Double 14 G Steel C	N9, N25, T	27'-4" E	24	30	33 35	25'-10" E	25	30	33 35	24'-9" E	26	29	32 34	23'-10" E	26	29	32 34	22'-3" F1	28	29	32 34	22'-3" F1	28	29	32 34	21'-8" F1	29	28	31 33	20'-7" F1	
Double 12 G Steel C	N9, N25, T	31'-1" E	25	31	35 37	29'-4" E	26	31	34 36	28'-2" E	27	30	33 35	27'-1" F1	28	30	33 35	26'-11" F1	29	30	33 35	25'-4" F1	29	30	33 35	24'-8" F1	29	29	32 34	24'-0" F1	
Steel Cloverleaf	W	8'-8" A1	17	18	19 21	7'-10" A1	17	17	19 20	7'-2" A1	17	17	19 21	6'-9" A1	18	17	19 21	6'-3" A1	18	19	21 22	5'-10" A2	18	19	21 22	5'-6" A2	18	20	22 23	5'-0" A2	
DBL Steel Cloverleaf	AA	12'-0" A2	18	19	21 22	11'-4" A2	19	19	21 22	10'-11" A2	20	19	21 22	10'-6" A2	20	18	20 21	10'-1" C	21	19	21 22	9'-9" C	21	19	21 22	9'-6" C	21	19	22 23	9'-3" C	
4x3 I Beam	Y	10'-11" A2	18	20	22 23	9'-8" A2	18	19	22 23	8'-8" A2	18	19	21 22	8'-0" A2	18	18	21 22	7'-4" A2	19	19	21 22	6'-9" A2	19	19	21 22	6'-3" A2	19	19	22 23	5'-10" A2	
7x4 I Beam	Q	17'-7" C	21	26	29 31	16'-7" C	22	26	28 30	15'-11" D	22	25	28 30	14'-9" D	23	24	27 29	13'-7" D	23	24	27 29	12'-7" D	23	24	27 29	11'-9" D	23	24	26 28	11'-0" D	

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

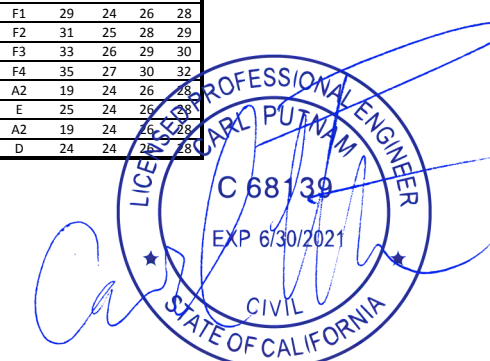

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 27 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.33a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																															
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)																
		3'-6"	A1			3'-6"	A1			4'	A1			4'-6"	A1			5'-2"	A1			5'-8"	A1			6'-4"	A1			7'-0"	A1			7'-6"	A1			8'-2"	A1			8'-8"	A1			9'-4"	A1			10'-0"	A1										
On Slab	On Slab	9'-6"	A1			8'-2"	A1			7'-1"	A1			6'-4"	A1			5'-8"	A1			5'-2"	A1			4'-9"	A1			4'-4"	A1			3'-9"	A1			3'-6"	A1			3'-6"	A1			3'-6"	A1			3'-6"	A1										
0.042"x3"x8"	N30	8'-10"	A1	20	18	20	21	8'-1"	A1	21	18	20	22	7'-5"	A1	21	19	21	22	6'-10"	A1	21	20	22	23	6'-4"	A1	21	20	22	24	5'-11"	A2	22	21	23	24	5'-7"	A2	22	21	23	25	5'-3"	A2	22	22	24	26	4'-9"	A2	22	22	25	26	4'-6"	A2	22	23	25	27
Double 3"x8"	N25	13'-3"	A2	23	18	20	21	13'-1"	A2	24	18	20	22	11'-4"	B	24	19	21	22	10'-7"	C	24	20	22	23	9'-11"	C	25	21	23	24	8'-11"	C	25	21	23	25	7'-9"	C	26	22	24	25	7'-5"	C	26	22	25	26	6'-11"	C	26	23	25	27						
Double 2"x6.625"	N25	11'-10"	A2	22	18	20	21	11'-0"	A2	23	18	20	22	10'-3"	A2	23	19	21	22	9'-7"	A2	24	20	22	23	9'-0"	B	24	20	22	24	8'-6"	C	24	21	23	24	8'-1"	C	25	21	23	25	7'-8"	C	25	22	24	25	7'-5"	C	25	22	24	26	6'-10"	C	26	23	25	27
5.5" Extruded Fascia	L	9'-11"	A1	21	18	20	21	9'-1"	A1	21	18	20	22	8'-3"	A2	22	19	21	22	7'-7"	A2	22	20	22	23	7'-1"	A2	22	20	22	24	6'-7"	A2	22	21	23	24	6'-2"	A2	22	21	23	25	5'-10"	A2	23	22	24	26	5'-3"	A2	23	22	25	26	5'-0"	A2	23	23	25	27
California Fascia	N10, G	9'-10"	A1	21	18	20	21	9'-0"	A1	21	18	20	22	8'-2"	A2	22	19	21	22	7'-6"	A2	22	20	22	23	7'-0"	A2	22	20	22	24	6'-6"	A2	22	21	23	24	6'-1"	A2	22	21	23	25	5'-9"	A2	23	22	24	26	5'-2"	A2	23	22	25	26	4'-11"	A2	23	23	25	27
Classic Fascia	H	13'-4"	A2	23	18	20	21	12'-7"	B	24	18	20	22	12'-1"	C	24	19	21	22	11'-7"	C	25	20	22	23	11'-2"	C	26	21	23	24	10'-10"	C	26	21	23	25	10'-7"	D	27	21	23	25	10'-3"	D	28	22	24	26	9'-9"	D	28	22	25	26	9'-7"	D	29	23	25	27
16 G Steel C	N9, T	15'-6"	C	24	18	20	21	14'-1"	C	25	18	20	22	12'-9"	C	25	19	21	22	11'-7"	C	25	20	22	23	10'-5"	C	25	20	22	24	9'-5"	C	25	21	23	24	8'-7"	C	25	21	23	25	7'-11"	C	25	22	24	26	7'-5"	C	25	22	25	26	6'-6"	C	25	23	25	27
14 G Steel C	N9, T	18'-6"	C	26	19	21	22	16'-11"	C	26	19	21	22	15'-4"	D	27	19	21	22	14'-1"	D	27	20	22	23	13'-1"	D	27	20	22	24	12'-2"	D	27	21	23	24	11'-5"	D	28	21	23	25	10'-9"	D	28	22	24	26	10'-1"	D	28	22	25	26	8'-9"	D	28	23	25	27
12 G Steel C	N9, T	24'-8"	D	28	20	22	24	23'-3"	E	29	21	23	24	22'-1"	E	30	21	23	25	20'-6"	E	31	21	23	25	19'-2"	E	31	21	23	25	17'-0"	E	31	22	24	26	15'-0"	E	32	22	24	26	14'-9"	E	32	22	24	26	14'-1"	F1	32	23	25	27						
Double 16 G Steel C	N9, N25, T	25'-7"	D	29	20	22	24	24'-2"	E	30	21	23	24	23'-3"	E	30	21	23	24	22'-4"	E	31	22	24	25	21'-6"	E	32	22	24	26	20'-11"	F1	33	22	25	26	18'-9"	F1	34	23	25	27	16'-5"	F1	34	23	25	27	14'-9"	F1	34	23	26	27	12'-4"	F1	35	24	26	28
Double 14 G Steel C	N9, N25, T	27'-4"	E	29	21	23	24	25'-10"	E	30	21	23	25	24'-9"	E	31	22	24	25	23'-10"	E	32	22	24	26	22'-11"	F1	33	23	25	27	22'-3"	F1	33	23	25	27	21'-8"	F1	34	23	26	28	20'-7"	F1	35	24	26	28	19'-5"	F2	36	24	27	29						
Double 12 G Steel C	N9, N25, T	31'-1"	E	30	21	23	25	29'-4"	E	31	22	24	26	28'-2"	F1	32	22	25	26	27'-1"	F1	33	23	25	27	26'-11"	F1	34	23	26	28	25'-4"	F1	35	24	26	28	24'-8"	F1	36	24	26	28	24'-0"	F1	36	24	27	28	23'-4"	F2	37	25	27	29	22'-5"	F2	38	25	28	29
Steel Cloverleaf	W	8'-7"	A1	20	18	20	21	7'-10"	A1	20	18	20	22	7'-2"	A1	21	19	21	22	6'-8"	A1	21	20	22	23	6'-2"	A1	21	20	22	24	5'-10"	A2	21	21	23	24	5'-2"	A2	22	22	24	25	4'-11"	A2	22	22	24	26	4'-8"	A2	22	22	25	26	4'-6"	A2	22	23	25	27
DBL Steel Cloverleaf	AA	12'-0"	A2	22	18	20	21	11'-4"	A2	23	18	20	22	10'-11"	A2	24	19	21	22	10'-6"	C	24	20	22	23	10'-1"	C	25	20	22	24	9'-0"	C	25	21	23	24	8'-5"	C	26	21	23	25	8'-3"	C	26	22	24	26	8'-10"	D	27	22	24	26	7'-9"	D	28	23	25	27
4x3 I Beam	Y	10'-8"	A2	21	18	20	21	9'-8"	A2	22	18	20	22	8'-8"	A2	22	19	21	22	7'-11"	A2	22	20	22	23	7'-3"	A2	22	20	22	24	6'-8"	A2	22	21	23	24	6'-2"	A2	22	21	23	25	5'-9"	A2	23	22	24	26	5'-6"	A2	23	22	25	26	4'-10"	A2	23	23	25	27
7x4 I Beam	Q	17'-7"	C	25	18	20	22	16'-7"	C	26	19	21	22	15'-11"	D	27	19	21	22	14'-7"	D	27	20	22	23	13'-5"	D	27	20	22	24	12'-6"	D	28	21	23	24	11'-8"	D	28	21	23	25	10'-11"	D	28	22	24	26	9'-9"	D	28	23	25	27						

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 30 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 5.33b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																															
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)								
		3'-6"	A1			3'-6"	A1			4'	A1			4'-6"	A1			5'-2"	A1			5'-8"	A1			6'-4"	A1			7'-0"	A1			7'-6"	A1			8'-2"	A1			8'-8"	A1			9'-4"	A1			10'-0"	A1										
On Slab	On Slab	9'-6"	A1			8'-2"	A1			7'-1"	A1			6'-4"	A1			5'-8"	A1			5'-2"	A1			4'-9"	A1			4'-4"	A1			3'-9"	A1			3'-6"	A1			3'-6"	A1			3'-6"	A1			3'-6"	A1										
0.042"x3"x8"	N30	8'-5"	A1	18	24	26	28	7'-8"	A1	19	23	25	27	7'-0"	A1	19	22	24	26	6'-6"	A1	19	22	24	26	6'-0"	A2	19	22	24	26	5'-8"	A2	20	21	23	24	5'-0"	A2	20	21	23	24	4'-9"	A2	20	21	24	25	4'-5"	A2	20	22	24	26	4'-3"	A2	20	22	24	26
Double 3"x8"	N25	12'-9"	A2	21	26	29	31	11'-9"	B	21	26	28	30	10'-10"	C	22	25	28	29	10'-1"	C	22	24	27	28	9'-5"	C	22	24	27	28	8'-11"	C	23	24	26	28	8'-1"	C	23	24	26	28	7'-4"	C	23	23	25	27	7'-0"	C	24	23	25	27						
Double 2"x6.625"	N25	11'-5"	A2	20	2																																																								

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 27 psf

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.34a: 30 psf Ground Snow Load, 20 psf Live Load, 27 psf Roof Design Load, 105 MPH Wind Speed, Seismic Ss= 150%, Seismic Design Category D, Attached to Existing Building.

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																			
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)																												
On Slab	On Slab	9'-6" A1				8'-2" A1				7'-1" A1				6'-4" A1				5'-8" A1				5'-2" A1				4'-9" A1				4'-1" A1				3'-6" A1																											
0.042"x3"x8"	N30	8'-11" A1	19	17	18	20	8'-11" A1	19	17	19	20	7'-5" A1	19	18	20	21	6'-11" A1	19	18	21	22	6'-0" A2	20	19	22	23	5'-8" A2	20	20	22	23	5'-4" A2	20	21	23	24	4'-9" A2	20	21	23	25	4'-7" A2	21	21	24	25															
Double 3"x8"	N25	13'-5" A1	21	17	19	20	12'-0" A2	21	17	19	20	11'-4" B	22	18	20	21	10'-8" C	23	18	21	22	10'-0" C	23	19	21	22	8'-11" C	23	20	22	23	8'-6" C	24	21	23	24	7'-9" C	24	21	23	25	7'-6" C	24	21	24	25															
Double 2"x6.625"	N25	12'-0" A2	20	17	18	20	11'-0" A2	21	17	19	20	10'-3" A2	21	18	20	21	9'-8" A2	22	18	21	22	9'-1" B	22	19	21	22	8'-7" C	23	20	22	23	7'-9" C	23	21	23	24	7'-5" C	23	21	23	25	6'-10" C	24	21	24	25															
5.5" Extruded Fascia	L	10'-0" A1	19	17	18	20	9'-1" A1	20	17	19	20	8'-3" A2	20	18	20	21	7'-8" A2	20	18	21	22	7'-2" A2	20	19	21	22	6'-8" A2	21	19	22	23	6'-3" A2	21	20	22	23	5'-11" A2	21	21	23	24	5'-7" A2	21	21	23	25	5'-1" A2	21	21	24	25										
California Fascia	N10, G	10'-0" A1	19	17	18	20	9'-0" A1	20	17	19	20	8'-2" A2	20	18	20	21	7'-7" A2	20	18	21	22	7'-1" A2	20	19	21	22	6'-7" A2	20	19	22	23	6'-2" A2	21	20	22	23	5'-9" A2	21	21	23	24	5'-6" A2	21	21	23	25	4'-11" A2	21	21	24	25										
Classic Fascia	H	13'-4" A2	21	17	19	20	12'-7" A2	22	18	19	21	12'-1" C	23	18	20	21	11'-7" C	23	18	21	22	11'-2" C	24	19	21	22	10'-10" C	24	19	22	23	10'-7" D	25	20	22	23	10'-3" D	25	20	23	24	10'-0" D	26	21	23	24	9'-7" D	26	21	24	25										
16 G Steel C	N9, T	15'-9" C	22	18	20	21	14'-1" C	23	18	20	21	12'-9" C	23	18	20	21	11'-9" C	23	18	21	22	10'-6" C	23	19	21	22	9'-7" C	23	19	22	23	8'-9" C	23	20	23	24	8'-0" C	23	21	23	25	7'-0" C	23	21	23	25	6'-7" C	23	21	24	25										
14 G Steel C	N9, T	18'-10" C	24	19	21	22	16'-11" C	24	19	21	22	15'-4" D	24	19	21	22	14'-3" D	25	19	21	22	13'-2" D	25	19	22	23	12'-4" D	25	20	22	23	11'-6" D	25	20	22	23	10'-10" D	26	20	23	24	9'-6" D	26	21	23	25	8'-10" D	26	21	24	25										
12 G Steel C	N9, T	24'-8" D	26	20	22	24	23'-3" D	27	21	23	24	22'-1" E	28	21	23	25	20'-8" E	28	21	24	25	19'-4" E	29	22	24	25	18'-2" E	29	22	24	26	16'-3" E	29	22	24	26	15'-7" E	30	22	25	26	14'-2" E	30	22	25	26	14'-2" F1	30	22	25	26	14'-2" F1	30	22	25	26					
Double 16 G Steel C	N9, N25, T	25'-7" D	26	20	22	24	24'-2" E	27	21	23	24	23'-3" E	28	21	23	25	22'-4" E	29	22	24	25	21'-6" E	29	22	24	26	20'-11" F1	30	22	25	26	20'-4" F1	31	23	25	27	19'-7" F1	31	23	26	27	18'-10" F1	31	23	26	27	17'-5" F1	32	24	26	28	17'-5" F1	32	24	26	28					
Double 14 G Steel C	N9, N25, T	27'-4" E	27	21	23	24	25'-10" E	28	21	23	25	24'-9" E	29	22	24	26	23'-10" E	29	22	24	26	22'-3" F1	31	23	25	27	21'-8" F1	31	23	26	28	21'-1" F1	32	24	26	28	20'-7" F1	32	24	26	28	20'-1" F1	33	24	27	28	19'-8" F1	33	24	27	29	19'-8" F1	33	24	27	29					
Double 12 G Steel C	N9, N25, T	31'-1" E	28	21	24	25	29'-4" E	29	22	24	26	28'-2" E	30	22	24	27	27'-1" F1	31	23	25	27	26'-11" F1	31	23	26	27	25'-4" F1	32	24	26	28	24'-8" F1	33	24	26	28	24'-0" F1	33	24	26	28	23'-4" F2	34	25	27	29	22'-10" F2	34	25	28	29	22'-5" F2	35	25	28	29	22'-5" F2	35	25	28	29
Steel Coverleaf	W	8'-8" A1	18	17	18	20	7'-10" A1	19	17	19	20	7'-2" A1	19	18	20	21	6'-9" A1	19	18	21	22	6'-3" A1	20	19	21	22	5'-10" A2	20	19	22	23	5'-6" A2	20	20	22	23	5'-0" A2	20	21	23	24	4'-9" A2	20	21	23	25	4'-6" A2	21	21	24	25	4'-6" A2	21	21	24	25					
DBL Steel Coverleaf	AA	12'-0" A2	18	17	18	20	11'-4" A2	19	17	19	20	10'-11" A2	22	18	20	21	10'-6" A2	22	18	21	22	10'-1" C	23	19	21	22	9'-9" C	23	19	22	23	9'-6" C	24	20	22	23	9'-3" C	24	20	23	24	9'-0" D	25	21	23	25	8'-8" D	25	21	24	25	8'-8" D	25	21	24	25					
4x3 I Beam	Y	10'-11" A2	20	17	18	20	9'-8" A2	20	17	19	20	8'-8" A2	20	18	20	21	8'-0" A2	20	18	21	22	7'-4" A2	21	19	21	22	6'-9" A2	21	19	22	23	6'-3" A2	21	20	22	23	5'-10" A2	21	21	23	24	5'-2" A2	21	21	23	25	4'-11" A2	21	21	24	25	4'-11" A2	21	21	24	25					
7x4 I Beam	Q	17'-7" C	23	18	20	22	16'-7" C	24	19	21	22	15'-11" D	25	19	21	23	14'-9" D	25	19	21	23	13'-7" D	25	20	22	23	12'-7" D	25	20	22	23	11'-9" D	26	20	22	23	11'-0" D	26	20	23	24	10'-5" D	26	21	23	25	9'-4" D	26	21	24	25	9'-4" D	26	21	24	25					

Table 5.34b: 30 psf Ground Snow Load, 20 psf Live Load, 28 psf Roof Design Load, 105 MPH Wind Speed, Seismic Ss= 150%, Seismic Design Category D, Freestanding Structures.

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																													
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)																										
On Slab	On Slab	9'-6" A1				8'-2" A1				7'-1" A1				6'-4" A1				5'-8" A1				5'-2" A1				4'-9" A1				4'-4" A1				4'-1" A1				3'-6" A1				3'-6" A1				3'-6" A1				3'-6" A1																					
0.042"x3"x8"	N30	8'-10" A1	17	23	26	27	8'-0" A1	17	23	25	27	7'-4" A1	18	22	25	26	6'-9" A1	18	22	24	25	6'-4" A1	18	21	24	25	5'-11" A2	18	21	23	25	5'-3" A2	19	20	23	24	5'-0" A2	19	21	23	24	4'-9" A2	19	21	23	25	4'-6" A2	19	21	24	25	4'-6" A2	19	21	24	25															
Double 3"x8"	N25	13'-3" A2	19	26	29	30	12'-2" A2	20	25	28	30	11'-3" B	20	25	27	29	10'-6" C	21	24	26	28	9'-10" C	21	24	26	28	8'-11" C	22	23	26	27	8'-5" C	22	23	25	27	7'-8" C	22	23	25	26	7'-4" C	22	23	25	26	7'-4" C	22	23	25	26	7'-4" C	22	23	25	26	7'-4" C	22	23	25	26										
Double 2"x6.625"	N25	11'-10" A2	19	24	26	28	10'-11" A2	19	23	26	27	10'-1" A2	20	23	25	27	9'-6" A2	20	23	25	26	8'-11" B	20	22	25	26	8'-6" C	21	22	24	26	7'-8" C	21	22	24	25	7'-4" C	21	21	24	25	7'-1" C	21	21	23	25	6'-9" C	22	21	24	25	6'-9" C	22	21	24	25															
5.5" Extruded Fascia	L	9'-10" A1	18	22	24	25	8'-11" A1	18	21	23	24	8'-2" A2	18	21	23	24	7'-6" A2	18	20	22	24	7'-0" A2	19	20	22	23	6'-7" A2	19	20	22	23	6'-2" A2	19	20	23	24	5'-10" A2	19	20	23	24	5'-6" A2	19	21	23	25	5'-0" A2	19	21	23	25	5'-0" A2	19	21	23	25															
California Fascia	N10, G	9'-10" A1	18	21	23	24	8'-10" A1	18	20	22	23	8'-1" A2	18	20	22	23	7'-5" A2	18	19	21	23	7'-0" A2	19	19	21	22	6'-6" A2	19	19	22	23	6'-1" A2	19	20	22	23	5'-9" A2	19	20	23	24	5'-5" A2	19	21	23	25	4'-10" A2	19	21	23	25	4'-10" A2	19	21	24	25															
Classic Fascia	H	13'-4" A2	20	24	26	28	12'-7" B	20	23	26	27	12'-1" C	21	23	25	27	11'-7" C	21	23	25	27	11'-2" C	22	23	25	27	10'-10" C	22	23	25	27	10'-7" D	23	22	25	26	10'-3" D	24	22	24	26	9'-9" D	24	22	24	26	9'-7" D	24	22	24	26	9'-7" D	24	22	24	26	9'-7" D	24	22	24	26										
16 G Steel C	N9, T	15'-6" C	21	27	30	31	13'-10" C	21	26	29	31	12'-7" C	21	25	28	30	11'-4" C	21	25	27	29	10'-9" C	21	24	27	28	9'-5" C	21	23	26	27	8'-7" C	21	22	25	26	8'-2" C	21	22	25	26	7'-11" C	21	22	25	26	6'-10" C	21	22	24	26	6'-5" C	21	22	24	26	6'-5" C	21	22	24	26	6'-5" C	21	22	24	26	6'-5" C	21	22	24	26
14 G Steel C	N9, T	18'-6" C	22	28	31	33	16'-8" C	22	27	30	32	15'-2" D	22	27	30	31	13'-11" D	23	26	29	31	12'-11" D	23	26	28	30	12'-2" D	23	25	28	30																																								

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 29 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building


Table 5.35a: Table with 24 columns for different footing and post sizes (3'-6" to 7'-6"). Each column contains a grid of post types and footing sizes (trib, min, uplift, max post length) for various materials like On Slab, Double 3"x8", etc.

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 32 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.35b: Table with 24 columns for different footing and post sizes (3'-6" to 7'-6"). Each column contains a grid of post types and footing sizes (trib, min, uplift, max post length) for various materials like On Slab, Double 3"x8", etc.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

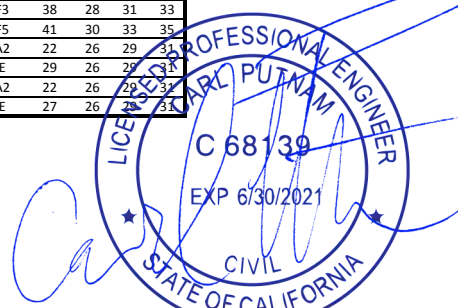

MAY 03 2019

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 30 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.36a: Engineering table for post spacing and footing size for solid covers. Columns include member type, post type, uplift, footing size, and various load conditions (trib, min, uplift, footing).

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 33 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.36b: Engineering table for post spacing and footing size for freestanding structures. Columns include member type, post type, uplift, footing size, and various load conditions (trib, min, uplift, footing).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

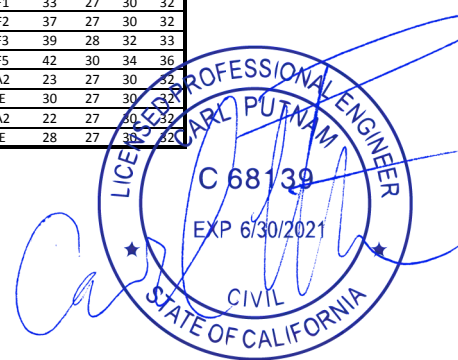

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 31 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.37a: Structural design table for attached buildings. Columns include member type (On Slab, Double, Fascia, Steel, DBL, 4x3, 7x4), dimensions (trib, min post, uplift, footing), and footing size (trib, min post, uplift, footing) for various load conditions.

Ground Snow Load: 30 psf Live Load: 20 psf Roof Design Load 34 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.37b: Structural design table for freestanding structures. Columns include member type (On Slab, Double, Fascia, Steel, DBL, 4x3, 7x4), dimensions (trib, min post, uplift, footing), and footing size (trib, min post, uplift, footing) for various load conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

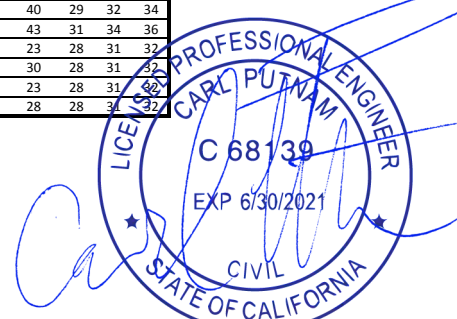

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 33 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.38a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"					
		trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)		
On Slab	On Slab	3'-6"	A2		8'-2"	A2		7'-1"	A2	4'-4"	A2		5'-8"	A2		5'-8"	A2		5'-2"	A2	4'-9"	A2		4'-9"	A2		4'-4"	A1		4'-1"	A2		3'-9"	A2		3'-6"	A2		3'-6"	A2			
0.042"x3"x8"	N30	8'-0"	A1	23	20	22	24	7'-3"	A1	24	22	24	26	6'-2"	A1	24	22	24	26	5'-3"	A2	25	24	26	28	4'-11"	A2	25	24	27	28	4'-8"	A2	25	25	28	30	4'-2"	A2	25	26	28	30
Double 3"x8"	N25	12'-2"	A2	27	20	22	24	11'-2"	C	27	21	23	25	10'-2"	C	28	22	24	26	9'-6"	C	29	23	26	27	8'-11"	C	29	24	27	28	7'-7"	C	30	25	28	30	6'-11"	D	30	26	29	31
Double 2"x6.625"	N25	10'-11"	A2	26	20	22	24	10'-0"	A2	26	21	23	25	9'-3"	B	27	22	24	26	8'-8"	C	28	24	26	28	7'-4"	C	28	24	27	28	7'-0"	C	29	25	28	30	6'-4"	C	29	26	29	31
5.5" Extruded Fascia	L	8'-11"	A1	24	20	22	24	8'-1"	A2	25	21	23	25	7'-3"	A2	25	22	24	26	6'-9"	A2	25	23	26	27	5'-10"	A2	26	24	27	28	5'-2"	A2	26	25	27	29	4'-10"	A2	26	25	28	30
California Fascia	N10, G	8'-10"	A1	24	20	22	24	8'-0"	A2	24	21	23	25	7'-2"	A2	25	22	24	26	6'-7"	A2	25	23	26	27	5'-9"	A2	26	24	27	28	5'-1"	A2	26	25	27	29	4'-9"	A2	26	25	28	30
Classic Fascia	H	13'-4"	C	28	20	22	24	12'-7"	C	28	21	23	25	12'-1"	C	29	22	24	26	11'-7"	D	31	23	26	27	10'-10"	D	31	24	26	28	10'-7"	D	33	25	27	29	10'-0"	E	33	25	28	30
16 G Steel C	N9, T	13'-10"	C	28	20	22	24	12'-5"	C	28	21	23	25	10'-10"	C	28	22	24	26	9'-8"	C	28	23	26	27	7'-11"	C	28	24	26	28	7'-4"	C	28	25	27	29	6'-3"	C	28	25	28	30
14 G Steel C	N9, T	16'-8"	C	30	20	22	24	15'-0"	D	30	21	23	25	13'-6"	D	30	22	24	26	12'-5"	D	31	22	25	26	11'-6"	D	31	24	26	28	9'-10"	D	31	24	27	29	8'-6"	D	31	25	28	30
12 G Steel C	N9, T	23'-9"	E	33	20	22	24	21'-7"	E	34	21	23	25	19'-8"	E	34	22	24	26	18'-4"	E	35	22	25	26	17'-1"	E	36	24	26	28	15'-3"	E	36	24	27	29	14'-5"	F1	37	25	28	30
Double 16 G Steel C	N9, N25, T	25'-7"	E	34	20	22	24	24'-2"	E	35	21	23	25	23'-1"	E	36	22	24	26	21'-8"	F1	37	22	25	26	20'-6"	F1	38	23	26	27	19'-5"	F1	38	24	26	28	18'-6"	F1	39	24	27	28
Double 14 G Steel C	N9, N25, T	27'-4"	E	35	21	23	25	25'-10"	E	36	21	23	25	24'-9"	F1	37	22	24	26	23'-10"	F1	38	22	25	26	22'-11"	F1	39	23	26	27	22'-2"	F1	40	24	26	28	21'-2"	F1	40	24	27	28
Double 12 G Steel C	N9, N25, T	31'-1"	E	36	21	24	26	29'-4"	F1	38	22	24	26	28'-2"	F1	39	22	25	26	27'-1"	F1	41	23	25	27	26'-11"	F1	41	23	26	27	25'-4"	F2	42	24	26	28	24'-8"	F2	43	24	27	28
Steel Coverleaf	W	7'-9"	A1	23	20	22	24	7'-0"	A1	23	21	23	25	6'-5"	A1	24	22	24	26	5'-11"	A1	24	22	25	26	5'-6"	A2	24	23	26	27	5'-2"	A2	25	24	26	28	4'-10"	A2	25	24	27	28
DBL Steel Coverleaf	AA	12'-0"	A2	27	20	22	24	11'-4"	C	27	21	23	25	10'-11"	C	28	22	24	26	9'-11"	C	29	22	25	26	9'-6"	C	30	24	26	28	9'-1"	D	31	24	27	28	8'-9"	D	31	25	27	29
4x3 I Beam	Y	9'-6"	A2	25	20	22	24	8'-5"	A2	25	21	23	25	7'-6"	A2	25	22	24	26	6'-10"	A2	25	22	25	26	6'-3"	A2	25	23	26	27	5'-9"	A2	26	24	26	28	5'-4"	A2	26	24	27	28
7x4 I Beam	Q	16'-9"	C	30	20	22	24	15'-6"	D	30	21	23	25	13'-11"	D	31	22	24	26	12'-9"	D	31	22	25	26	11'-9"	D	31	23	26	27	10'-11"	D	32	24	26	28	10'-2"	D	32	24	27	28

Table 5.38b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"									
		trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)		
On Slab	On Slab	3'-4"	A2		3'-2"	A2		3'-0"	A2	2'-10"	A2		2'-8"	A2		2'-8"	A2		2'-7"	A2	2'-5"	A2		2'-5"	A2		2'-3"	A2		2'-2"	A2		2'-2"	A2		2'-1"	A2		2'-1"	A2			
0.042"x3"x8"	N30	3'-9"	A2	26	26	29	31	3'-7"	A2	26	27	30	31	3'-5"	A2	25	27	30	32	3'-3"	A2	26	28	31	32	3'-2"	A2	26	28	31	33	2'-11"	A2	26	29	32	34	2'-8"	A2	26	29	32	34
Double 3"x8"	N25	6'-4"	D	30	26	29	31	6'-1"	D	31	27	30	31	5'-10"	D	30	27	30	32	5'-8"	D	31	28	31	32	5'-6"	D	31	28	31	33	5'-3"	D	31	28	31	33	5'-0"	D	31	28	31	33
Double 2"x6.625"	N25	5'-11"	C	30	26	29	31	5'-8"	D	30	27	30	31	5'-6"	D	30	27	30	31	5'-4"	D	30	28	31	32	5'-2"	D	30	28	31	33	4'-10"	D	31	29	32	34	4'-7"	D	31	29	32	34
5.5" Extruded Fascia	L	4'-2"	A2	26	26	29	31	4'-0"	A2	27	27	30	31	3'-10"	A2	26	27	30	31	3'-8"	A2	27	28	31	32	3'-6"	B	27	28	31	33	3'-4"	B	27	28	31	33	3'-3"	B	27	29	32	34
California Fascia	N10, G	4'-1"	A2	26	26	29	31	3'-10"	A2	26	27	30	31	3'-8"	A2	26	27	30	31	3'-7"	A2	27	28	31	32	3'-5"	A2	26	28	31	33	3'-3"	A2	27	29	32	34	2'-11"	B	27	29	32	34
Classic Fascia	H	9'-2"	E	34	26	29	31	8'-10"	E	35	27	30	31	8'-7"	E	35	27	30	32	8'-4"	E	35	28	31	32	8'-1"	E	35	28	31	33	7'-10"	E	36	29	32	34	7'-2"	E	36	29	33	35
16 G Steel C	N9, T	5'-2"	C	28	26	29	31	4'-10"	C	28	27	30	31	4'-7"	C	28	27	30	31	4'-4"	C	28	28	31	32	4'-2"	C	28	28	31	33	3'-11"	C	28	29	32	34	3'-6"	C	28	29	32	34
14 G Steel C	N9, T	6'-11"	D	31	26	29	31	6'-7"	D	31	27	30	31	6'-3"	D	31	27	30	32	6'-1"	D	31	28	31	32	5'-8"	D	31	28	31	33	5'-4"	D	31	28	31	33	5'-1"	D	31	29	32	34
12 G Steel C	N9, T	12'-0"	F1	38	26	29	31	11'-7"	F1	38	27	30	31	11'-2"	F1	38	27	30	32	10'-9"	F1	38	28	31	32	10'-5"	F1	38	28	31	33	10'-0"	F1	39	29	32	34	9'-9"	F1	39	29	32	34
Double 16 G Steel C	N9, N25, T	15'-2"	F1	41	26	29	31	14'-8"	F2	41	27	30	31	14'-2"	F2	41	27	30	32	13'-9"	F2	42	28	31	32	13'-5"	F2	41	28	31	33	13'-0"	F2	42	29	32	34	12'-7"	F2	42	29	32	34
Double 14 G Steel C	N9, N25, T	17'-7"	F2	43	26	29	31	17'-0"	F2	43	27	30	31	16'-7"	F2	43	27	30	32	16'-1"	F3	44	28	31	32	15'-8"	F3	44	28	31	33	15'-3"	F3	44	28	31	33	14'-11"	F3	45	29	32	34
Double 12 G Steel C	N9, N25, T	21'-11"	F3	46	26	29	31	21'-4"	F4	46	27	30	31	20'-10"	F4	46	27	30	32	20'-3"	F4	47	28	31	32	19'-9"	F4	47	28														

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 31 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.39a: Multi-column table with 18 columns for different footing types (trib, Min Post, Uplift, Footing) and 25 rows for various materials like On Slab, Double 3"x8", etc.

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 31 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.39b: Multi-column table with 18 columns for different footing types (trib, Min Post, Uplift, Footing) and 25 rows for various materials like On Slab, Double 3"x8", etc.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

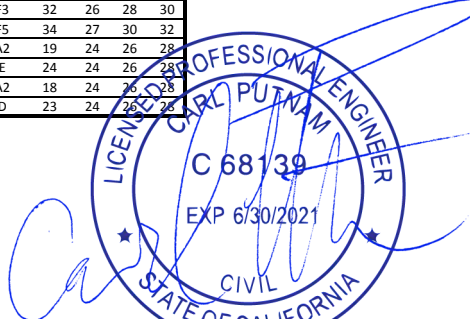

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 31 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.40a: Detailed table for attached structures with columns for footing types (trib, Min Post, Uplift, Footing) and sizes (8', 9', 10', 11', 12', 13', 14', 15').

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 33 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.40b: Detailed table for freestanding structures with columns for footing types (trib, Min Post, Uplift, Footing) and sizes (8', 9', 10', 11', 12', 13', 14', 15').

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

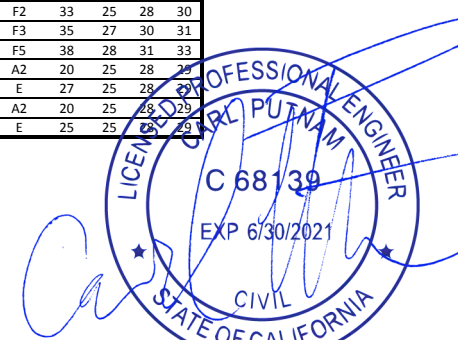

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 32 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.41a: Engineering table for attached structures with columns for footing types (trib, min post, uplift, footing) and sizes (3'-0" to 7'-0").

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 34 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 5.41b: Engineering table for freestanding structures with columns for footing types and sizes (3'-0" to 13'-0").

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 36 psf Live Load: 20 psf Roof Design Load 33 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.42a: Detailed table for Structures Attached to Existing Building. Columns include member type, footing dimensions, and post spacing for various materials like On Slab, Double 3"x8", Double 2"x6.625", etc.

Ground Snow Load: 36 psf Live Load: 20 psf Roof Design Load 35 psf Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.42b: Detailed table for Freestanding Structures. Columns include member type, footing dimensions, and post spacing for various materials like On Slab, Double 3"x8", Double 2"x6.625", etc.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

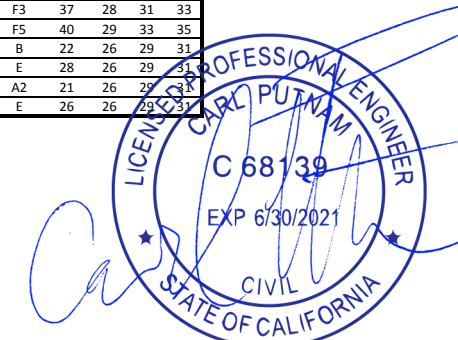

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 33 psf

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.43a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																															
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)								
On Slab	On Slab	8'-0"	A1			3'-2"	A1			4'-10"	A1			4'-4"	A1			6'-0"	A1			3'-5"	A1			8'-0"	A1			3'-2"	A1			3'-0"	A1			4'-10"	A1			4'-4"	A1			6'-0"	A1			3'-5"	A1										
0.042"x3"x8"	N30	7'-9"	A1	21	19	21	22	7'-11"	A1	22	20	22	23	6'-6"	A1	22	20	23	24	5'-11"	A2	22	21	23	25	5'-6"	A2	22	22	24	25	5'-2"	A2	23	22	25	26	4'-10"	A2	23	23	25	27	4'-7"	A2	23	24	26	28	4'-1"	A2	23	24	27	28	3'-10"	A2	23	24	27	29


Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																									
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post
On Slab	On Slab	2'-10"	A1			2'-8"	A1			2'-6"	A1			2'-5"	A1			2'-3"	A1			2'-2"	A1			2'-10"	A1			2'-10"	A1			2'-10"	A1			2'-10"	A1			2'-10"	A1			2'-10"	A1			2'-10"	A1			2'-10"	A1				
0.042"x3"x8"	N30	3'-8"	A2	23	25	28	29	3'-6"	A2	23	25	28	30	3'-4"	A2	27	26	28	30	3'-2"	A2	24	26	29	30	3'-1"	A2	27	26	29	31	2'-9"	A2	24	27	29	31	2'-10"	A2	24	27	30	31	2'-9"	A2	24	27	30	32	2'-8"	A2	24	27	30	32				

Ground Snow Load: 36 psf Live Load: 20 psf Roof Design Load 36 psf Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.43b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)
On Slab	On Slab	8'-0"	A2			3'-5"	A2			4'-10"	A2			4'-4"	A2			6'-0"	A2			3'-2"	A2			8'-0"	A2			3'-2"	A2			3'-0"	A2			4'-10"	A2			4'-4"	A2			6'-0"	A2			3'-5"	A2										
0.042"x3"x8"	N30	7'-5"	A1	19	24	27	29	6'-8"	A1	20	24	26	28	6'-8"	A1	20	23	25	27	5'-8"	A2	20	22	24	26	4'-10"	A2	20	22	24	26	4'-3"	A2	21	22	25	26	4'-0"	A2	21	23	25	27	3'-9"	A2	21	23	26	27	3'-9"	A2	21	23	26	27	3'-7"	A2	21	24	26	28

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																									
		trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post
On Slab	On Slab	2'-10"	A2			2'-8"	A2			2'-6"	A2			2'-5"	A2			2'-3"	A2			2'-2"	A2			2'-10"	A2			2'-10"	A2			2'-10"	A2			2'-10"	A2			2'-10"	A2			2'-10"	A2			2'-10"	A2			2'-10"	A2								
0.042"x3"x8"	N30	3'-5"	A2	21	24	27	28	3'-3"	A2	21	24	27	29	3'-1"	A2	21	25	27	29	3'-0"	A2	21	25	28	29	2'-10"	A2	21	25	28	30	2'-5"	A2	21	26	29	30	2'-6"	A2	21	26	29	31	2'-5"	A2	21	26	29	31	2'-5"	A2	21	26	29	31								

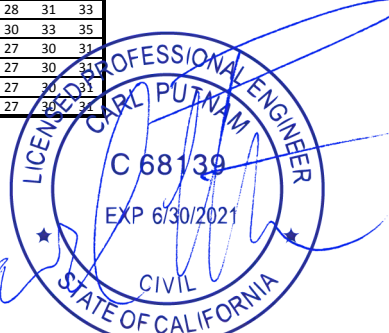Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 36 psf Live Load: 20 psf Roof Design Load 34 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building


Table 5.44a: Table of footing requirements for structures attached to existing buildings. Columns include footing type (trib, min post, uplift, constrained), footing size (8', 9', 10', 11', 12', 13', 14', 15'), and various load parameters.

Ground Snow Load: 36 psf Live Load: 20 psf Roof Design Load 38 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.44b: Table of footing requirements for freestanding structures. Columns include footing type (trib, min post, uplift, constrained), footing size (8', 9', 10', 11', 12', 13', 14', 15'), and various load parameters.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P.E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

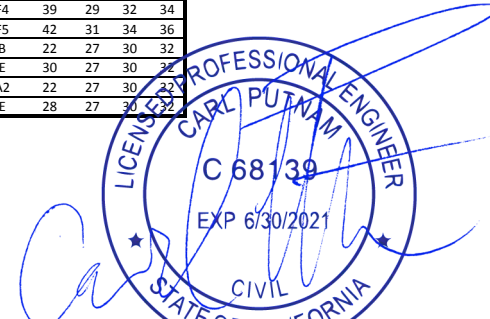

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 36 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 50%

Seismic Design Category C

Structures are Attached to Existing Building

Table 5.45a: Post spacing and footing size table for attached structures under various load and seismic conditions. Columns include material type (e.g., On Slab, N30, N25), post type, footing dimensions, and footing length.

Table 5.45a continuation: Post spacing and footing size table for attached structures, showing details for different materials and footing configurations.

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 37 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 50%


Seismic Design Category C

Freestanding Structures

Table 5.45b: Post spacing and footing size table for freestanding structures under various load and seismic conditions. Columns include material type, post type, footing dimensions, and footing length.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

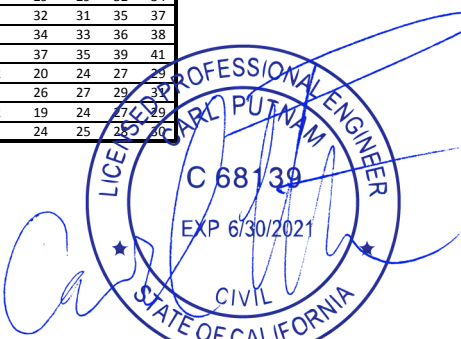

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 37 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 50%

Seismic Design Category C

Structures are Attached to Existing Building

Table 5.46a: Detailed table for attached structures with columns for footing size, post type, and various load conditions. Includes a header section and a grid of data points.

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 39 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 50%


Seismic Design Category C

Freestanding Structures

Table 5.46b: Detailed table for freestanding structures with columns for footing size, post type, and various load conditions. Includes a header section and a grid of data points.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P.E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

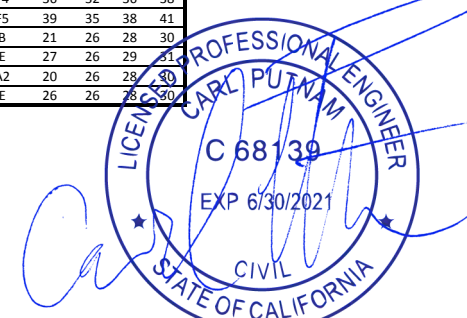

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 38 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.47a: Design tables for attached structures with columns for footing type, footing size, and post spacing for various load and seismic conditions.

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 42 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 5.47b: Design tables for freestanding structures with columns for footing type, footing size, and post spacing for various load and seismic conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 50 psf

Live Load: 20 psf

Roof Design Load 43 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 50%

Seismic Design Category C

Structures are Attached to Existing Building

Header Detail	cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"																								
	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained										
On Slab	17'-5"	A1				11'-7"	A1				8'-8"	A1				6'-11"	A1				5'-9"	A1				4'-4"	A1				3'-10"	A1				5'-5"	A1				2'-10"	A1													
0.042"x3"x8"	N30	12'-11"	A1	16	18	20	21	10'-2"	A1	17	19	21	22	8'-7"	A1	18	19	21	23	7'-6"	A1	18	20	22	23	6'-8"	A1	19	20	22	24	5'-11"	A2	19	20	22	24	5'-5"	A2	19	20	23	24	4'-7"	A2	20	21	23	24	4'-3"	A2	20	21	24	25

Header Detail	cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"																		
	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)
On Slab	2'-8"	A1				2'-5"	A1				2'-3"	A1				2'-2"	A1				2'-0"	A1				1'-11"	A1				1'-10"	A1				1'-8"	A1				1'-7"	A1							
0.042"x3"x8"	N30	3'-9"	A2	20	22	25	26	3'-6"	A2	20	23	25	26	3'-4"	A2	27	23	25	27	3'-1"	A2	20	23	26	27	3'-0"	A2	28	24	26	28	2'-10"	A2	20	24	27	28	2'-7"	A2	21	24	27	29	2'-5"	A2	21	25	28	30


Ground Snow Load: 50 psf Live Load: 20 psf Roof Design Load 43 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Freestanding Structures

Header Detail	cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"																								
	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained					
On Slab	17'-5"	A1				11'-7"	A1				8'-8"	A1				6'-11"	A1				5'-9"	A1				4'-4"	A1				3'-10"	A1				5'-5"	A1				2'-10"	A1													
0.042"x3"x8"	N30	12'-11"	A1	15	27	30	32	10'-2"	A1	16	25	28	30	8'-7"	A1	17	24	27	28	7'-5"	A1	17	23	26	27	6'-8"	A1	17	23	25	27	5'-11"	A2	18	22	24	26	4'-11"	A2	18	21	23	25	4'-7"	A2	18	21	23	24	4'-3"	A2	18	21	23	24

Header Detail	cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"																		
	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)	Constrained	trib	Min Post	Uplift	Footings (in)
On Slab	2'-8"	A1				2'-5"	A1				2'-3"	A1				2'-2"	A1				2'-0"	A1				1'-11"	A1				1'-10"	A1				1'-8"	A1				1'-7"	A1							
0.042"x3"x8"	N30	3'-8"	A2	19	21	24	25	3'-6"	A2	19	22	24	26	3'-3"	A2	19	22	25	26	3'-1"	A2	19	23	25	26	2'-10"	A2	19	23	26	27	2'-8"	A2	19	24	26	28	2'-7"	A2	19	24	26	28	2'-5"	A2	19	24	27	29

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

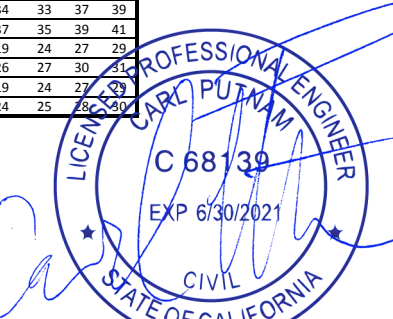

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 50 psf

Live Load: 20 psf

Roof Design Load 43 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.49a: Design table for structures attached to existing buildings. Columns include material (On Slab, Double 3"x8", etc.), post size (1.5", 2", 2.5", 3", 3.5", 4", 4.5", 5", 5.5", 6"), and footing size (8", 12", 15").

Ground Snow Load: 50 psf

Live Load: 20 psf

Roof Design Load 47 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 5.49b: Design table for freestanding structures. Columns include material (On Slab, Double 3"x8", etc.), post size (1.5", 2", 2.5", 3", 3.5", 4", 4.5", 5", 5.5", 6"), and footing size (8", 12", 15").

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P.E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 60 psf Live Load: 20 psf Roof Design Load 51 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Structures are Attached to Existing Building

Table 5.50a: Detailed table for attached structures showing footing dimensions (trib, min post, uplift, max post length) for various materials and conditions across 12 columns.

Ground Snow Load: 60 psf Live Load: 20 psf Roof Design Load 51 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 50% Seismic Design Category C Freestanding Structures

Table 5.50b: Detailed table for freestanding structures showing footing dimensions (trib, min post, uplift, max post length) for various materials and conditions across 12 columns.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

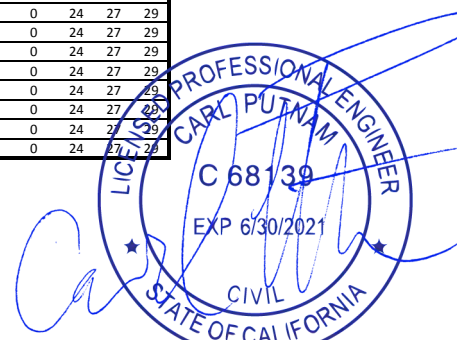

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%


Ground Snow Load: 60 psf Live Load: 20 psf Roof Design Load 51 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.5.1a: Detailed table for attached structures with columns for footing type, min post, uplift, and footing length for various roof types and materials.

Ground Snow Load: 60 psf Live Load: 20 psf Roof Design Load 53 psf Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures


Table 5.5.1b: Detailed table for freestanding structures with columns for footing type, min post, uplift, and footing length for various roof types and materials.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net




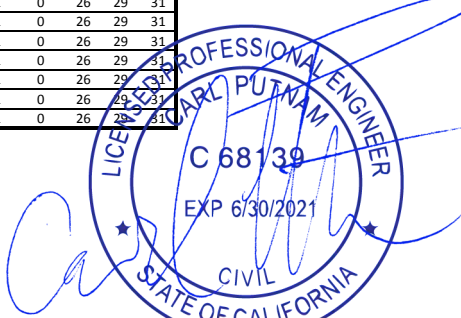


USE OF FOAM CORE SANDWICH PANELS WILL REQUIRE THE USE OF A REGISTERED DESIGN PROFESSIONAL TO COMPLY WITH EXISTING ICC ESR


FOAM CORE SANDWICH PANEL W/ CURRENT ICC ESR

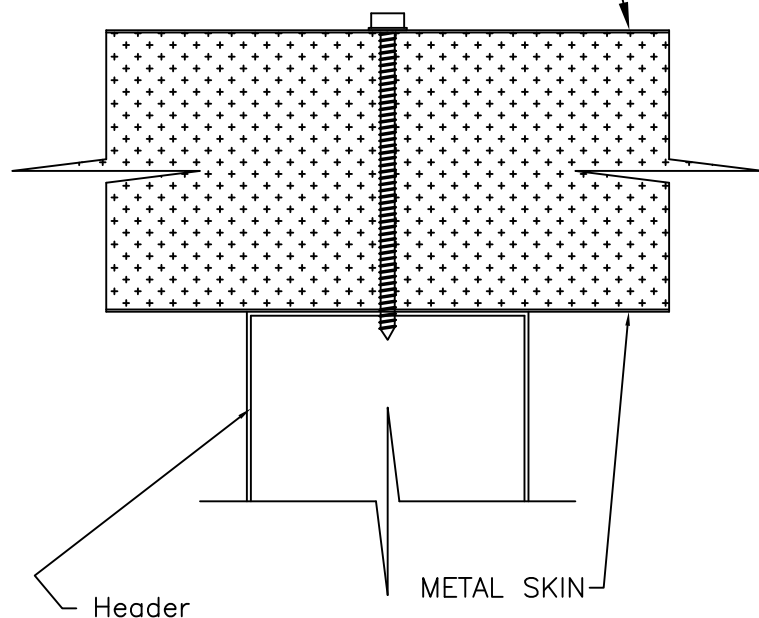

(N1) SANDWICH PANEL TO HEADER CONNECTION

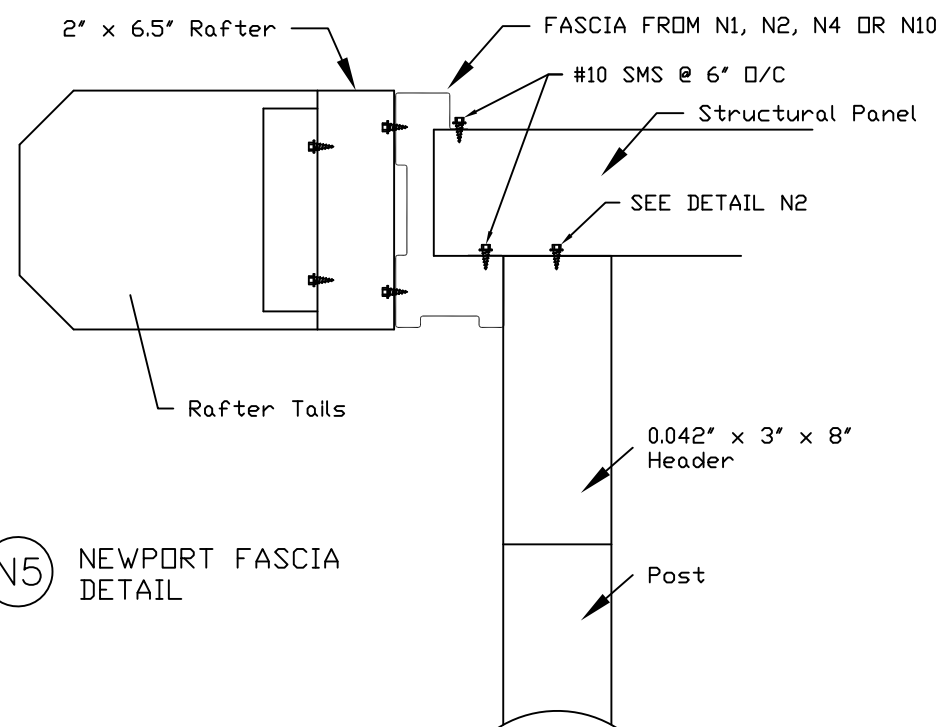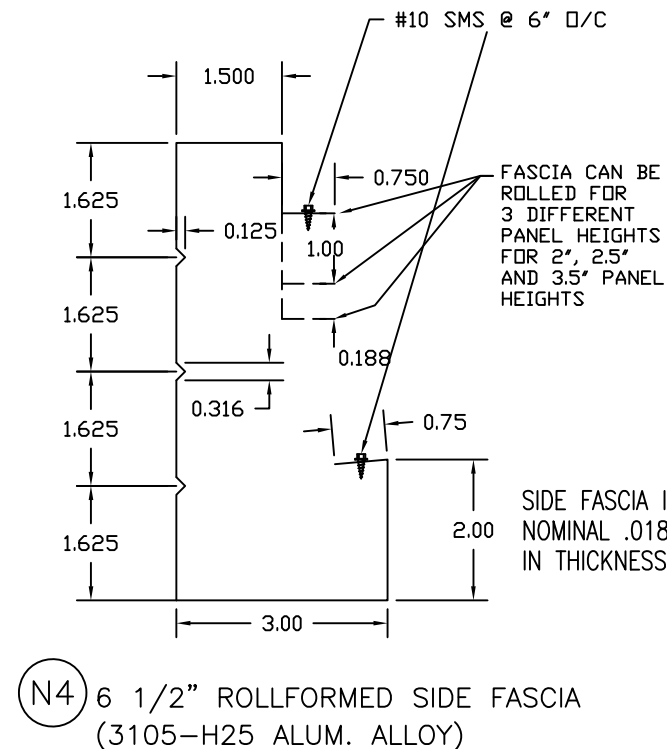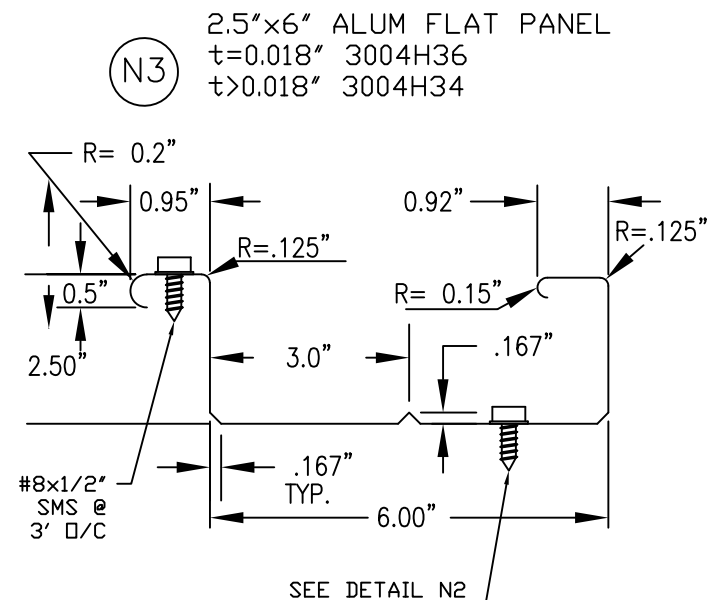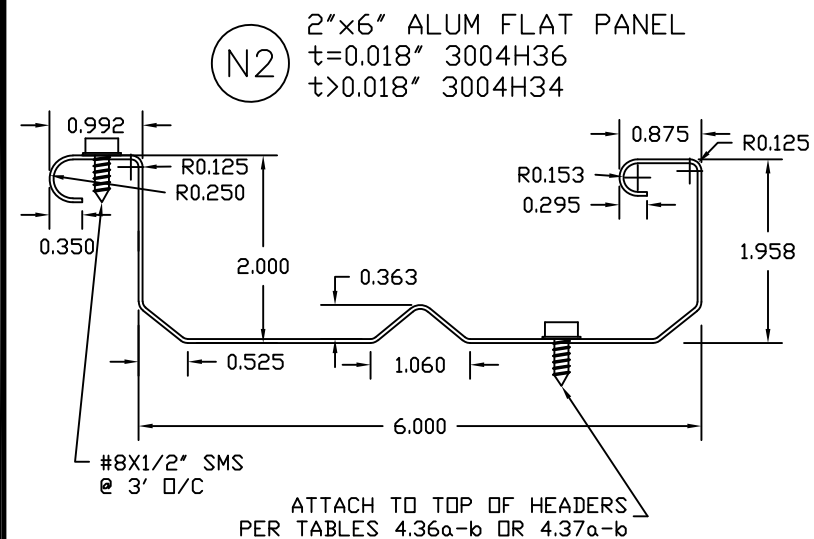

(N5) NEWPORT FASCIA DETAIL

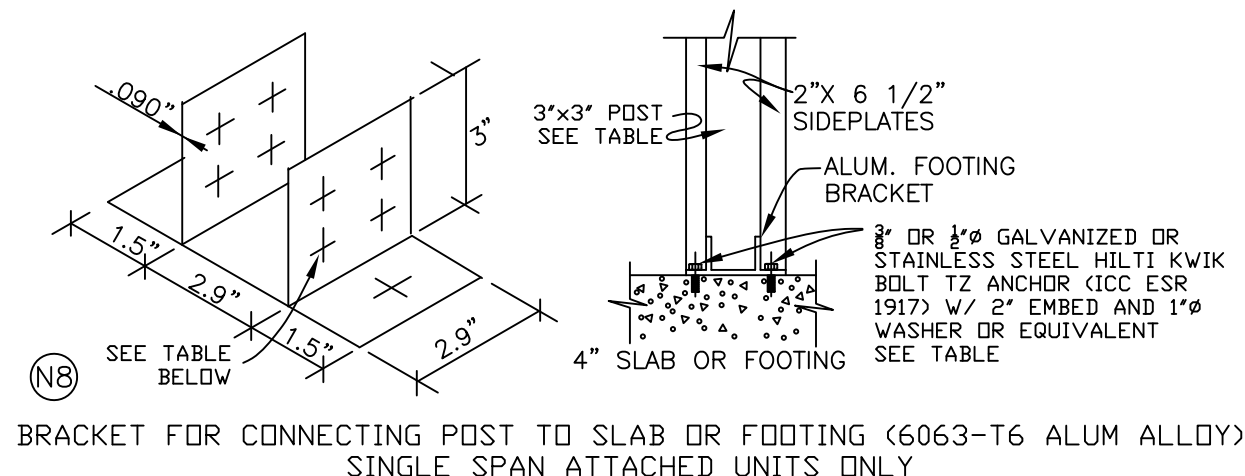


(N8) BRACKET FOR CONNECTING POST TO SLAB OR FOOTING (6063-T6 ALUM ALLOY) SINGLE SPAN ATTACHED UNITS ONLY

Footing d (in)	Number Of #14 SMS	3"x3" Post	Concrete Anchors	Maximum Wind Condition for "On Slab" Attachment
26	8	0.024" Alum	3/8"	110 mph Exp B
29	8	0.032" Alum	3/8"	105 mph Exp C / 130 mph Exp B
30	12	0.024" Alum	1/2"	115 mph Exp C
33	12	0.032" Alum	1/2"	130 mph Exp C
33	8	0.041" Steel	1/2"	150 mph Exp C




Amerimax 28921 US Hwy 74
EXTERIOR HOME PRODUCTS Romoland, CA 92585


DRAWN BY: BEJ/CP TYPE:
SCALE: NTS NAME: Component Parts & Connection Details for Newport Patio Structures
DATE: FILE#: NP01-2018 SHEET: 1 of 4

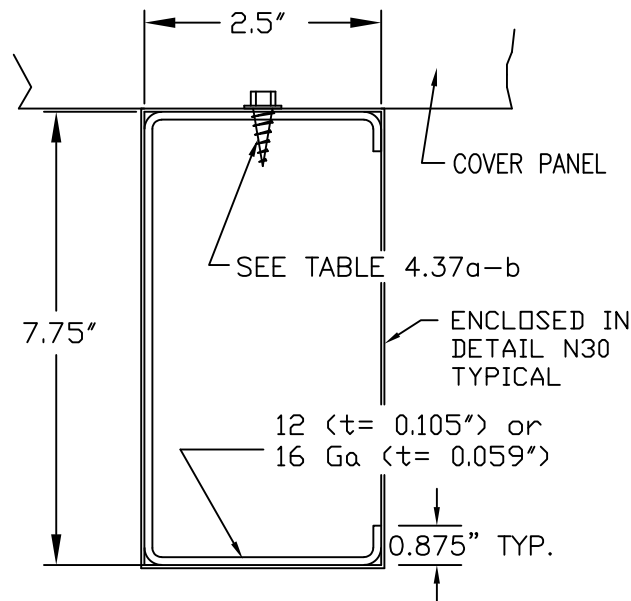


N9 STEEL "C"— CHANNEL HEADER
(STEEL A-653 Fy=50 KSI)

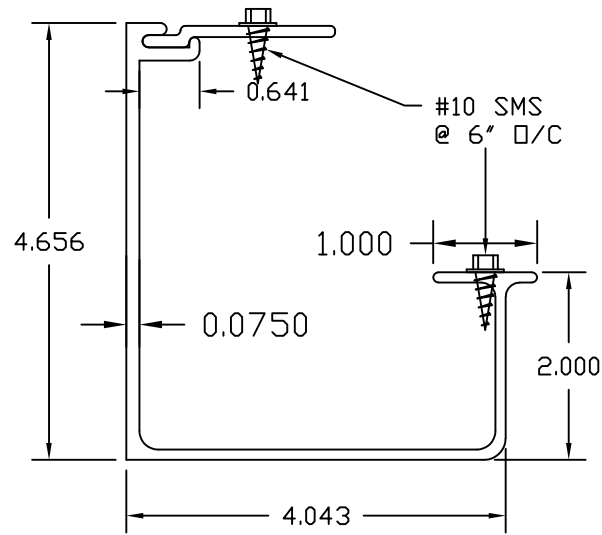

N10 CALIFORNIA FASCIA
(ALUM 6063 T6)

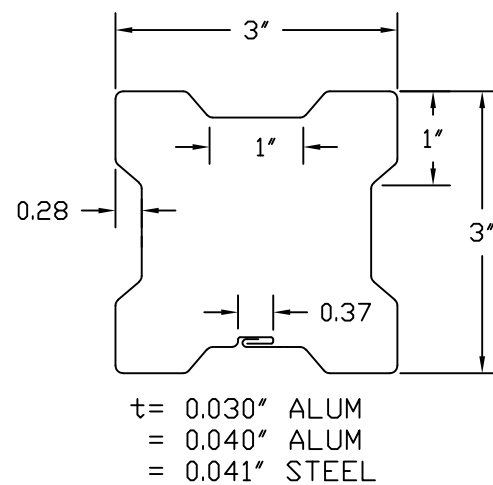


N11 3" ALTERNATE POST
(3105-H25 ALUM. ALLOY OR
A-653 Fy=40 KSI STEEL)

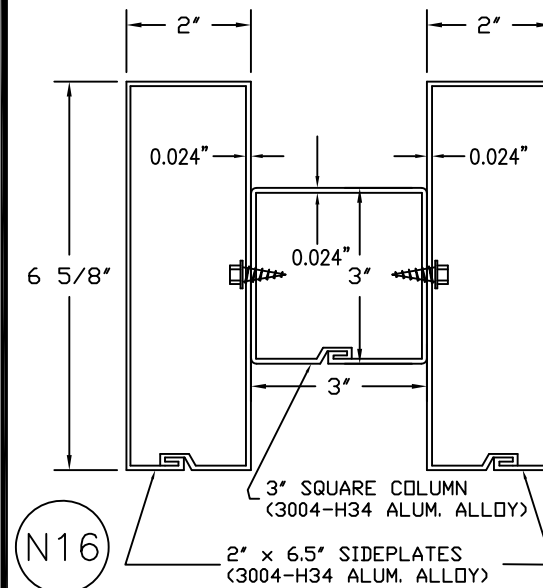


N16 SIDEPLATE CONNECTION DETAIL

Live Load (psf)	Wind Speed and Exposure	MAX "L" FOR TOP OR SIDE MOUNT	
		16" o/c	24" o/c
10	115 mph Exp B	15'-2"	10'-1"
	130 mph Exp B	13'-7"	9'-1"
	100 mph Exp C	15'-2"	10'-1"
	110 mph Exp C	14'-7"	9'-8"
	115 mph Exp C	13'-10"	9'-3"
20	130 mph Exp C	12'-2"	8'-2"
	115 mph Exp B	10'-3"	6'-9"
	100 mph Exp C	10'-3"	6'-9"
	110 mph Exp C	10'-0"	6'-8"
	115 mph Exp C	9'-8"	6'-6"
130 mph Exp C	8'-9"	5'-10"	


TOP MOUNT BRACKET NOT ALLOWED IN SNOW LOAD AREAS
SEE GENERAL NOTE #9 FOR CORROSION PROTECTION

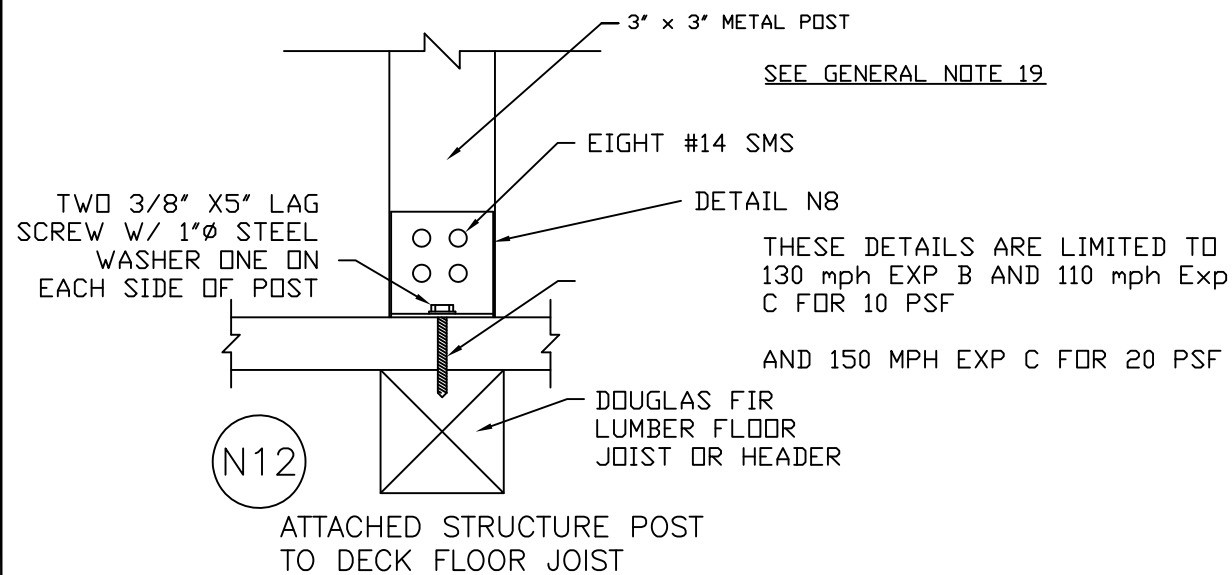

N12 ATTACHED STRUCTURE POST TO DECK FLOOR JOIST

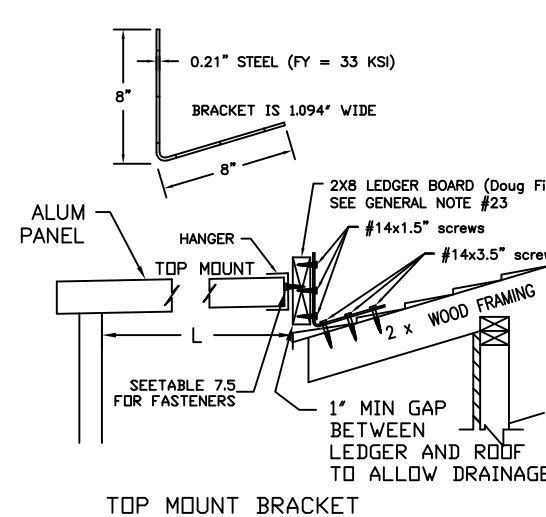


N17 TOP MOUNT BRACKET

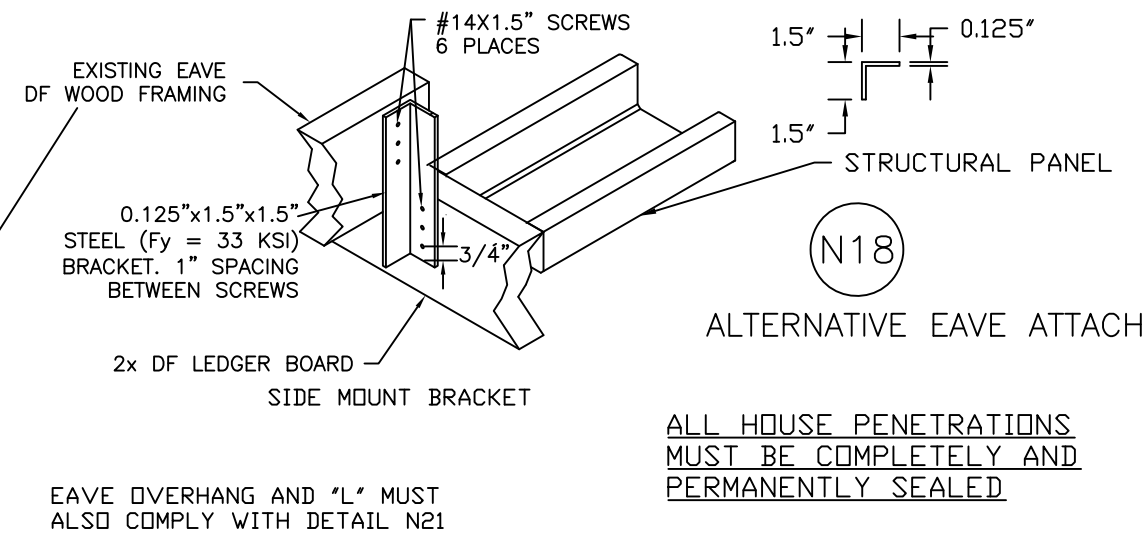


N18 ALTERNATIVE EAVE ATTACHMENT

ALL HOUSE PENETRATIONS MUST BE COMPLETELY AND PERMANENTLY SEALED

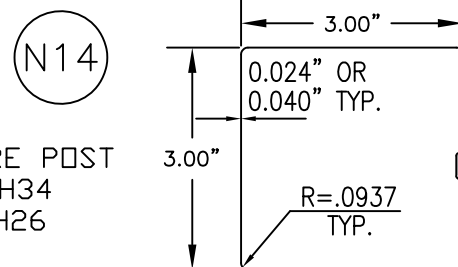

N14 3" ALUM SQUARE POST
t = 0.024" 3004H34
t = 0.040" 3105H26

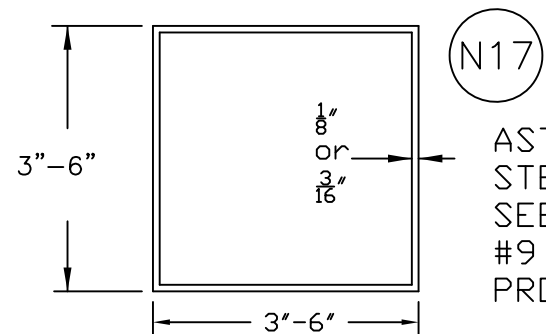


N17 ASTM A500 GRADE B STEEL POST
SEE GENERAL NOTE #9 FOR CORROSION PROTECTION




Amerimax 28921 US Hwy 74 Romoland, CA 92585
EXTERIOR HOME PRODUCTS





DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details for Newport Patio Structures
DATE:	FILE#: NP02-2018
	SHEET: 2 of 4

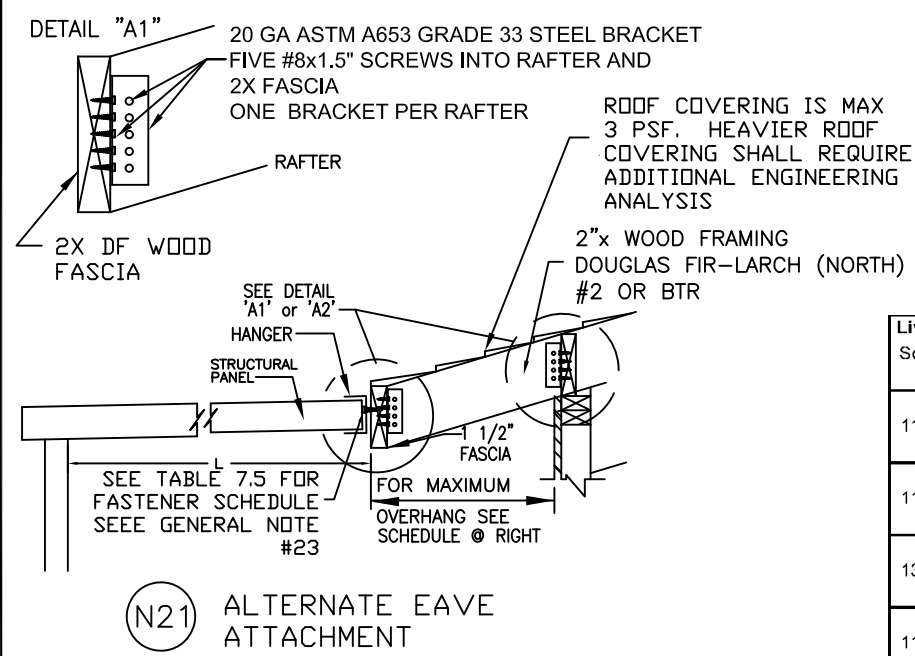


(N21) ALTERNATE EAVE ATTACHMENT

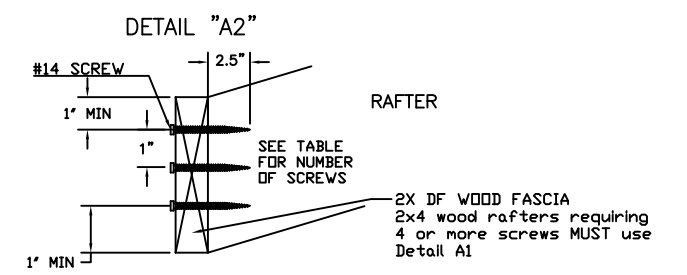


Live/Snow Load Solid Cover Wind (psf)	RAFTER SIZE (24" O/C)	MAX DISTANCE TO FIRST ROW OF POSTS "L"					# of #14 Screws
		EAVE OVERHANG					
10 115 MPH EXP B	2x4	21'-0"	20'-5"	11'-6"	6'-4"	2'-10"	2
	2x6	21'-0"	21'-0"	21'-0"	21'-0"	16'-3"	
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"	
10 115 MPH EXP C	2x4	21'-0"	20'-3"	11'-5"	6'-4"	2'-9"	2
	2x6	21'-0"	21'-0"	21'-0"	21'-0"	16'-2"	
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"	
10 130 MPH EXP C	2x4	21'-0"	17'-8"	9'-11"	5'-6"	2'-5"	3
	2x6	21'-0"	21'-0"	21'-0"	20'-1"	14'-1"	
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"	
20 110 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
20 115 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
20 130 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
25 110 MPH EXP C	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
25 130 MPH EXP C	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
30 130 MPH EXP C	2x4	15'-0"	9'-2"	5'-1"	2'-9"	1'-0"	4
	2x6	15'-0"	15'-0"	15'-0"	10'-5"	7'-2"	
	2x8	15'-0"	15'-0"	15'-0"	15'-0"	14'-9"	
35.7 130 MPH EXP C	2x4	15'-0"	7'-7"	4'-0"	1'-11"	0'-6"	4
	2x6	15'-0"	15'-0"	12'-8"	8'-5"	5'-7"	
	2x8	15'-0"	15'-0"	15'-0"	15'-0"	12'-0"	
42 130 MPH EXP C	2x4	14'-0"	6'-3"	3'-2"	1'-4"	0'-0"	4
	2x6	14'-0"	14'-0"	10'-6"	6'-10"	4'-5"	
	2x8	14'-0"	14'-0"	14'-0"	13'-8"	9'-10"	
50 130 MPH EXP C	2x4	12'-0"	5'-1"	2'-5"	0'-10"	0'-0"	4
	2x6	13'-0"	13'-0"	8'-7"	5'-5"	3'-3"	
	2x8	13'-0"	13'-0"	13'-0"	11'-1"	7'-10"	
60 130 MPH EXP C	2x4	9'-11"	4'-1"	1'-9"	0'-4"	0'-0"	4
	2x6	12'-0"	11'-9"	6'-11"	4'-2"	2'-4"	
	2x8	12'-0"	12'-0"	12'-0"	8'-11"	6'-1"	

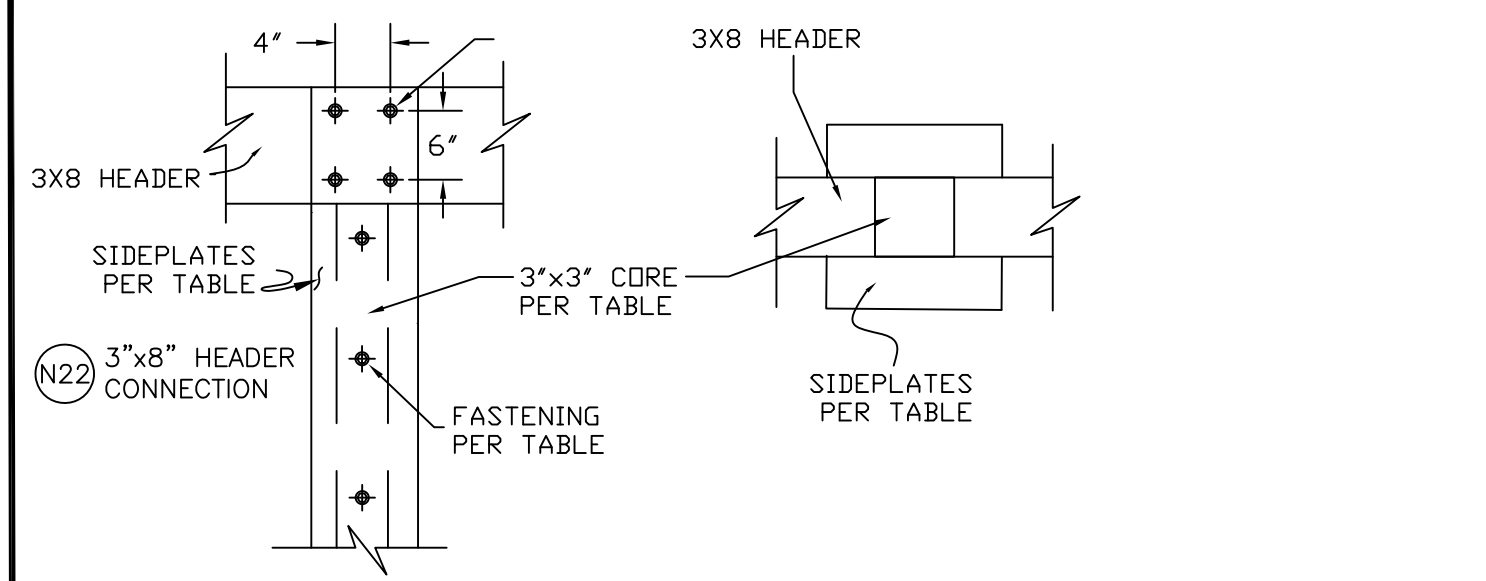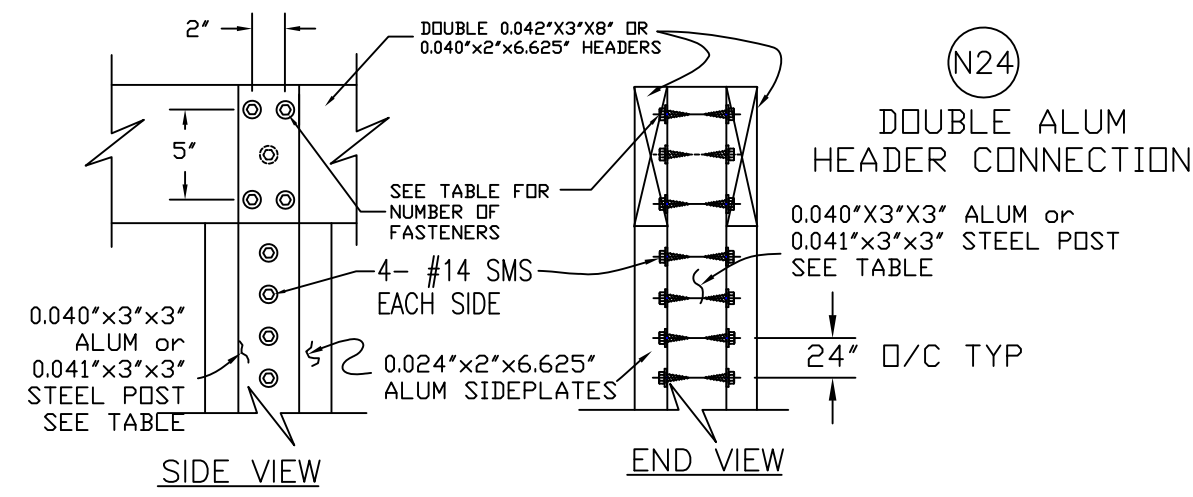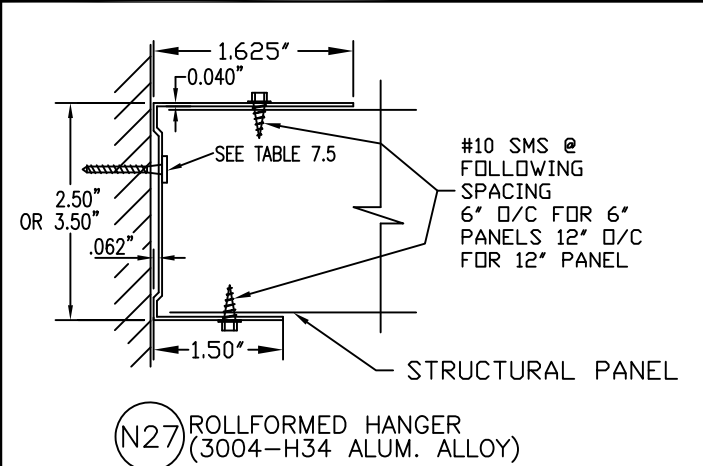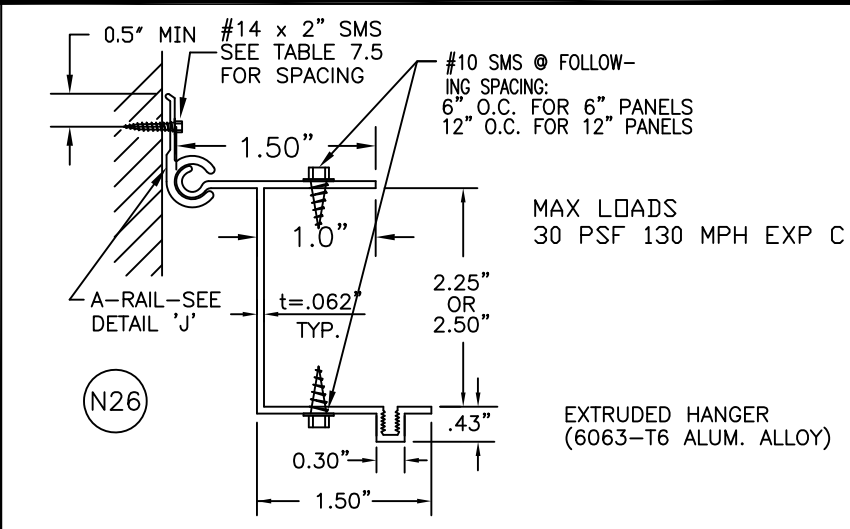

FOOTING d (in)	Number of #14 SMS	Side Plates	3"x3" Core	Maximim Wind Condition for "On Slab" Attachment
26	8	0.024"x2"x6.625"	0.024"	115 mph Exp B
29	8	0.032"x2"x6.625"	0.032"	120 mph Exp B/105 MPH Exp C
30	12	0.024"x2"x6.625"	0.024"	110 mph Exp C
33	12	0.032"x2"x6.625"	0.032"	130 mph Exp C

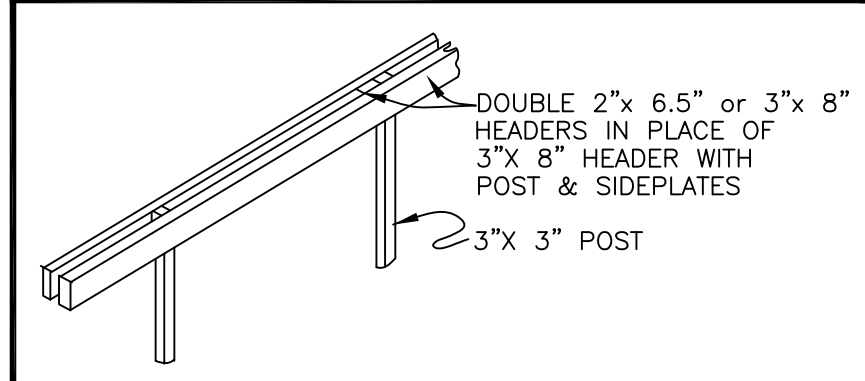

(N25) DOUBLE 2"x6.625" HEADERS (DETAIL N31)
 DOUBLE 3"x8" HEADER (DETAIL N30)

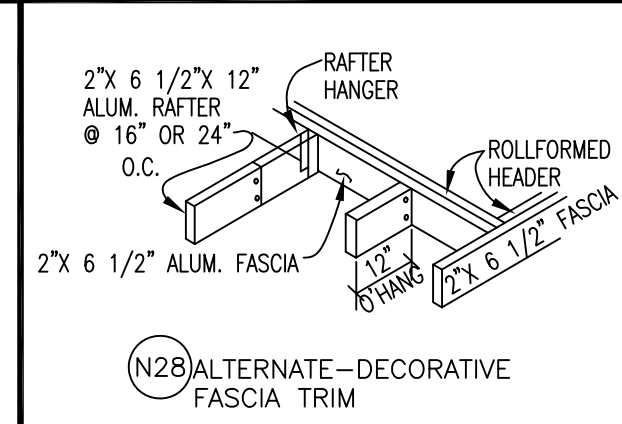








Max Uplift Footing d (in)	Total Number of #14 SMS	Maximim Wind Condition for "On Slab" Attachment	Minimum 3"x3" Post
30	8	115 mph Exp B/100 mph Exp C	0.040" Alum
32	10	120 mph Exp C	0.040" Alum
34	12	130 mph Exp C	0.040" Alum
31	8	120 mph Exp C	0.041" Steel
34	10	130 mph Exp C	0.041" Steel



Amerimax 28921 US Hwy 74
 EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP TYPE:
 SCALE: NTS NAME: Component Parts & Connection Details for Newport Patio Structures
 DATE: FILE#: NP03-2018 SHEET: 3 of 4


MAY 03 2019

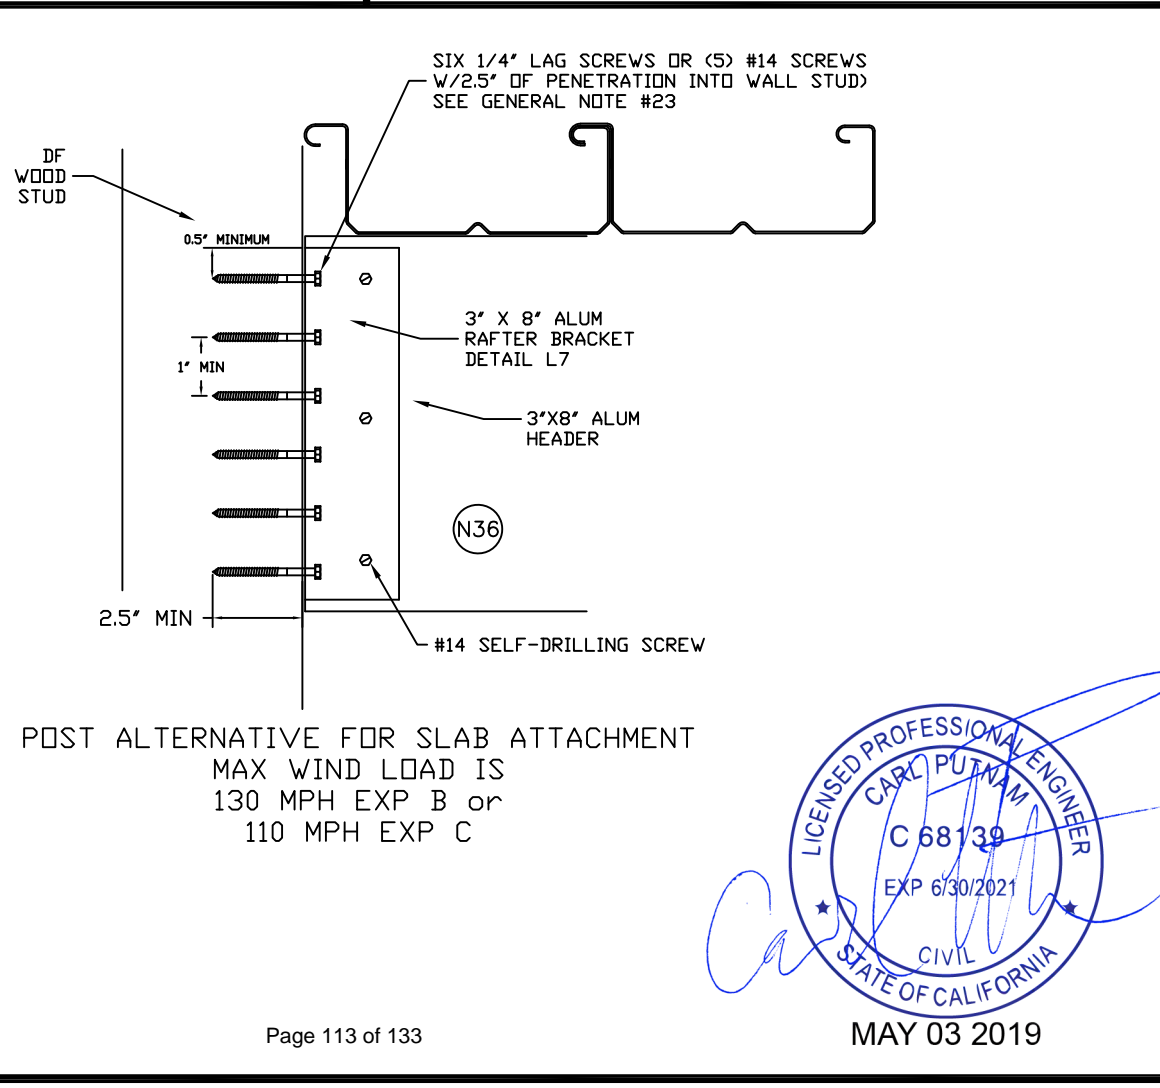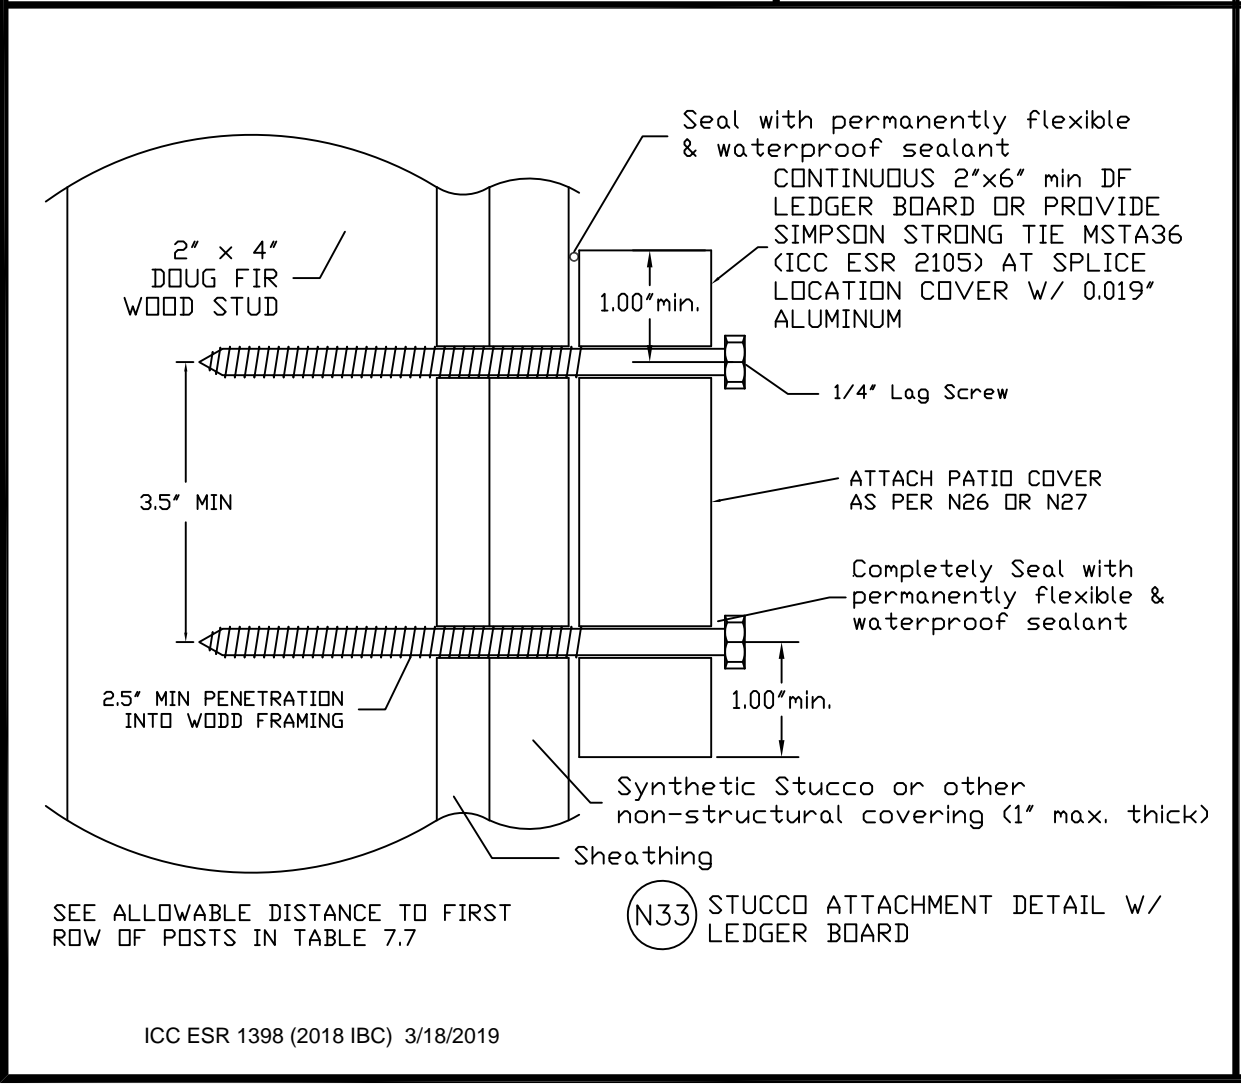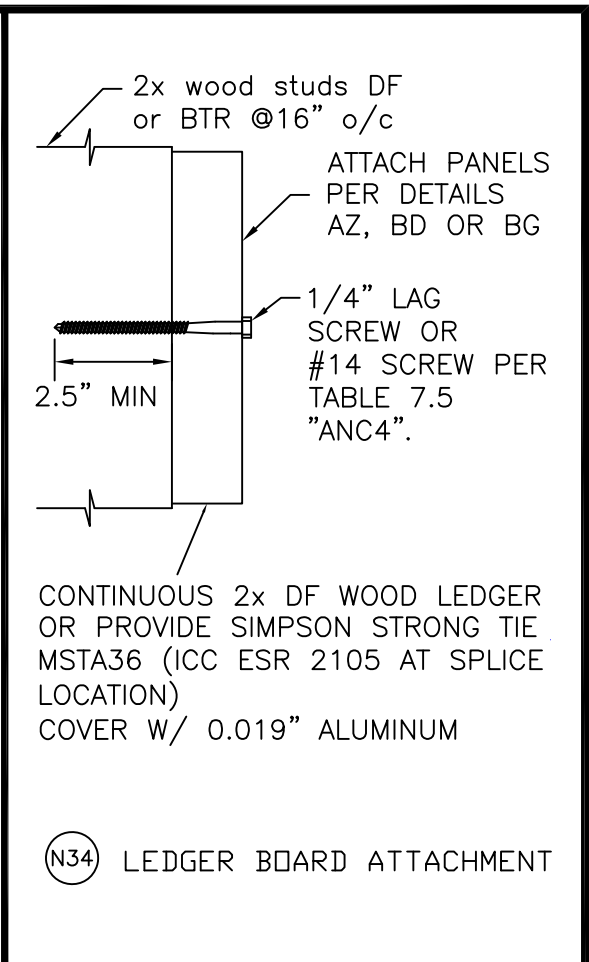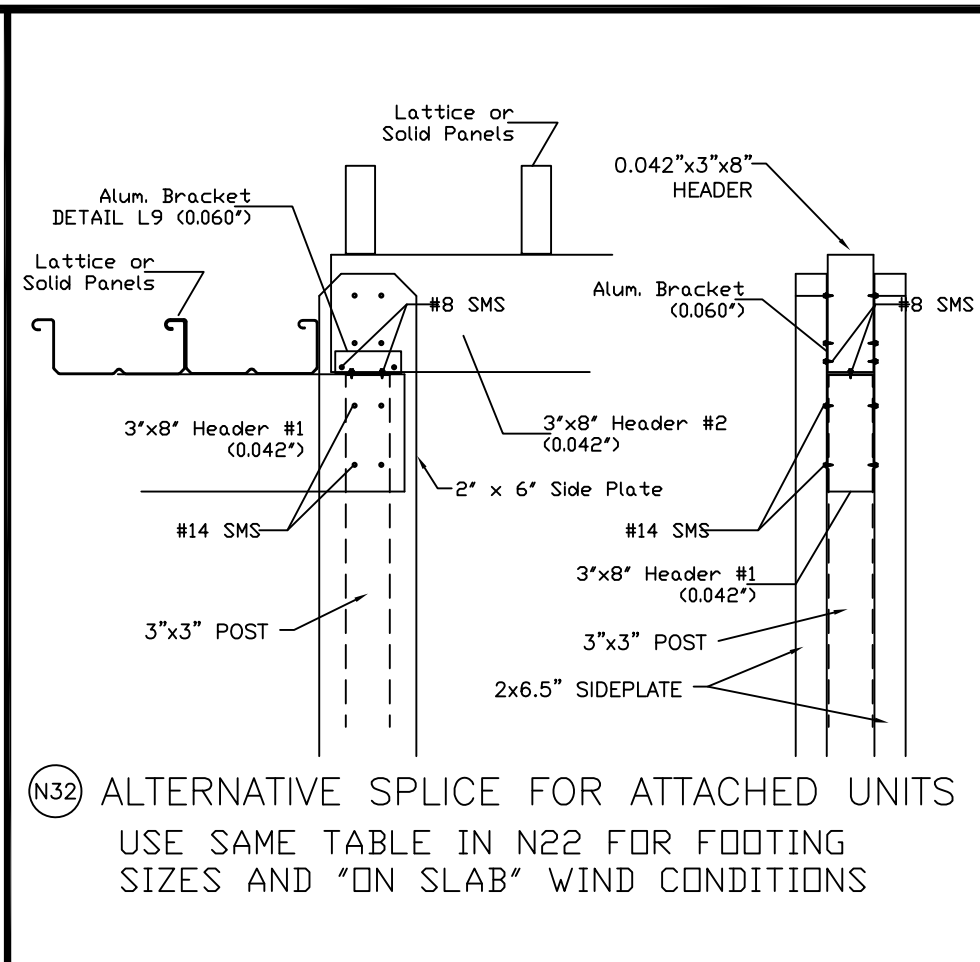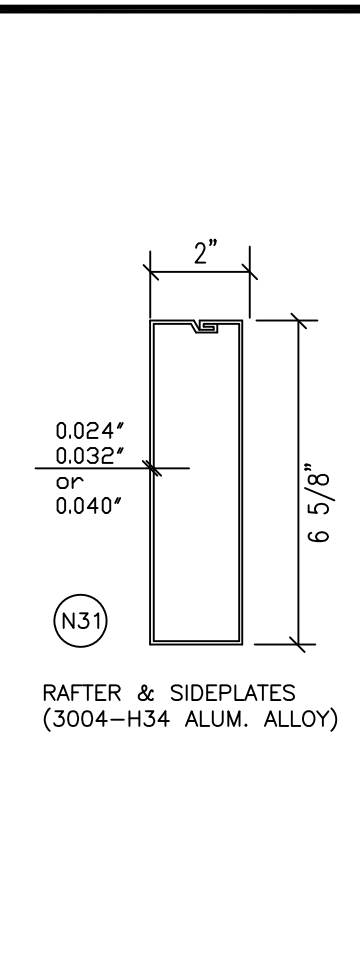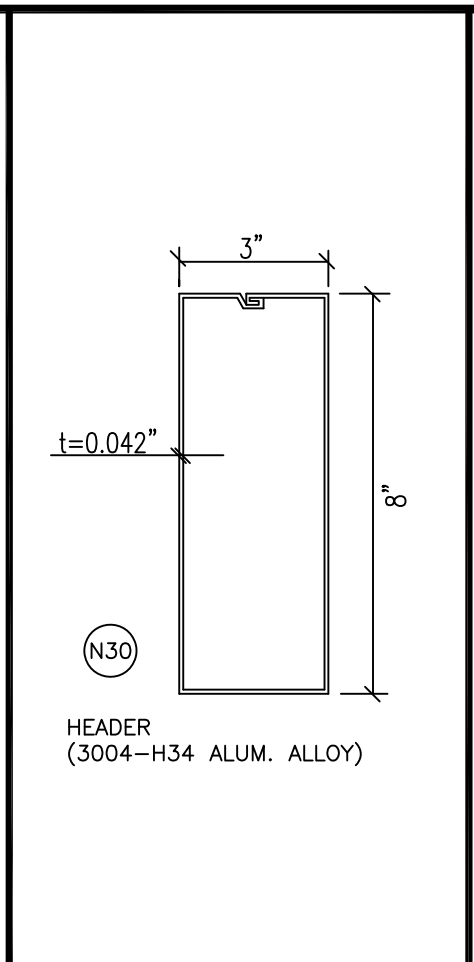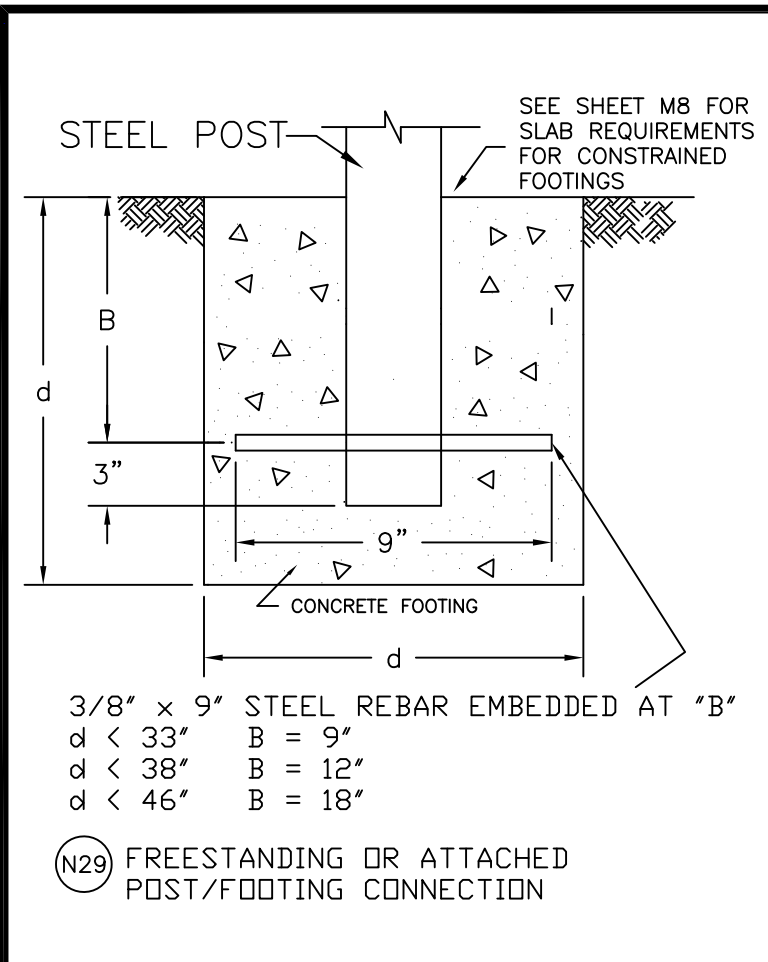


Amerimax 28921 US Hwy 74 Romoland, CA 92585
 EXTERIOR HOME PRODUCTS

DRAWN BY: BEJ/CP TYPE:
 SCALE: NTS NAME: Component Parts & Connection Details for Newport Patio Structures
 DATE: FILE#: NP04-2018 SHEET: 4 of 4


LICENSED PROFESSIONAL ENGINEER
 CARL PUTNAM
 C 68139
 EXP 6/30/2021
 CIVIL
 STATE OF CALIFORNIA
 MAY 03 2019

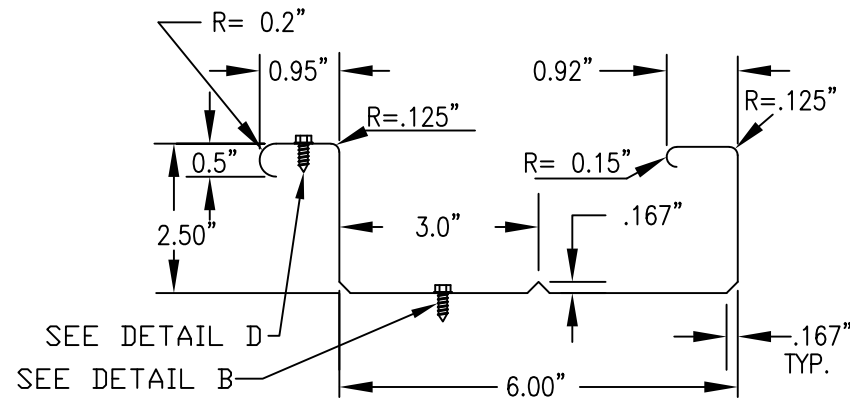


(A) 2.5"x6" SUPER SIX PANEL
 t = 0.018" 3004H36
 t > 0.018" 3004H34

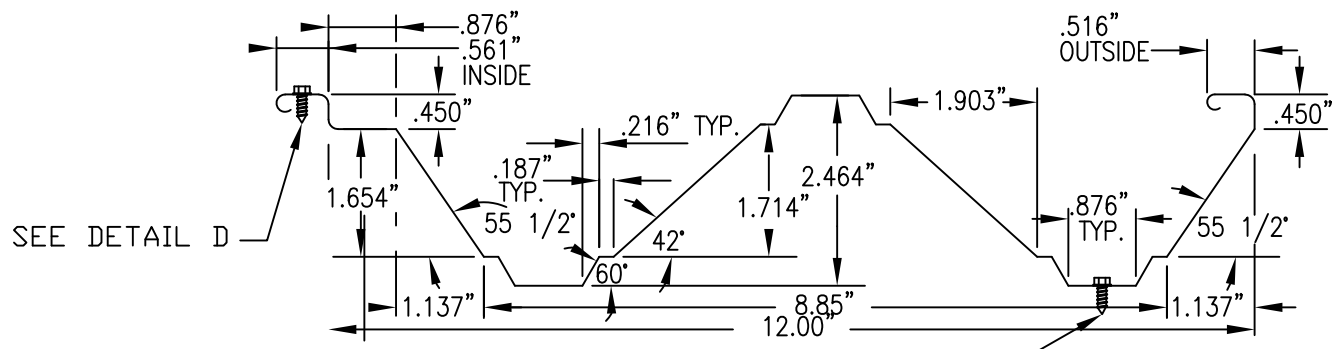


(B) 2.5"x12" MARK X ALUMINUM PANEL
 0.018"-0.032" 3004 H36
 0.036" 3004 H34

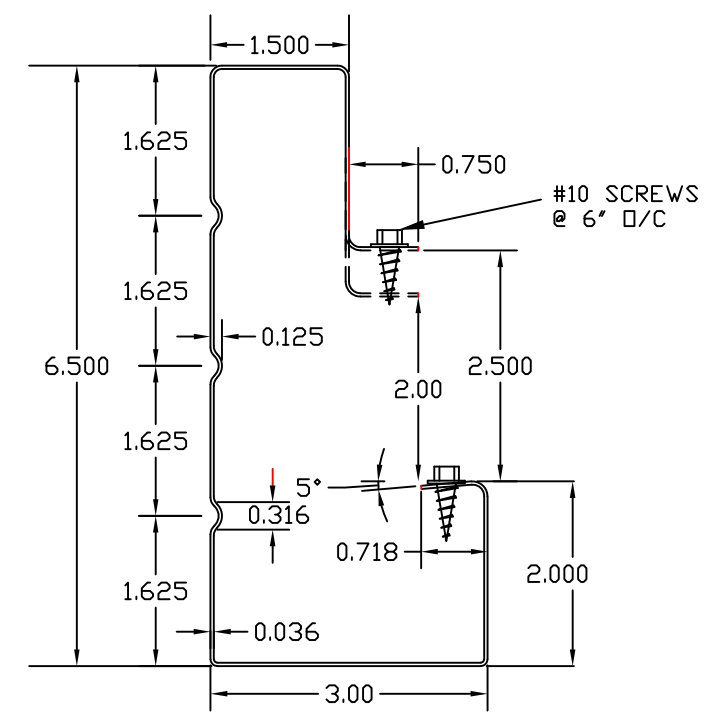


(E) 6 1/2" ROLLFORMED FASCIA 3105H25 ALLOY

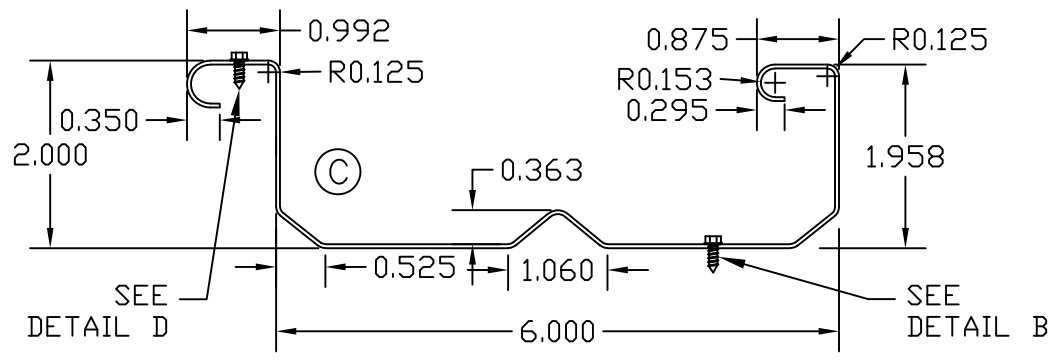

(C) 2"x6" FLAT PANEL
 t = 0.018" 3004H36 ALUMINUM
 t > 0.018" 3004H34 ALUMINUM

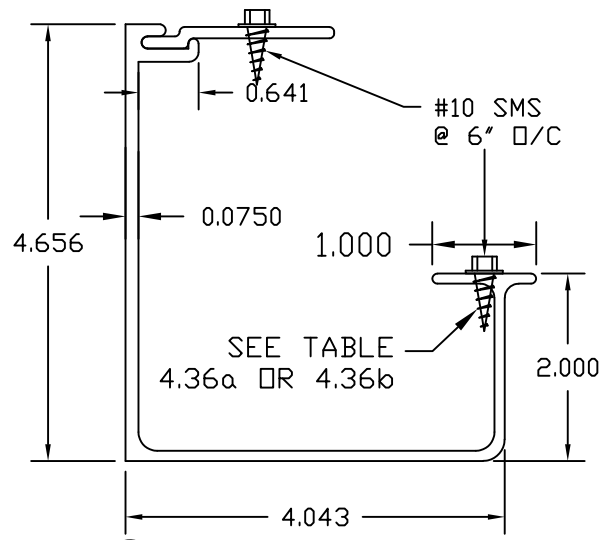

(G) CALIFORNIA FASCIA
 (6063-T6 ALUM. ALLOY)

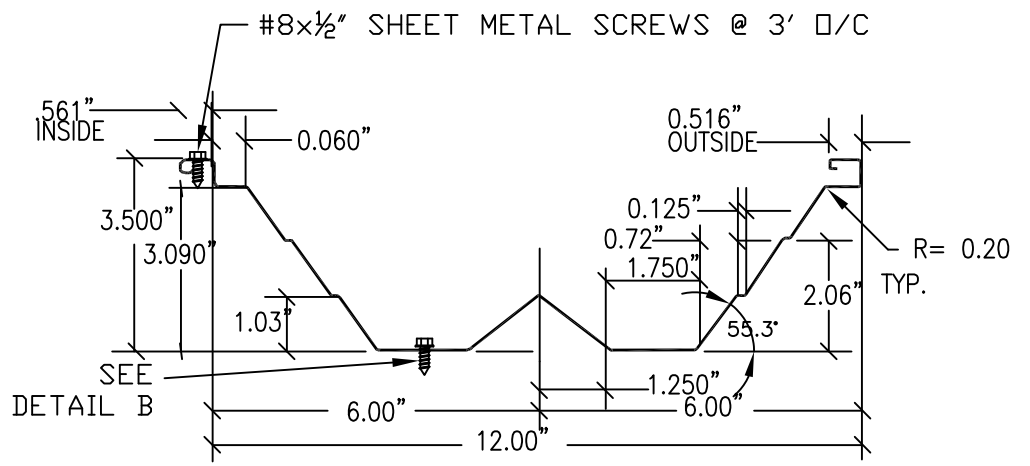


(D) 3.5"x12" "W" PANEL
 t = 0.018" 3004H36 ALUMINUM
 t > 0.018" 3004H34 ALUMINUM




MAY 03 2019

Amerimax EXTERIOR HOME PRODUCTS 28921 US Hwy 74 Romoland, CA 92585


DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE#: CD01-2018
	SHEET: 1 of 9

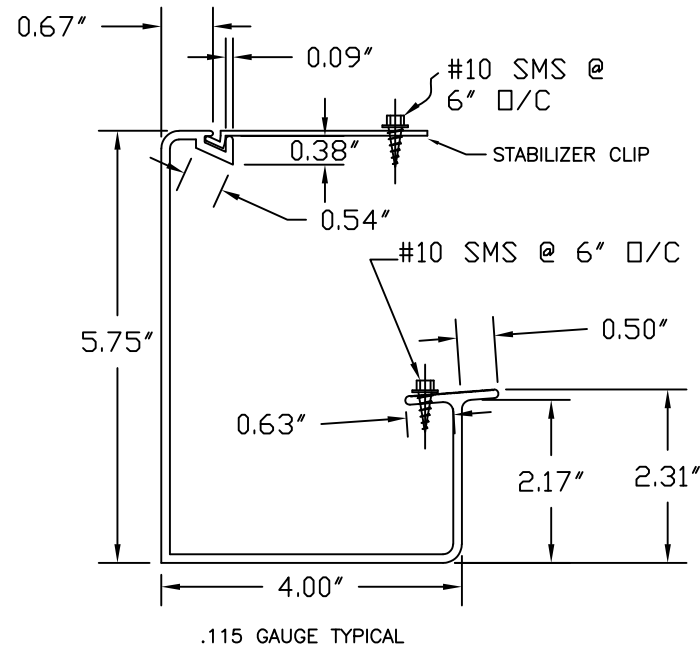

(H) CLASSIC FASCIA
W/ STABLIZER CLIP
(6061-T6 Alum. Alloy)

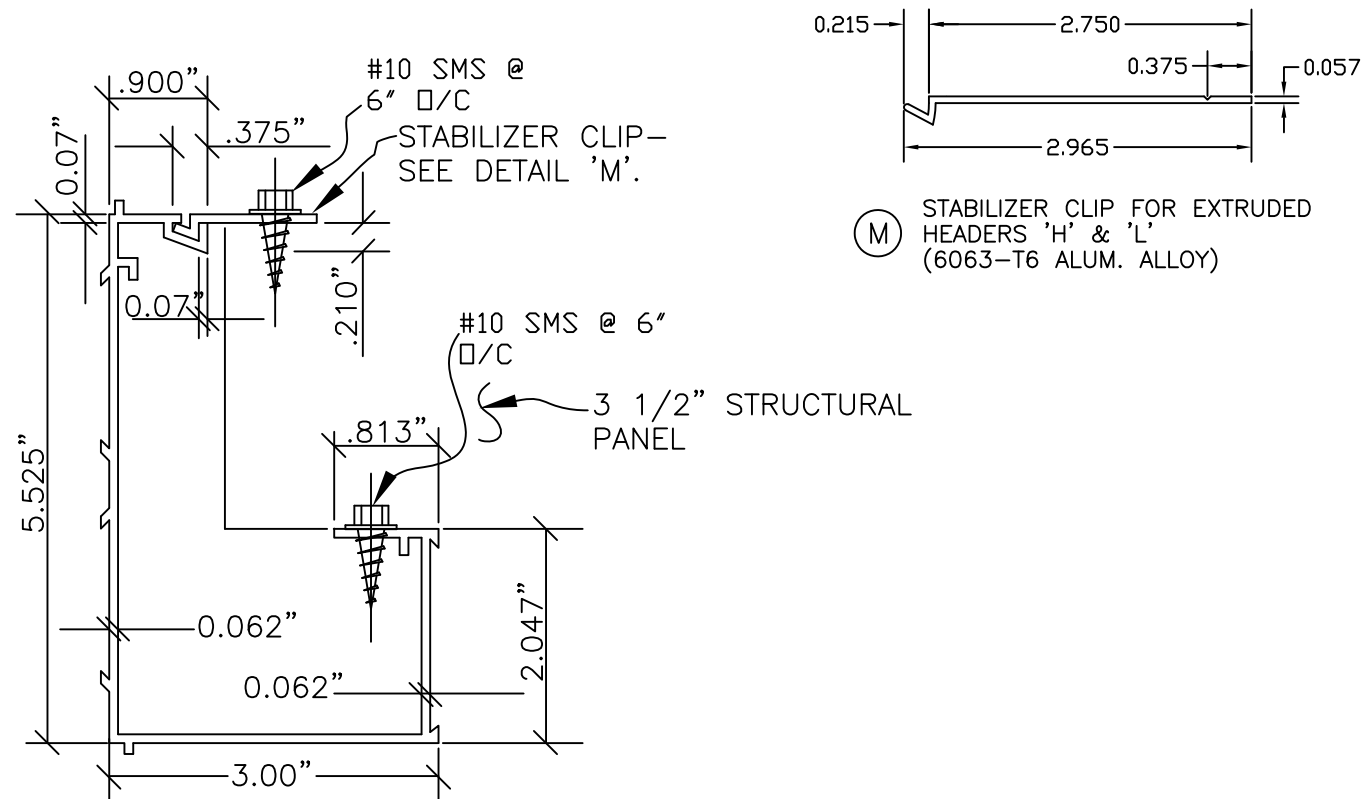


(L) 5 1/2" EXTRUDED HEADER
(6105-T5 ALUM. ALLOY)

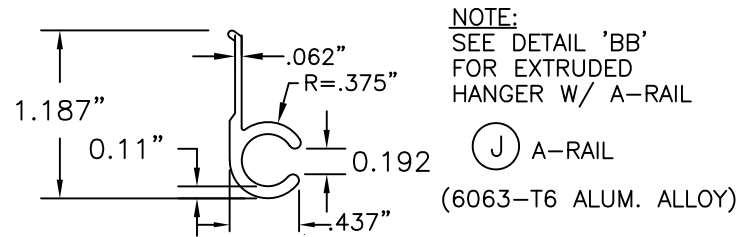

NOTE:
SEE DETAIL 'BB'
FOR EXTRUDED
HANGER W/ A-RAIL

(J) A-RAIL
(6063-T6 ALUM. ALLOY)

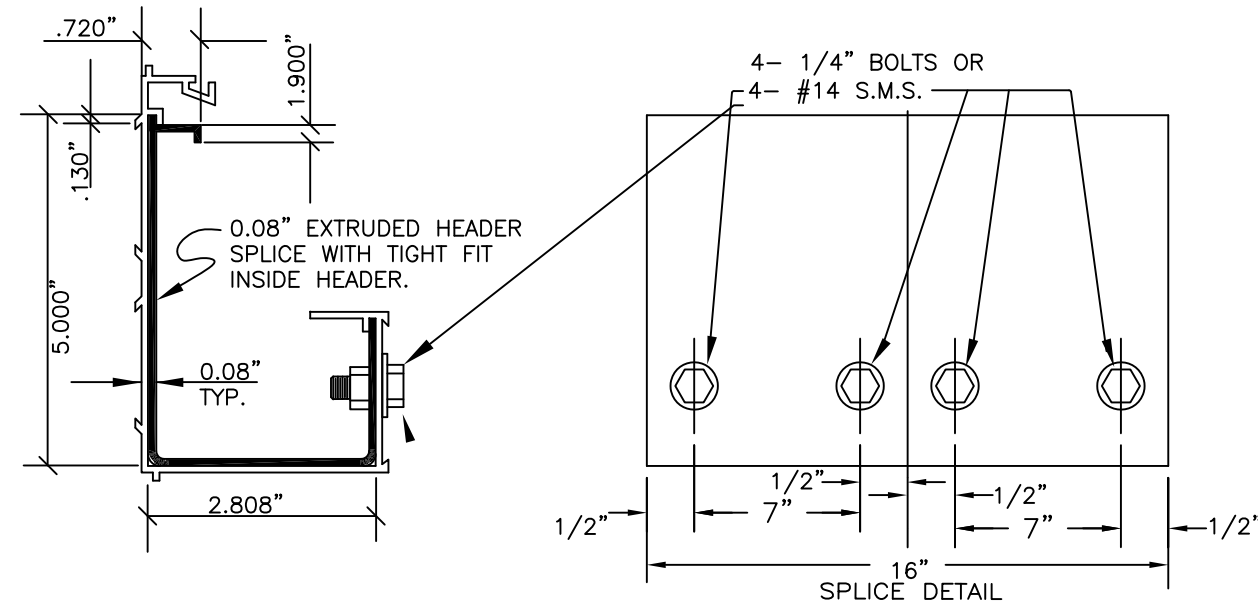


(N) 5 1/2" EXTRUDED HEADER SPLICE
6063T5 ALUMINUM ALLOY





MAY 03 2019

		28921 US Hwy 74 Romoland, CA 92585	
		DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details		
DATE:	FILE#: CD02-2018	SHEET: 2 of 9	

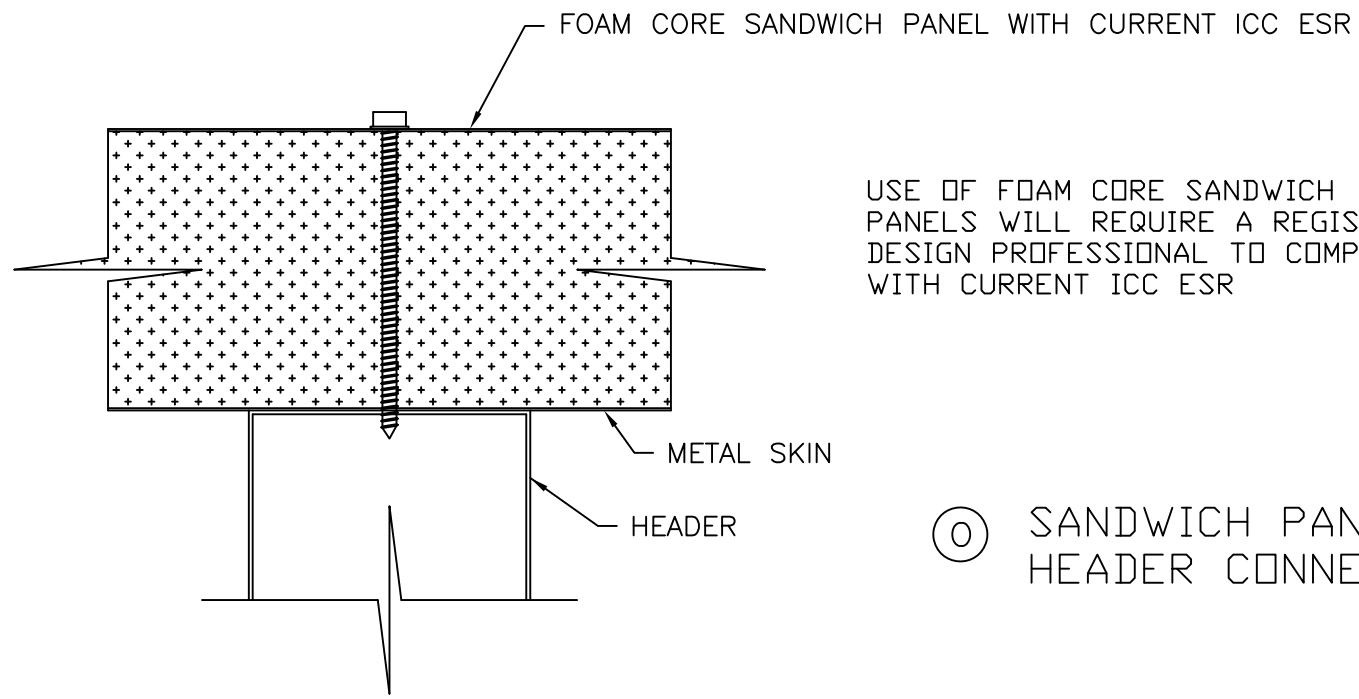


USE OF FOAM CORE SANDWICH PANELS WILL REQUIRE A REGISTERED DESIGN PROFESSIONAL TO COMPLY WITH CURRENT ICC ESR

Ⓞ SANDWICH PANEL TO HEADER CONNECTION

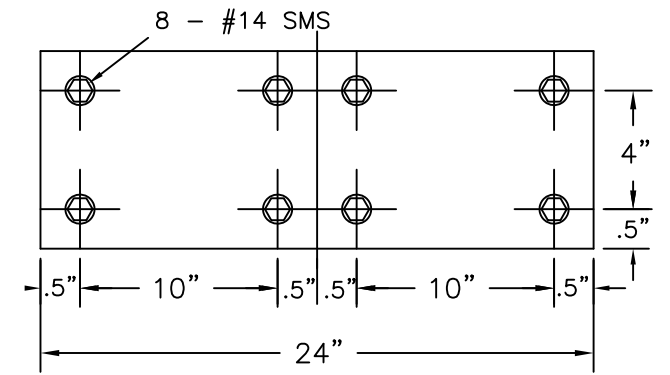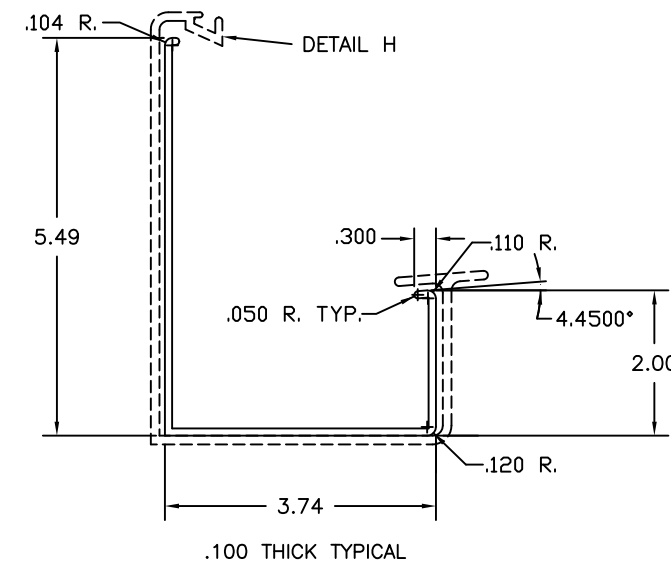


Ⓟ CLASSIC ALASKAN HEADER SPLICE (6063 T5 ALUM. ALLOY)

SEE TABLE 4.37a OR 4.37b

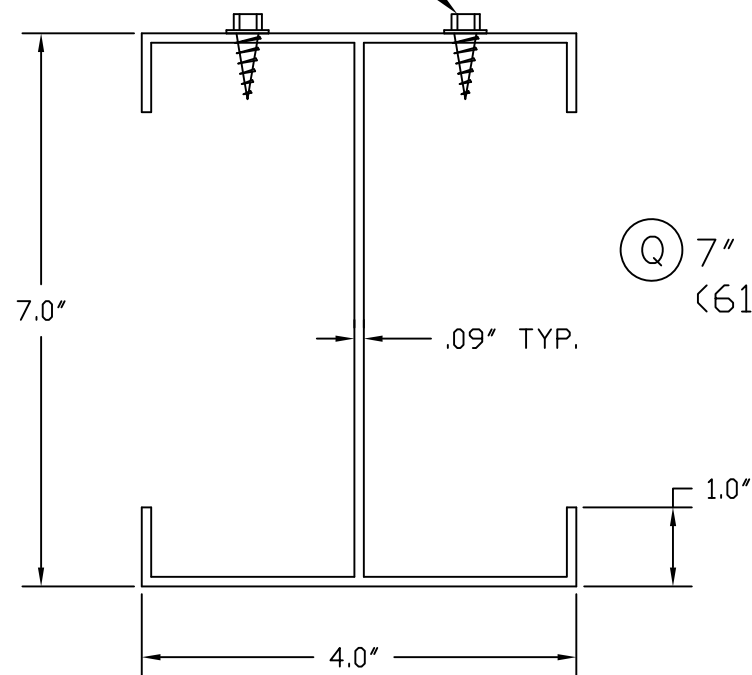

Ⓠ 7" x 4" I BEAM HEADER (6105-T5 ALUM. ALLOY)

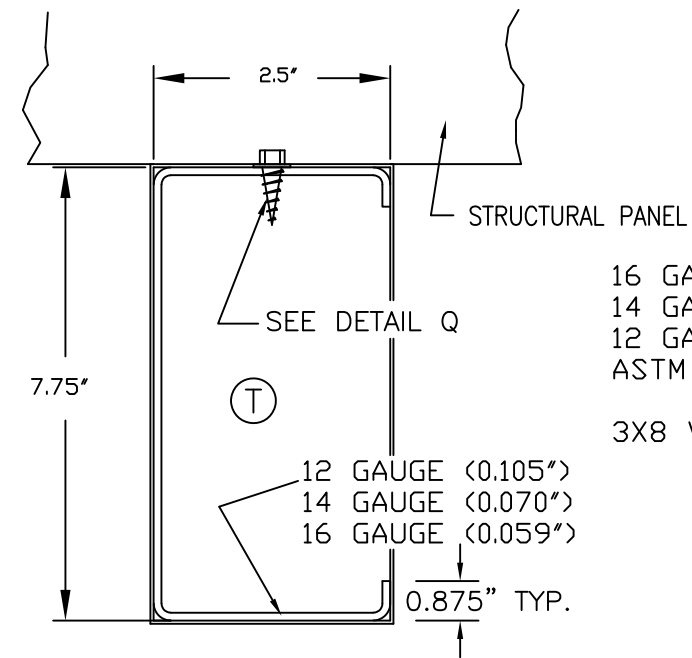


16 GA (t=0.059") 3"X8" STEEL HEADER
 14 GA (t=0.070") 3"X8" STEEL HEADER
 12 GA (t=0.105") 3"X8" STEEL HEADER
 ASTM A653 GRADE 50

3X8 WRAP REQUIRED AS PER DETAIL AW




Amerimax 28921 US Hwy 74 EXTERIOR HOME PRODUCTS Romoland, CA 92585	
DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE#: CD03-2018
	SHEET: 3 of 9

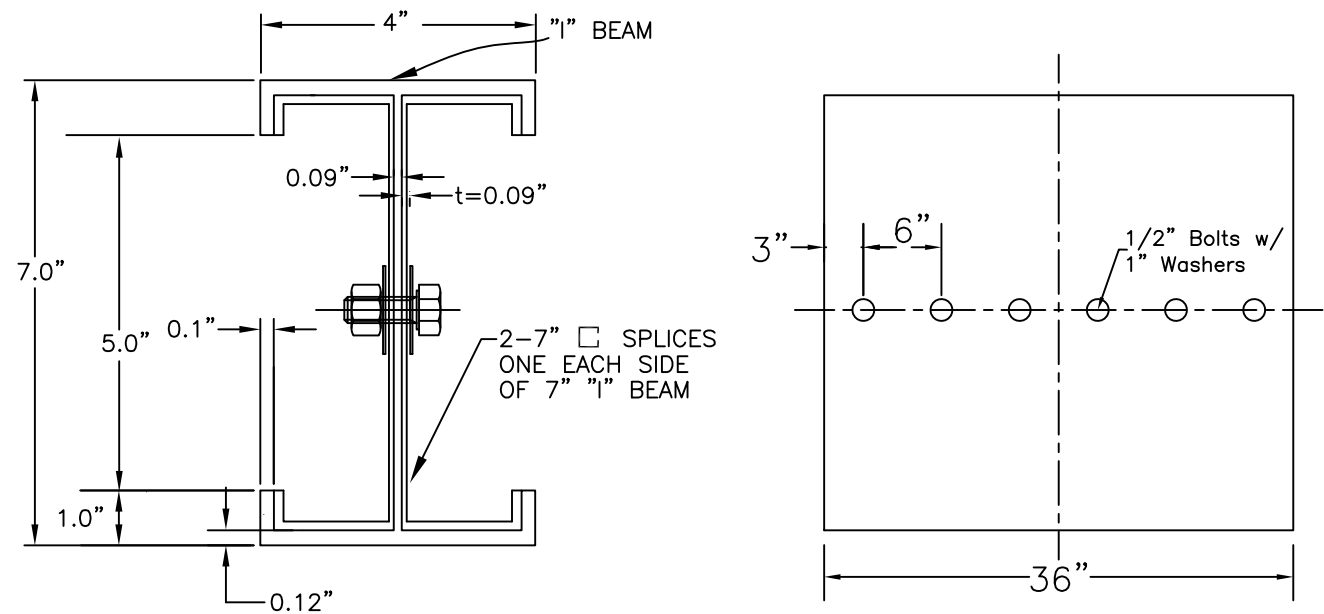


7" X 4" I-BEAM SPLICE
(6105-T5 ALUM. ALLOY)

U 7" X 4" ALUM. I-BEAM FULL STRENGTH SPLICE BOLT LAYOUT


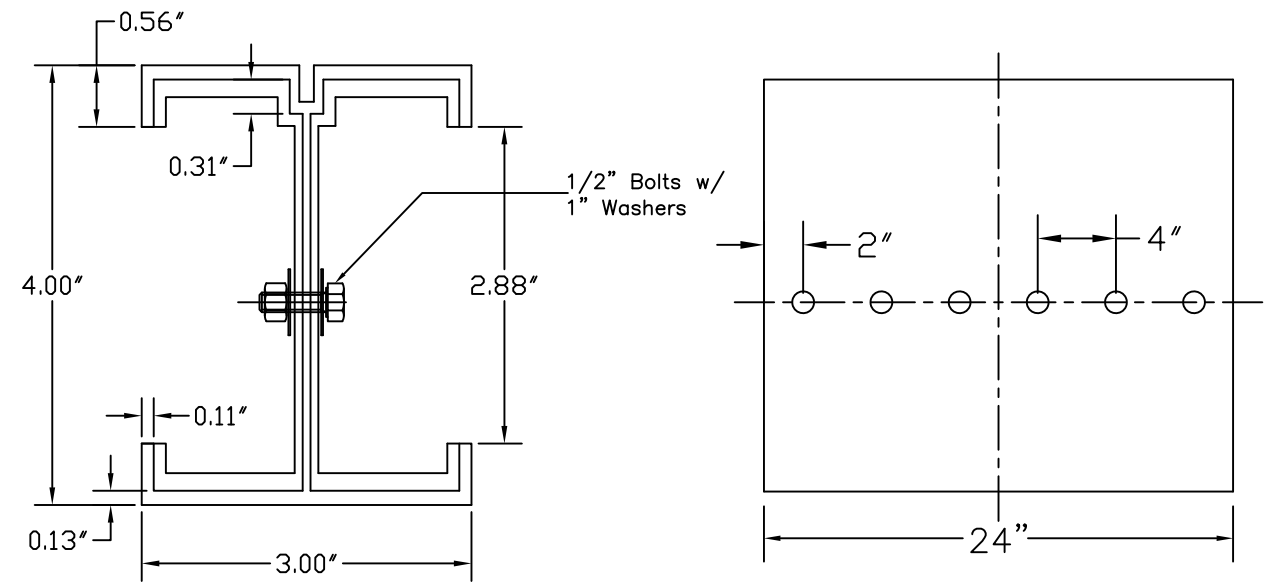


X 4"X3" I BEAM FULL STRENGTH
SPLICE BOLT LAYOUT
6063-T6 ALUMINUM ALLOY

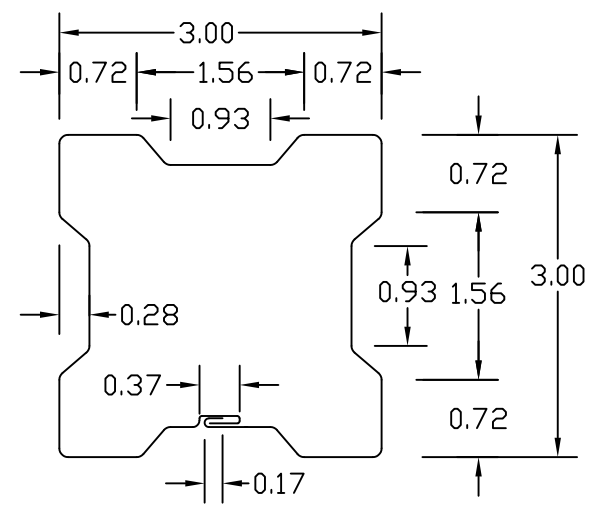


W 3"x3" CLOVERLEAF HEADER
(A-653 Fy=40 KSI STEEL)

Y 4"x3" I BEAM
6063-T6 ALUM

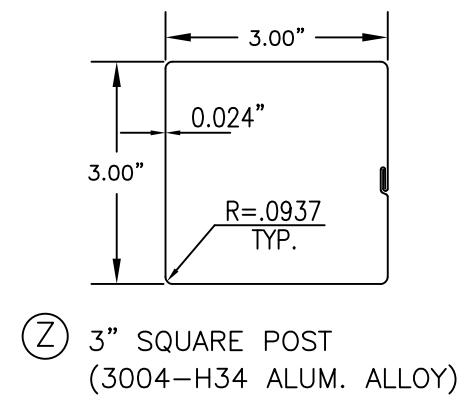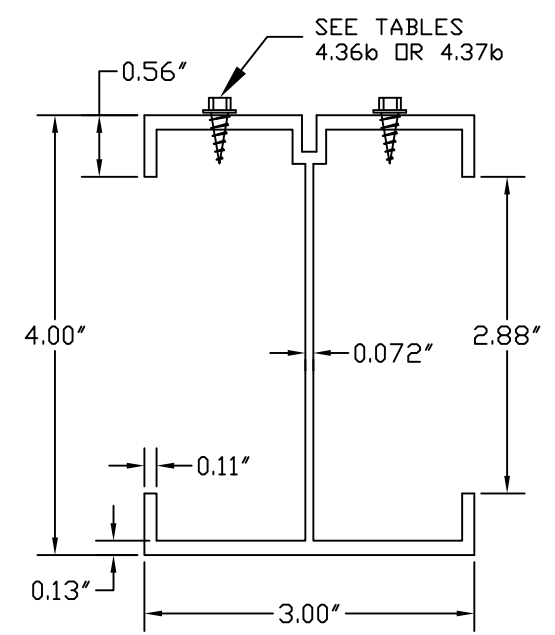

Z 3" SQUARE POST
(3004-H34 ALUM. ALLOY)

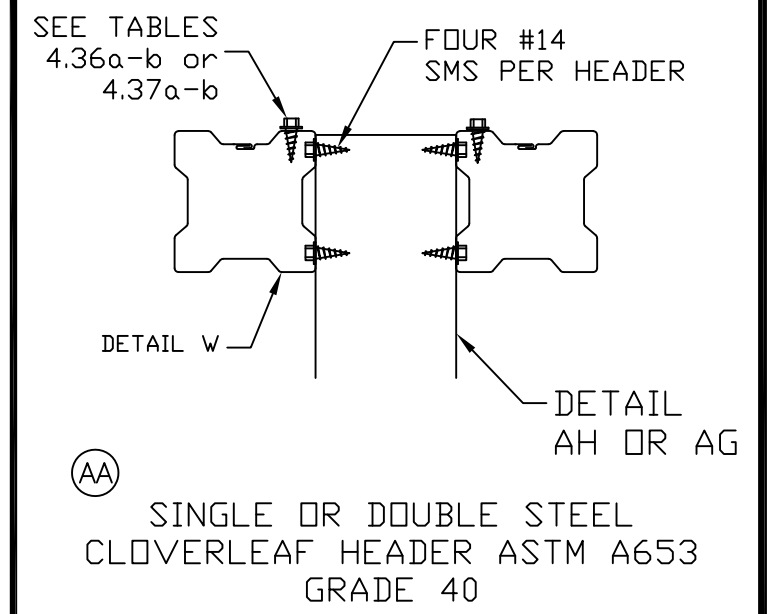


AA SINGLE OR DOUBLE STEEL
CLOVERLEAF HEADER ASTM A653
GRADE 40





Amerimax 28921 US Hwy 74
EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE#: CD04-2018
	SHEET: 4 of 9

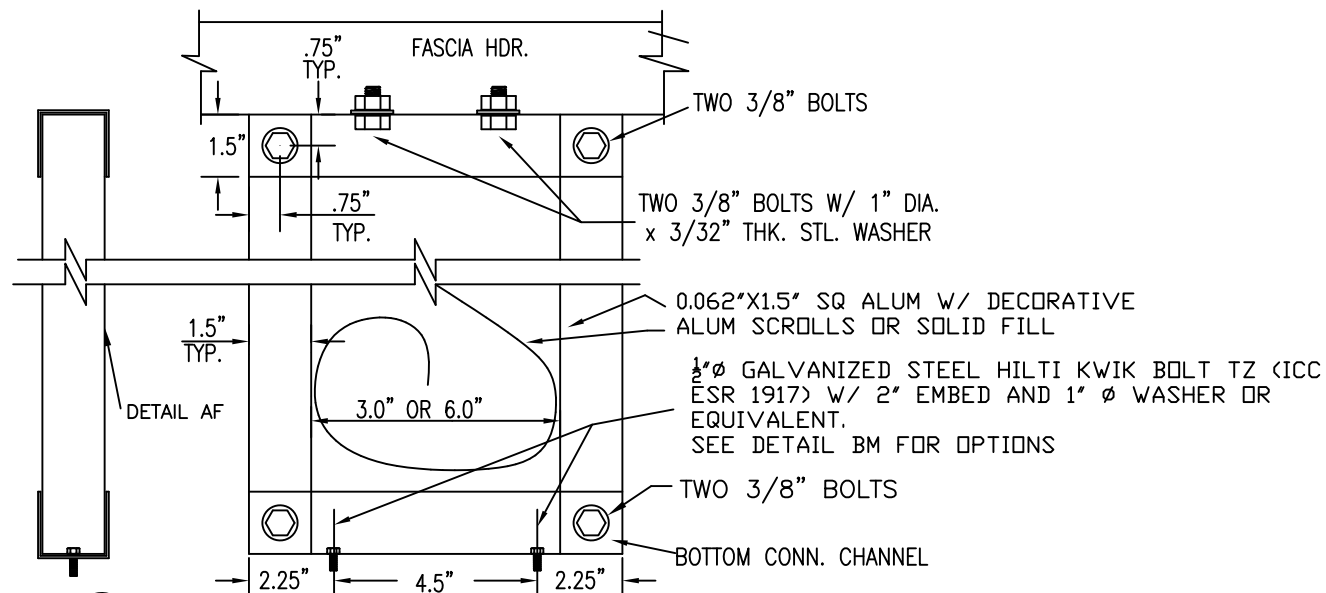


AC SCROLL POST CONNECTION TO CONCRETE SLAB OR FOOTING BRACKET = 6063 T6 ALUM ALLOY POST = DETAIL AF ONLY USABLE FOR SINGLE SPAN ATTACHED UNITS

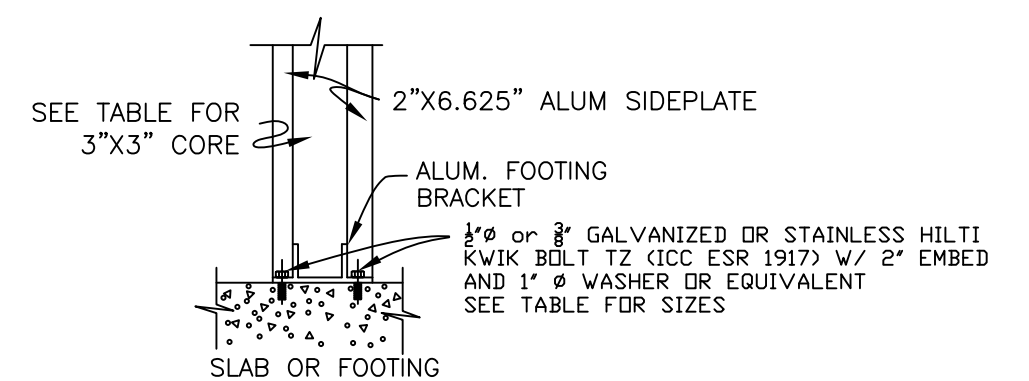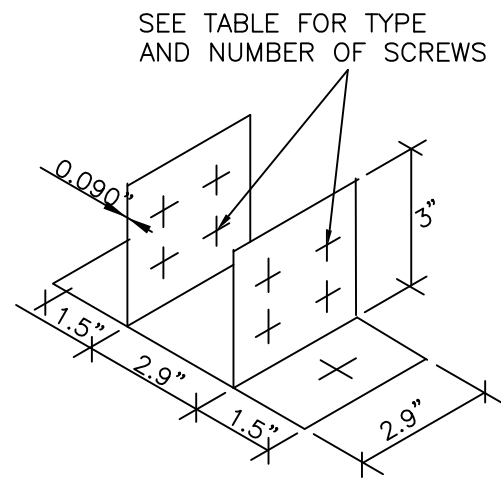


AD ALUMINUM FOOTING BRACKET FOR CONNECTING TO CONCRETE SLAB OR FOOTING 6063 T6 ALUM ALLOY ONLY USABLE FOR SINGLE SPAN ATTACHED UNITS


Footing d (in)	Number Of #14 SMS	3"x3" Post	Concrete Anchors	Maximum Wind Condition for "On Slab" Attachment
26	8	0.024" Alum	3/8"	110 mph Exp B
29	8	0.032" Alum	3/8"	105 mph Exp C / 130 mph Exp B
30	12	0.024" Alum	1/2"	115 mph Exp C
33	12	0.032" Alum	1/2"	130 mph Exp C
33	8	0.041" Steel	1/2"	150 mph Exp C

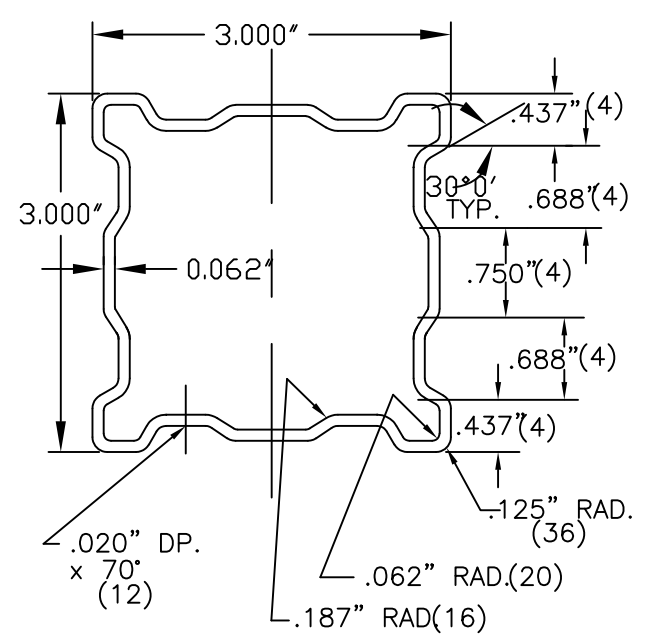


AE COLONIAL POSTS (3" ALUM. 6063-T6) "t" = 0.062" UNLESS OTHERWISE NOTED

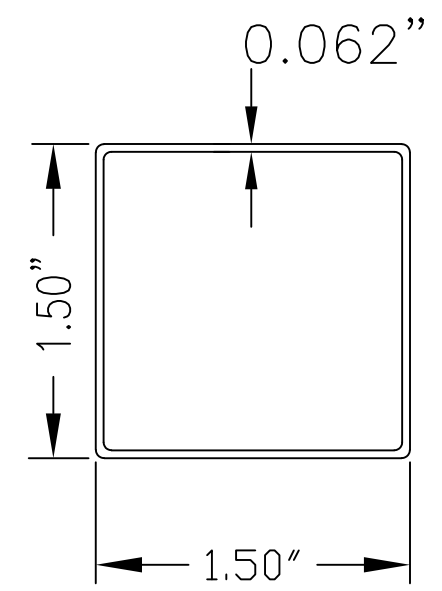

AF TWIN 1.5" SQ. X .062" EXTRUDED POST (ALUM. 6063-T6)

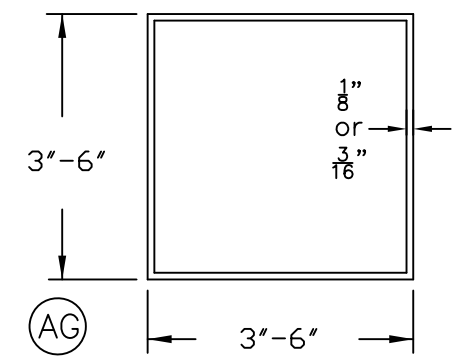

AG 3", 4", 5" or 6" ASTM A500 GRADE B STEEL POST SEE GENERAL NOTE #9 FOR CORROSION PROTECTION

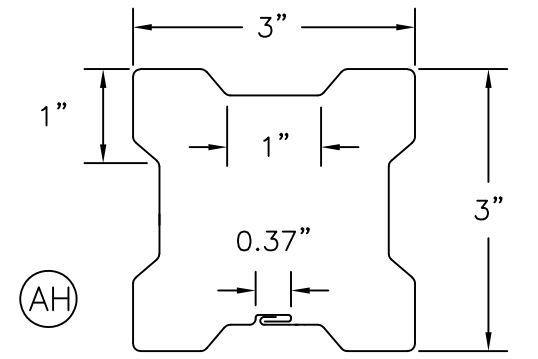


AH 3" CLOVERLEAF POST (3105 H25 ALUM OR ASTM A653 GRADE 40 STEEL) t (IN) = 0.030, 0.040 (ALUM) = 0.041 (STEEL)



Amerimax 28921 US Hwy 74 Romoland, CA 92585
EXTERIOR HOME PRODUCTS


DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE#: CD05-2018
	SHEET: 5 of 9

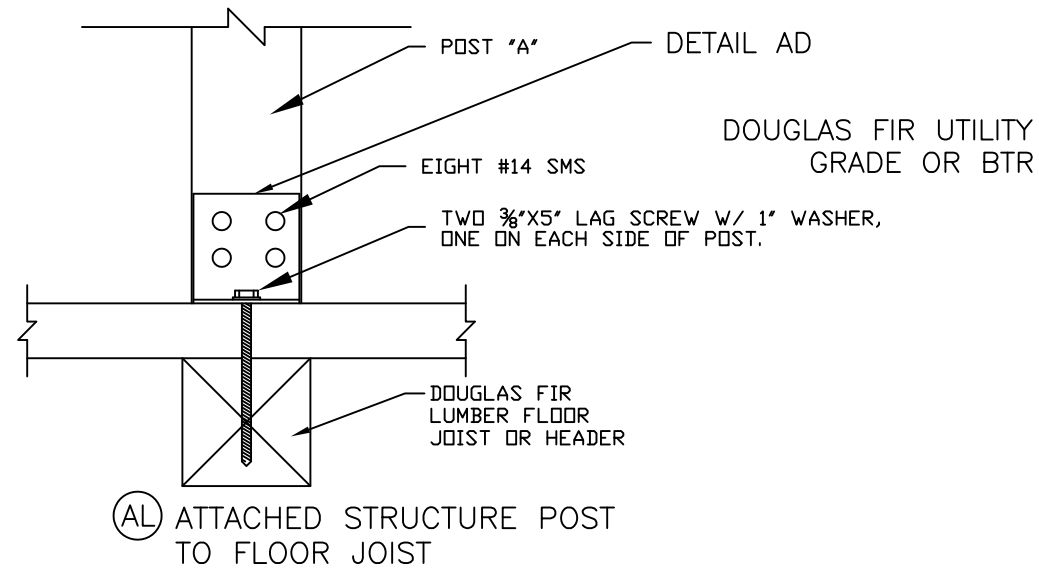

POST SPACING IS RESTRICTED TO THE "ON SLAB" SPACING SHOWN IN TABLES IN SECTION 5.0.

SOLID COVERS MUST USE THESE RESTRICTIONS
 FOR 10 PSF SNOW/LIVE LOAD
 MAXIMUM WINDSPEED IS
 130 MPH EXP B
 110 MPH EXP C

FOR 20 PSF OR GREATER SNOW/LIVE LOAD
 MAXIMUM WINDSPEED IS
 150 MPH EXP C

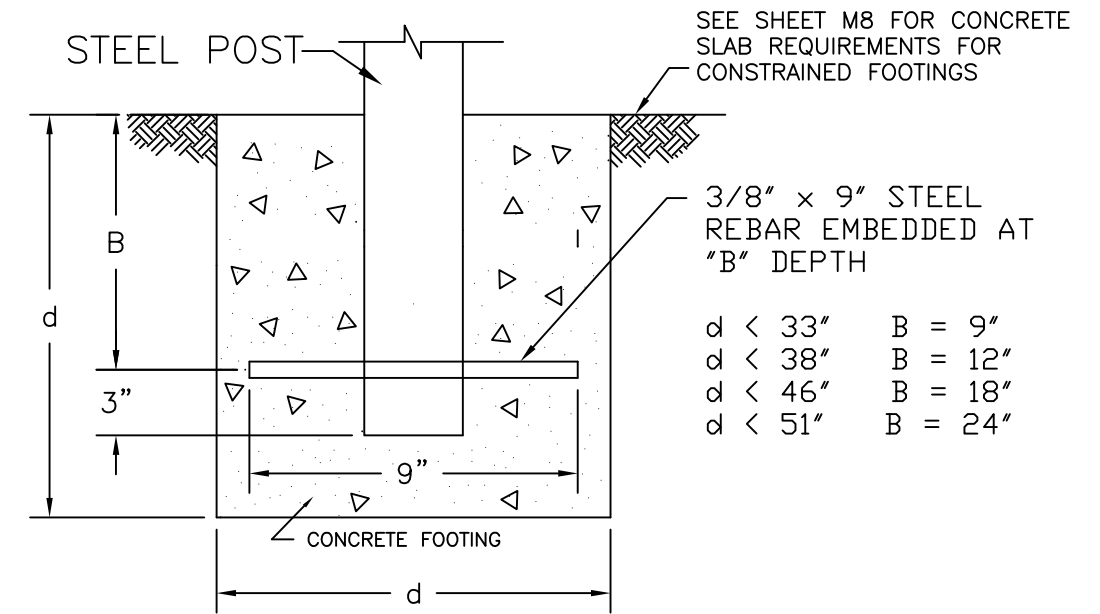


(AQ) FREESTANDING OR ATTACHED STRUCTURE COLUMN TO FOOTING CONNECTION DETAIL



Amerimax
 EXTERIOR HOME PRODUCTS 28921 US Hwy 74
 Romoland, CA 92585


DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE#: CD06-2018
	SHEET: 6 of 9

3/8" BOLTS W/ 1.0" DIA. x 3/32" THK. STL. WASHER OR #14 SDS. SEE NOTE FOR QTY (4 FASTENERS MAX).

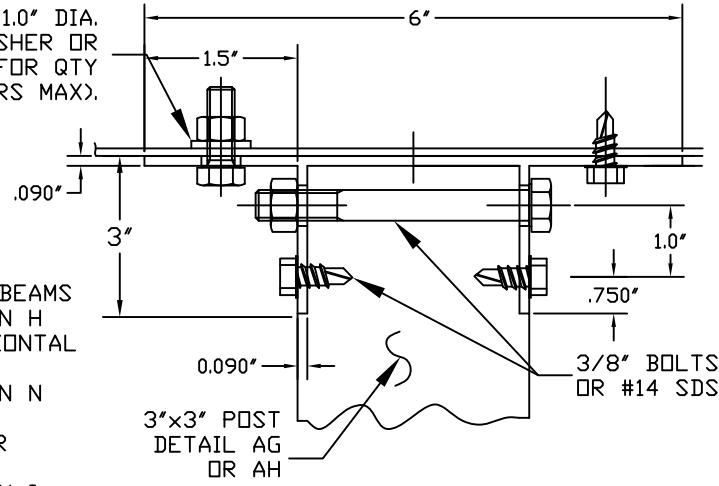


ALL "I" BEAMS & "C" BEAMS USE TABLE 7.3 COLUMN H FOR NUMBER OF HORIZONTAL BOLTS
 USE TABLE 7.4 COLUMN N FOR VERTICAL BOLTS
 USE 7.3 COLUMN I FOR HORIZONTAL #14 SDS
 USE TABLE 7.4 COLUMN I FOR VERTICAL #14 SDS (SDS= SELF DRILLING SCREW)


(AR) ALTERNATE 3" SQ. POST CONNECTOR BRACKET (6063-T6 ALUM. ALLOY)

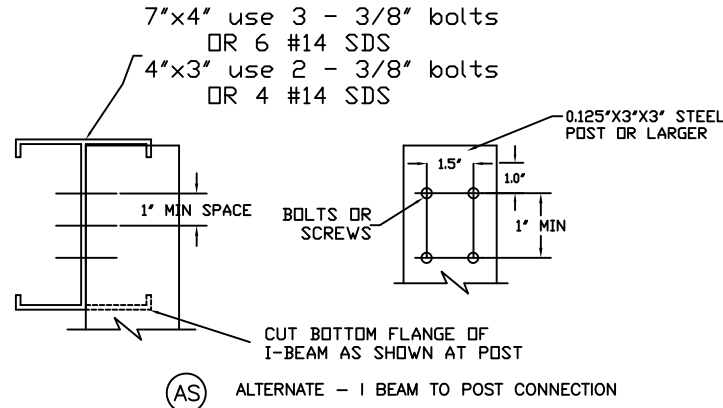


(AS) ALTERNATE - I BEAM TO POST CONNECTION

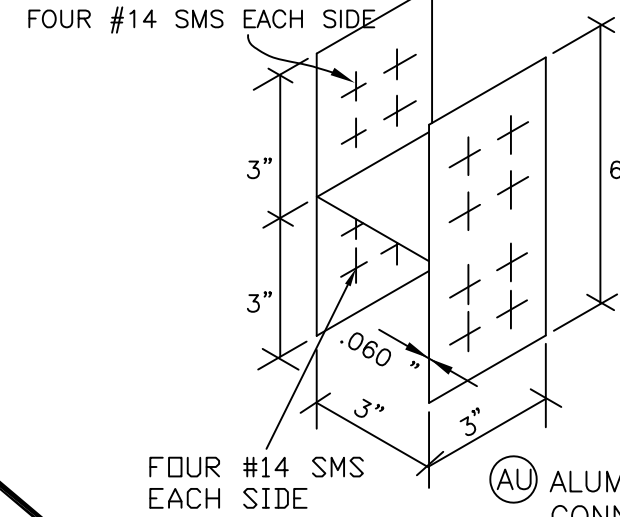


(AU) ALUMINUM 'H' BRACKET FOR CONNECTING COLUMN TO HEADER (6063-T5 ALUM. ALLOY)

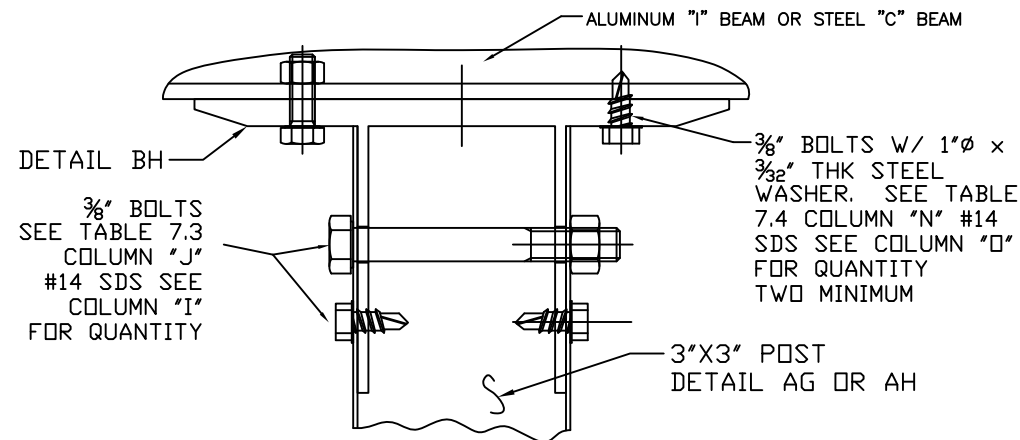

(AT) 3" STEEL POST TO HEADER CONN. BRACKET

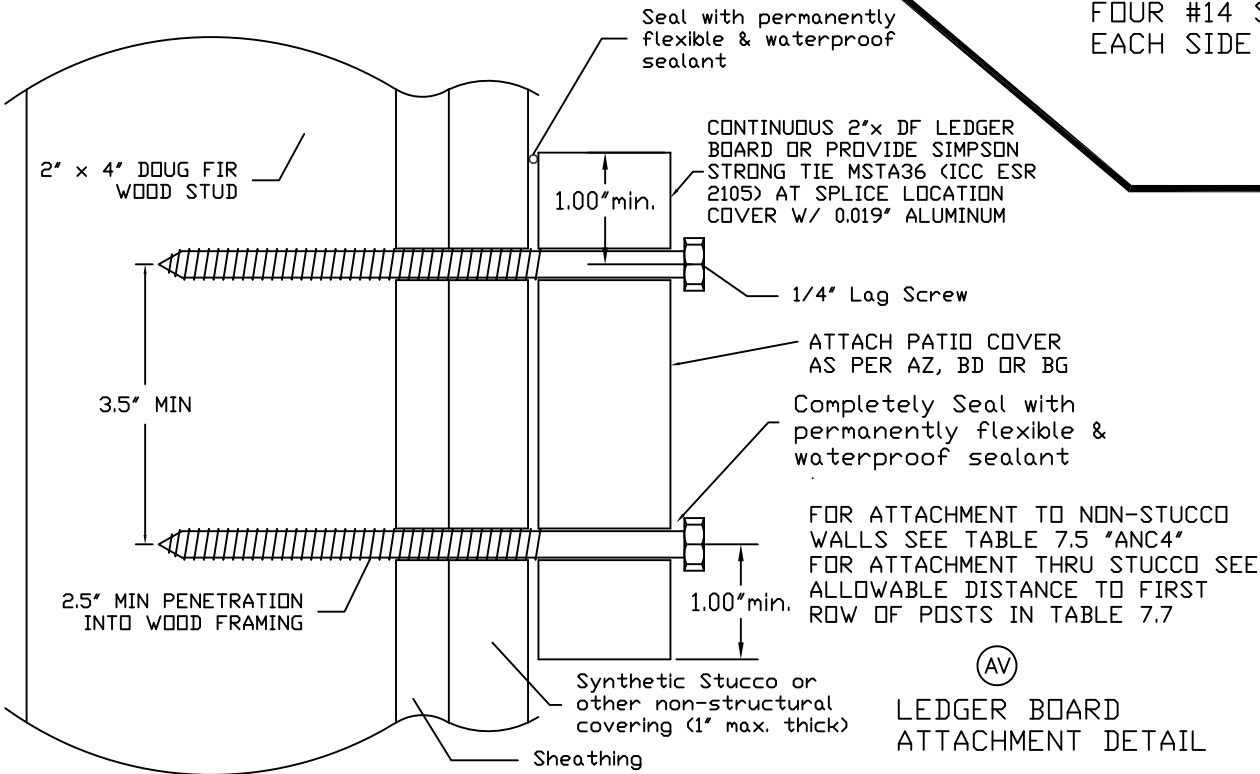


(AV) LEDGER BOARD ATTACHMENT DETAIL

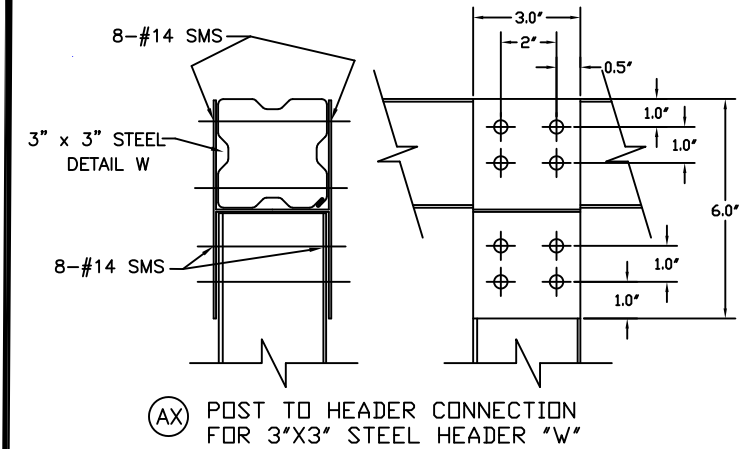

(AX) POST TO HEADER CONNECTION FOR 3"x3" STEEL HEADER "W"


3"x8" STEEL C BEAM W/ 0.042"x3"x8" ALUM WRAP

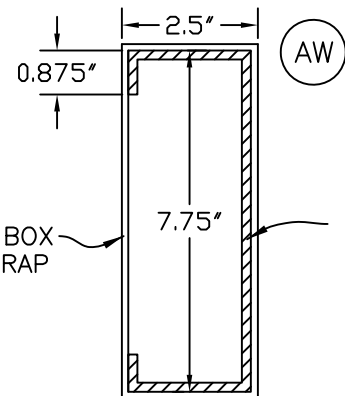

3"x8" 12 GA (t=0.105") 14 GA (t=0.070") OR 16 GA (t=0.059") STEEL C BEAM


3"x 8" BOX BEAM WRAP

1/4" BOLTS ASTM A307 OR #14 SELF DRILLING SCREWS (SDS) SEE TABLE FOR QTY

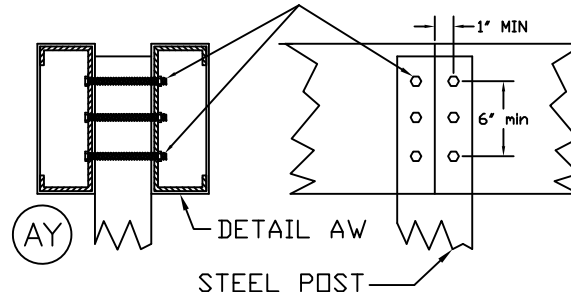

(AY) DOUBLE OR SINGLE 3"x8" STEEL C BEAM. BOLT LAYOUT FOR SPLICED AND NON-SPLICE ATTACHMENT


Beam Type	Ground Snow Load	Required # of 1/4" Bolts (# of 14 Self Drilling Screws)				
		115 mph Exp C	105 mph Exp B	170 mph Exp C	130 mph Exp C	105 mph Exp B
All C Beams "On Slab"	60 psf	20 psf (Live)	20 psf (Live)	10 psf (Live)	10 psf (Live)	10 psf (Live)
16G and 14G Steel 3x8	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)
12G Steel 3x8	6 (8)	6 (8)	6 (8)	6 (8)	6 (8)	6 (8)
Double 16G Steel 3x8	4 (12)	4 (10)	4 (10)	4 (10)	4 (10)	4 (10)
Double 14G Steel 3x8	5 (14)	5 (12)	5 (12)	5 (12)	5 (12)	4 (10)
Double 12G Steel 3x8	7 (18)	6 (16)	6 (14)	6 (16)	6 (14)	(5) 14

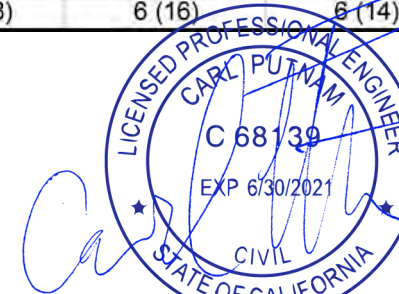


MAY 03 2019

Amerimax 28921 US Hwy 74 Romoland, CA 92585
 EXTERIOR HOME PRODUCTS


DRAWN BY: BEJ/CP TYPE:
 SCALE: NTS NAME: Component Parts & Connection Details
 DATE: FILE#: CD07-2018 SHEET: 7 of 9

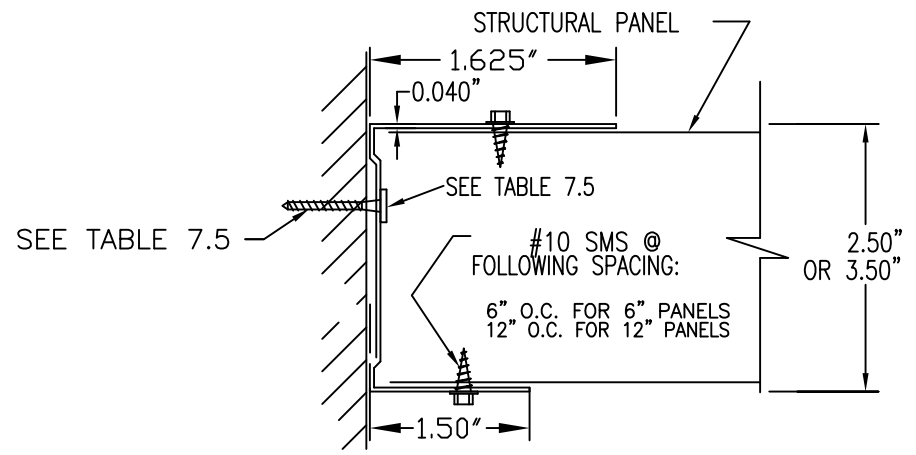


(AZ) ROLLFORMED HANGER
(3004-H34 ALUM. ALLOY)

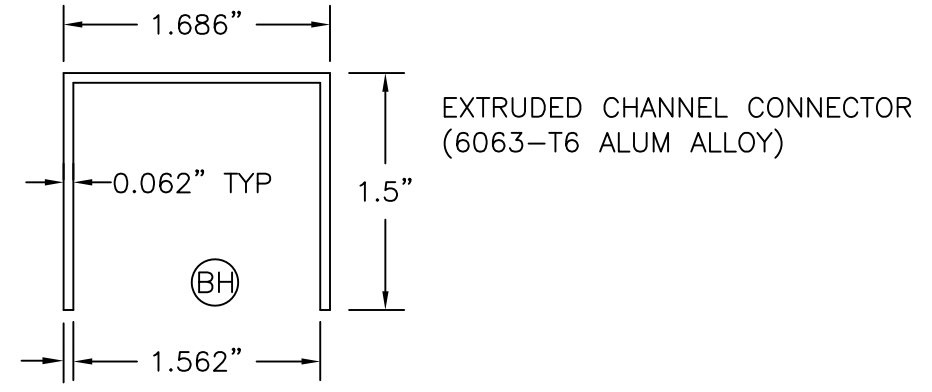


EXTRUDED CHANNEL CONNECTOR
(6063-T6 ALUM. ALLOY)

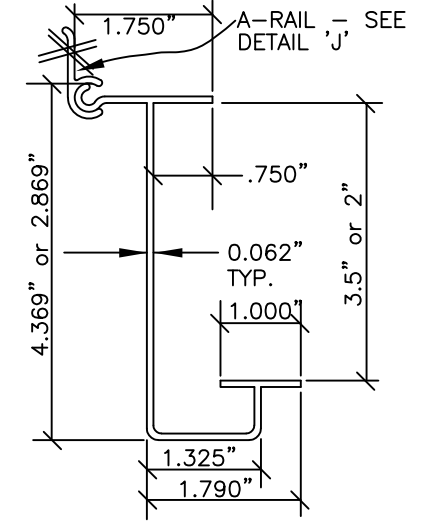


(BB) 3 1/2" "J" HANGER
(6063-T6 ALUM. ALLOY)

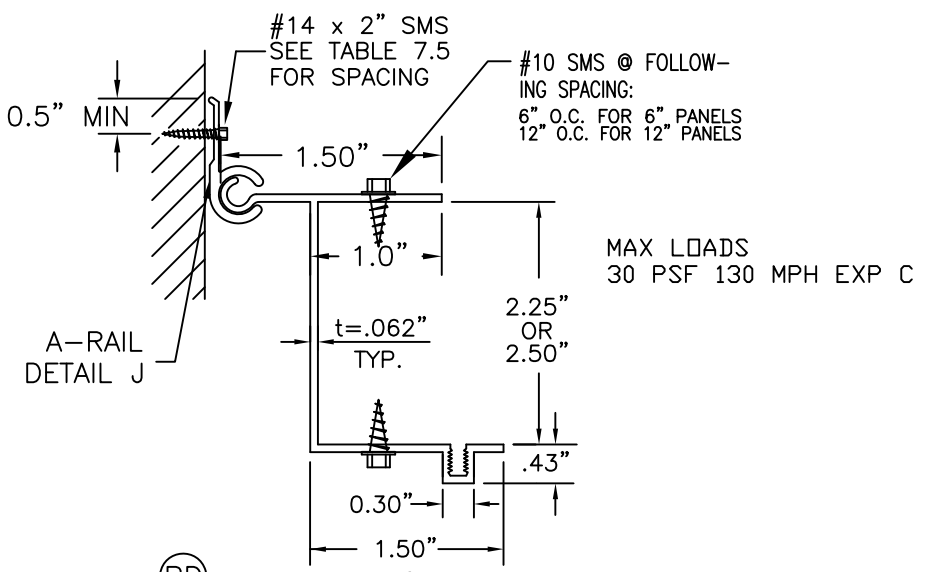


(BD) EXTRUDED HANGER
(6063-T6 ALUM. ALLOY)

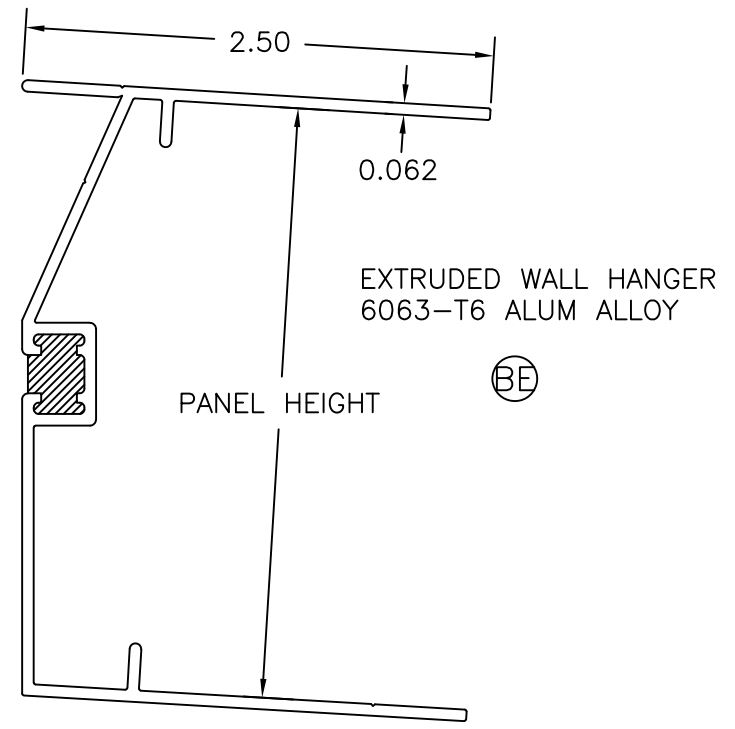


EXTRUDED WALL HANGER
6063-T6 ALUM. ALLOY

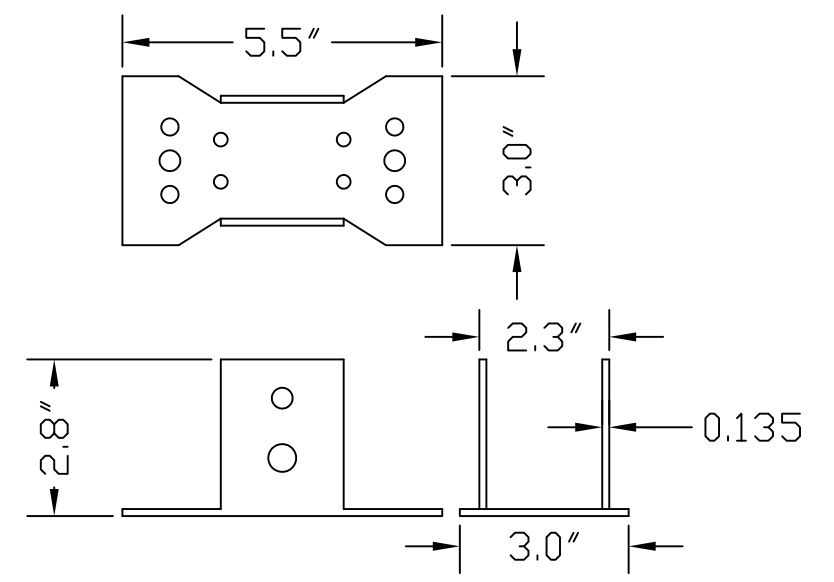

(BH) ASTM A36 STEEL BRACKET

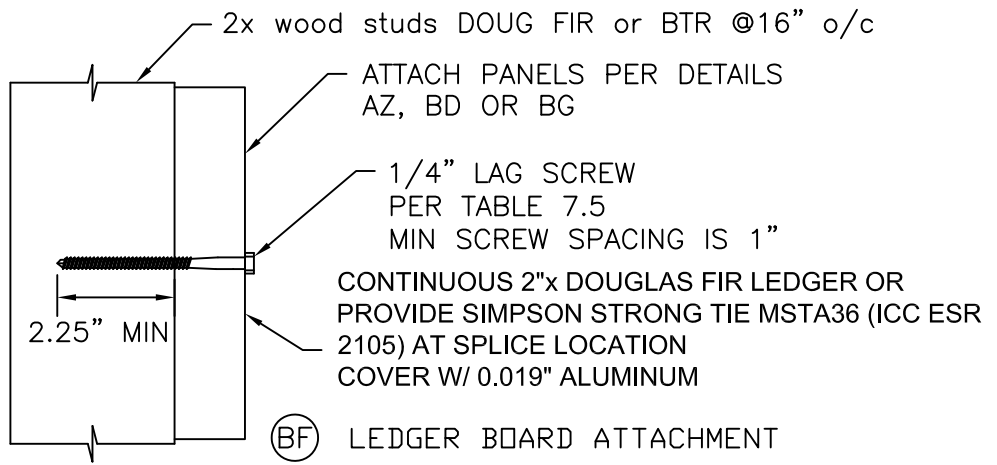

(BF) LEDGER BOARD ATTACHMENT

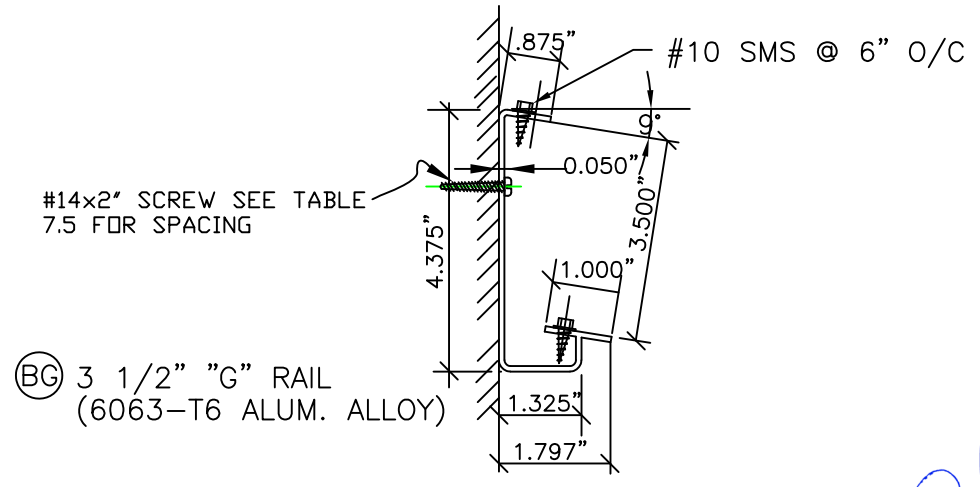


(BG) 3 1/2" "G" RAIL
(6063-T6 ALUM. ALLOY)



Amerimax 28921 US Hwy 74
EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE#: CD08-2018
	SHEET: 8 of 9

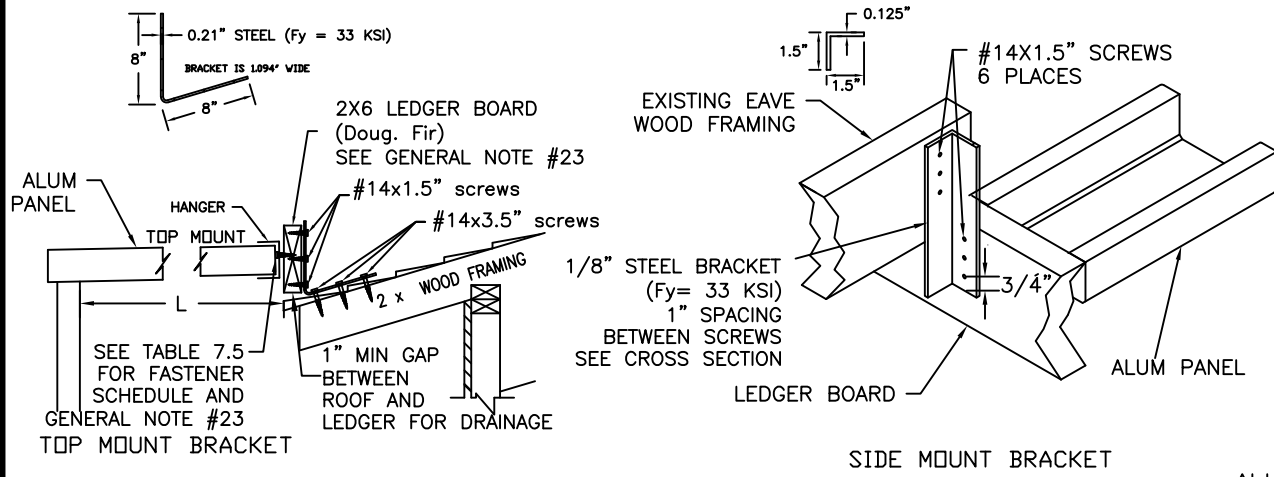


EAVE OVERHANG AND "L" MUST COMPLY WITH DETAIL BN ALSO


(BI) ALTERNATE EAVE ATTACHMENTS

ALL HOUSE PENETRATIONS MUST BE COMPLETELY AND PERMANENTLY SEALED NOT ALLOWED IN SNOW LOAD AREAS SEE GENERAL NOTE #9 FOR CORROSION PROTECTION


Live Load (psf)	Wind Speed and Exposure	MAX "L" FOR TOP OR SIDE MOUNT	
		16" o/c	24" o/c
10	115 mph Exp B	15'-2"	10'-1"
	130 mph Exp B	13'-7"	9'-1"
	100 mph Exp C	15'-2"	10'-1"
	110 mph Exp C	14'-7"	9'-8"
	115 mph Exp C	13'-10"	9'-3"
20	130 mph Exp C	12'-2"	8'-2"
	115 mph Exp B	10'-3"	6'-9"
	100 mph Exp C	10'-3"	6'-9"
	110 mph Exp C	10'-0"	6'-8"
	115 mph Exp C	9'-8"	6'-6"
130 mph Exp C	8'-9"	5'-10"	

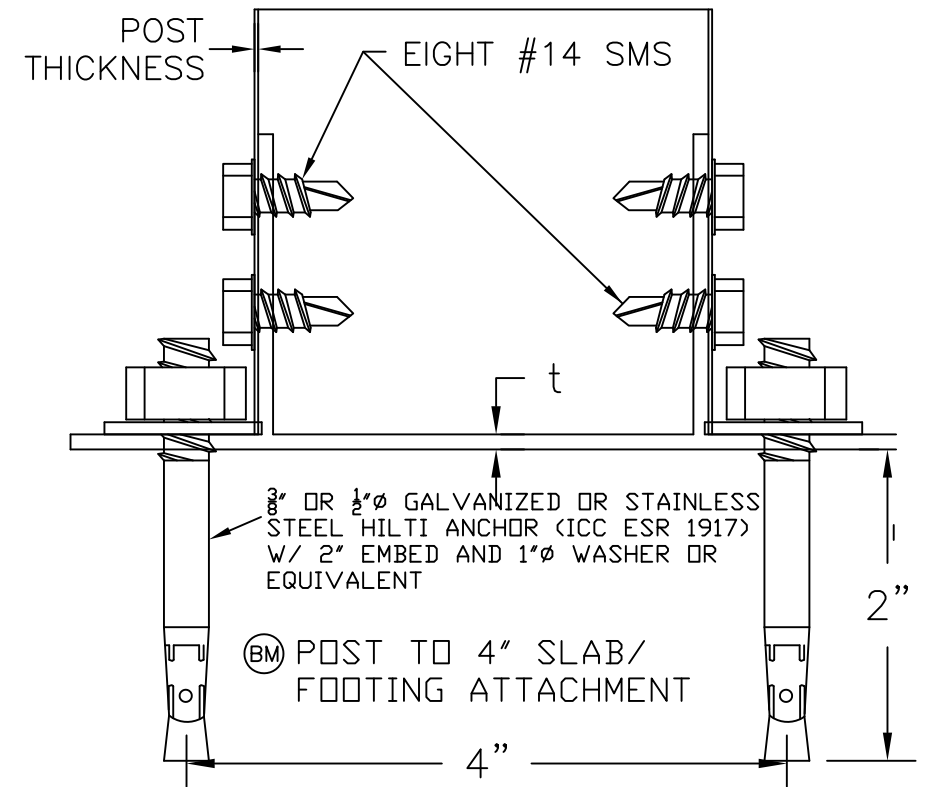

6063T6 ALUMINUM BRACKET OR ASTM A36 STEEL
t = 0.090" >> SLAB ATTACH FOR 130 EXP B/115 MPH EXP C
t = 0.090" >> FOOTING d = 31" MAX
t = 0.140" >> FOOTING d = 35" MAX WITH DETAIL AH STEEL POST
t = 0.140" >> SLAB ATTACH FOR 140 EXP C

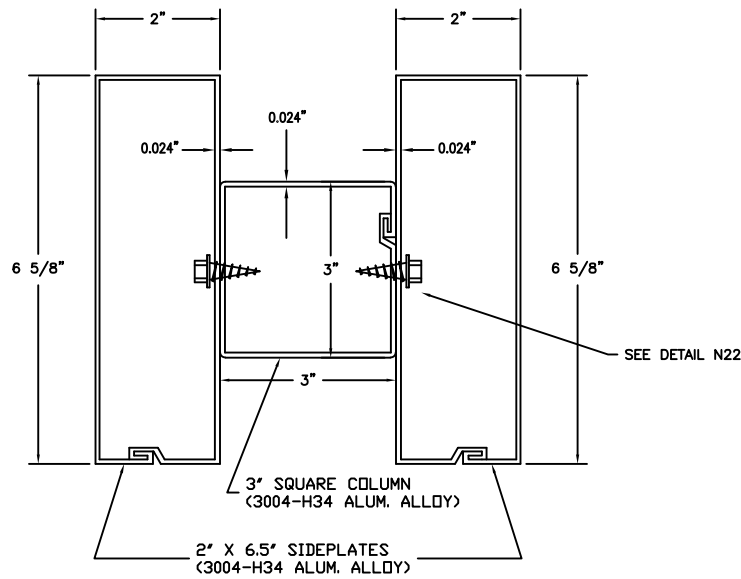


Live/Snow Load Solid Cover Wind (psf)	RAFTER SIZE (24" O/C)	MAX DISTANCE TO FIRST ROW OF POSTS "L"					# of #14 Screws
		EAVE OVERHANG					
		6"	12"	18"	24"	30"	
10	2x4	21'-0"	20'-5"	11'-6"	6'-4"	2'-10"	2
	2x6	21'-0"	21'-0"	21'-0"	21'-0"	16'-3"	
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"	
115 MPH EXP B	2x4	21'-0"	20'-3"	11'-5"	6'-4"	2'-9"	2
	2x6	21'-0"	21'-0"	21'-0"	21'-0"	16'-2"	
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"	
10	2x4	21'-0"	17'-8"	9'-11"	5'-6"	2'-5"	3
	2x6	21'-0"	21'-0"	21'-0"	20'-1"	14'-1"	
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"	
130 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
20	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
110 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
20	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
115 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
20	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
130 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
25	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
110 MPH EXP C	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
25	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
130 MPH EXP C	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
30	2x4	15'-0"	9'-2"	5'-1"	2'-9"	1'-0"	4
	2x6	15'-0"	15'-0"	15'-0"	10'-5"	7'-2"	
	2x8	15'-0"	15'-0"	15'-0"	15'-0"	14'-9"	
130 MPH EXP C	2x4	15'-0"	7'-7"	4'-0"	1'-11"	0'-6"	4
	2x6	15'-0"	15'-0"	12'-8"	8'-5"	5'-7"	
	2x8	15'-0"	15'-0"	15'-0"	15'-0"	12'-0"	
35.7	2x4	15'-0"	7'-7"	4'-0"	1'-11"	0'-6"	4
	2x6	15'-0"	15'-0"	12'-8"	8'-5"	5'-7"	
	2x8	15'-0"	15'-0"	15'-0"	15'-0"	12'-0"	
130 MPH EXP C	2x4	14'-0"	6'-3"	3'-2"	1'-4"	0'-0"	4
	2x6	14'-0"	14'-0"	10'-6"	6'-10"	4'-5"	
	2x8	14'-0"	14'-0"	14'-0"	13'-8"	9'-10"	
42	2x4	14'-0"	6'-3"	3'-2"	1'-4"	0'-0"	4
	2x6	14'-0"	14'-0"	10'-6"	6'-10"	4'-5"	
	2x8	14'-0"	14'-0"	14'-0"	13'-8"	9'-10"	
130 MPH EXP C	2x4	14'-0"	6'-3"	3'-2"	1'-4"	0'-0"	4
	2x6	14'-0"	14'-0"	10'-6"	6'-10"	4'-5"	
	2x8	14'-0"	14'-0"	14'-0"	13'-8"	9'-10"	
50	2x4	12'-0"	5'-1"	2'-5"	0'-10"	0'-0"	4
	2x6	13'-0"	13'-0"	8'-7"	5'-5"	3'-3"	
	2x8	13'-0"	13'-0"	13'-0"	11'-1"	7'-10"	
130 MPH EXP C	2x4	12'-0"	5'-1"	2'-5"	0'-10"	0'-0"	4
	2x6	12'-0"	11'-9"	6'-11"	4'-2"	2'-4"	
	2x8	12'-0"	12'-0"	12'-0"	8'-11"	6'-1"	

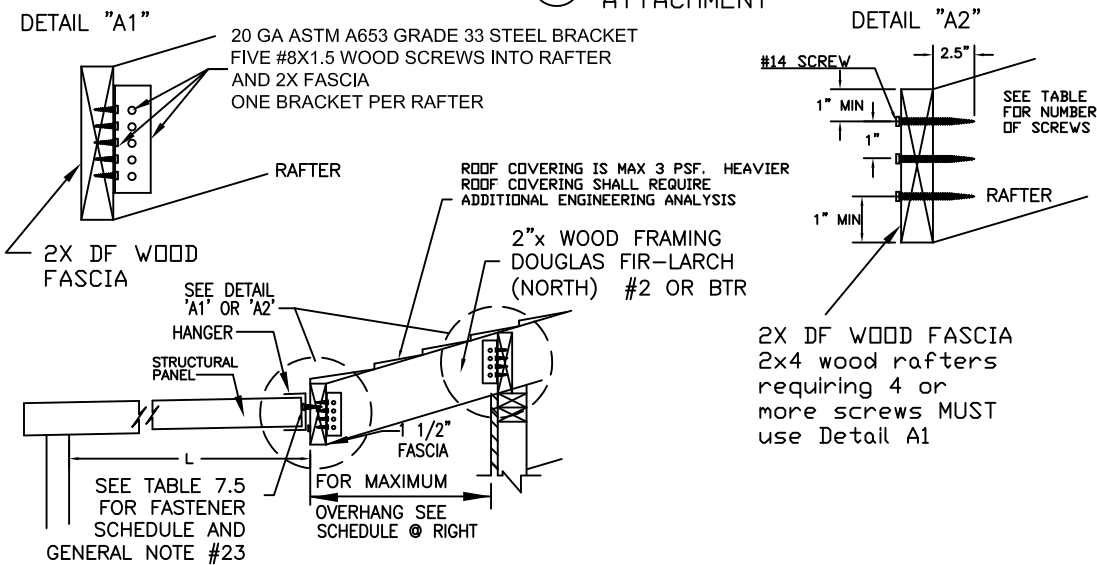


Amerimax 28921 US Hwy 74 Romoland, CA 92585
EXTERIOR HOME PRODUCTS



DRAWN BY: BEJ/CP TYPE:
SCALE: NTS NAME: Component Parts & Connection Details
DATE: FILE#: CD09-2018 SHEET: 9 of 9

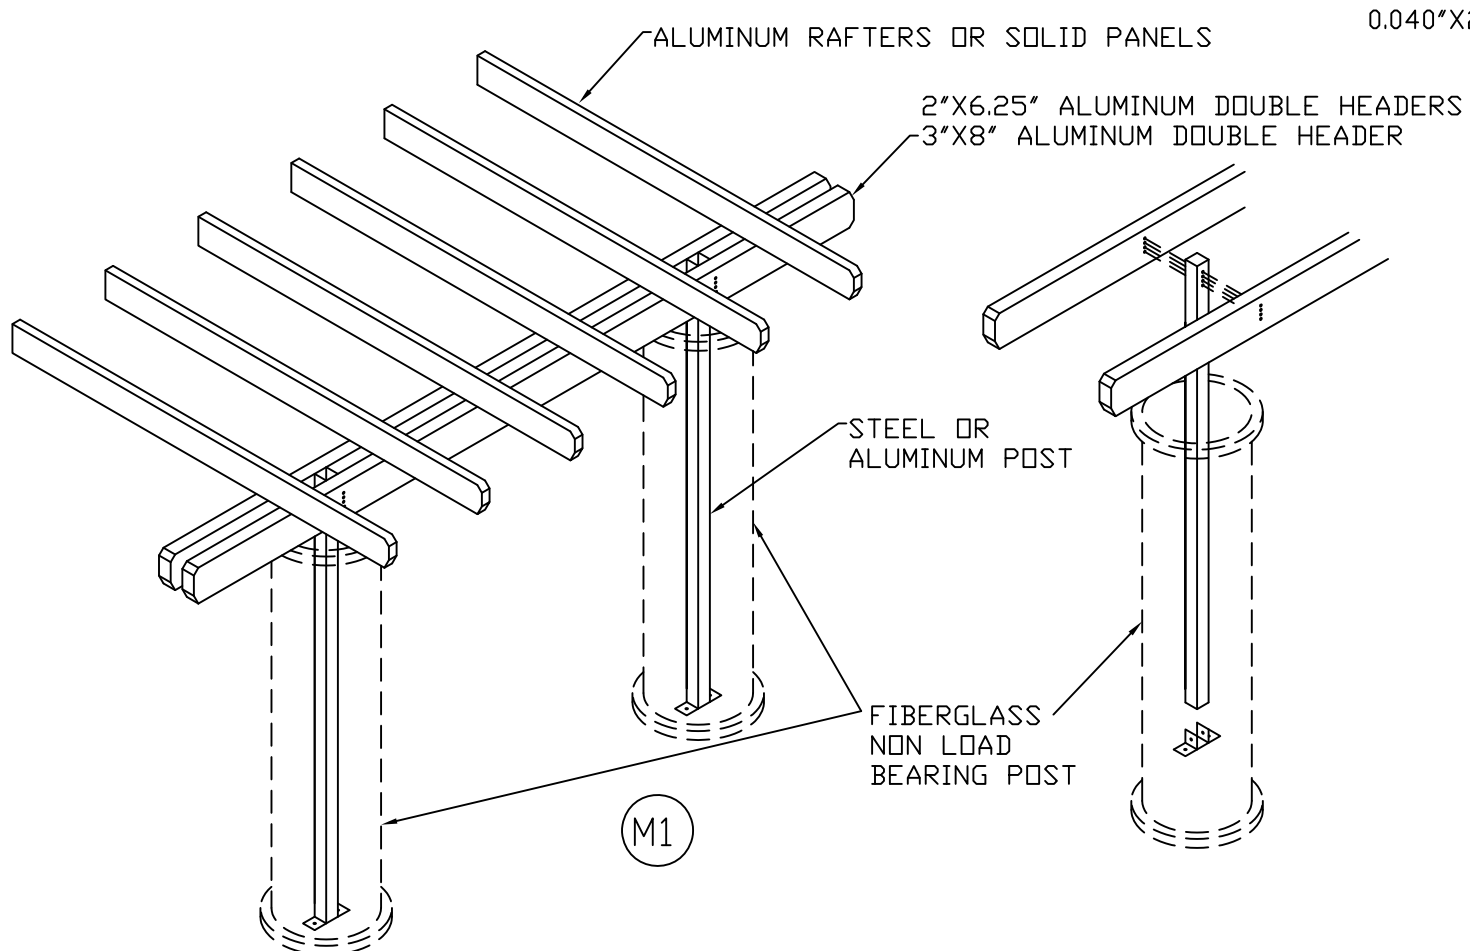

0.040\"/>

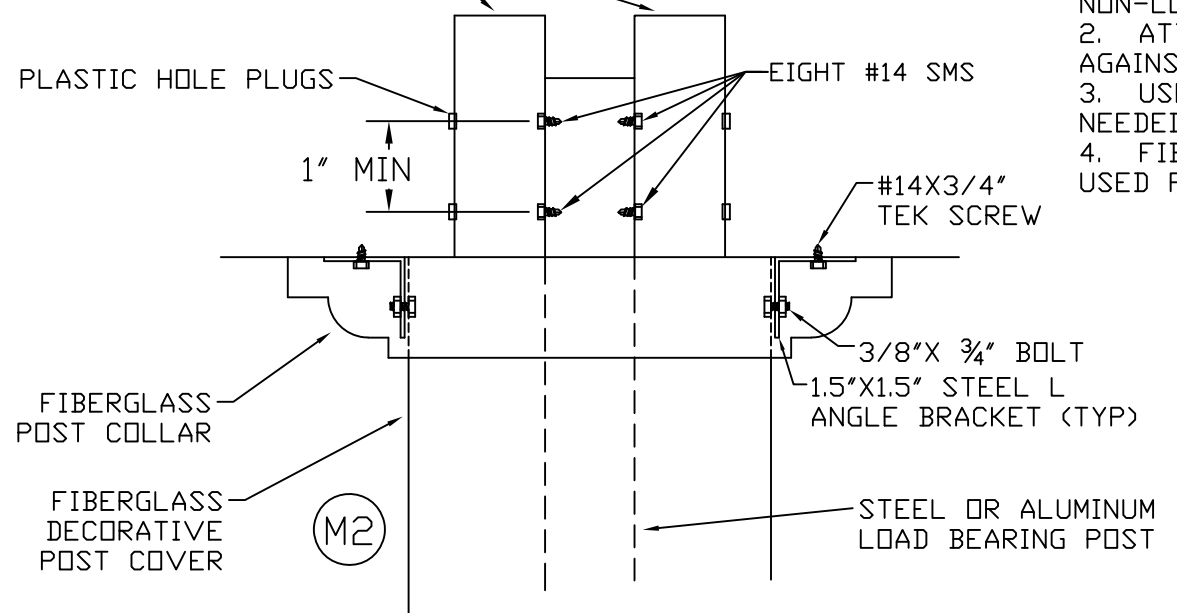

- NOTES:
1. FIBERGLASS POSTS ARE NON-LOAD BEARING.
 2. ATTACHMENT TO HOLD COVERING AGAINST MINOR LATERAL FORCES.
 3. USE MULTIPLE BRACKETS AS NEEDED.
 4. FIBERGLASS POSTS MAY BE USED FOR ANY STRUCTURE.

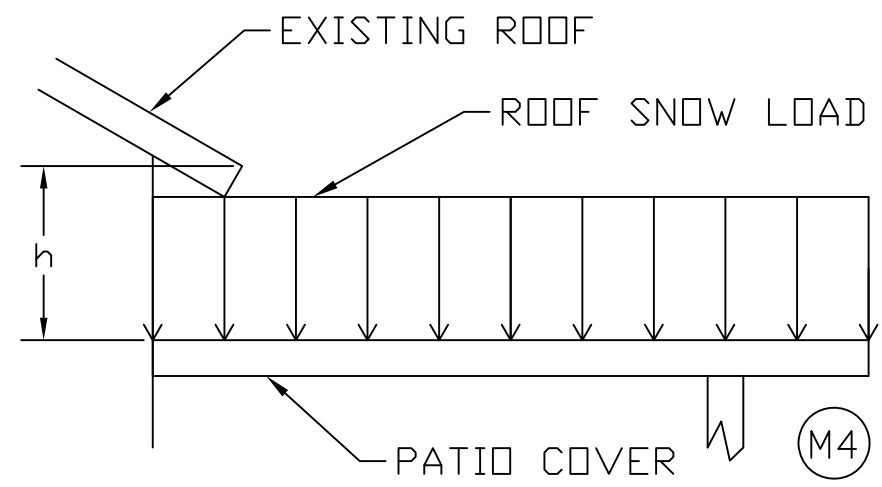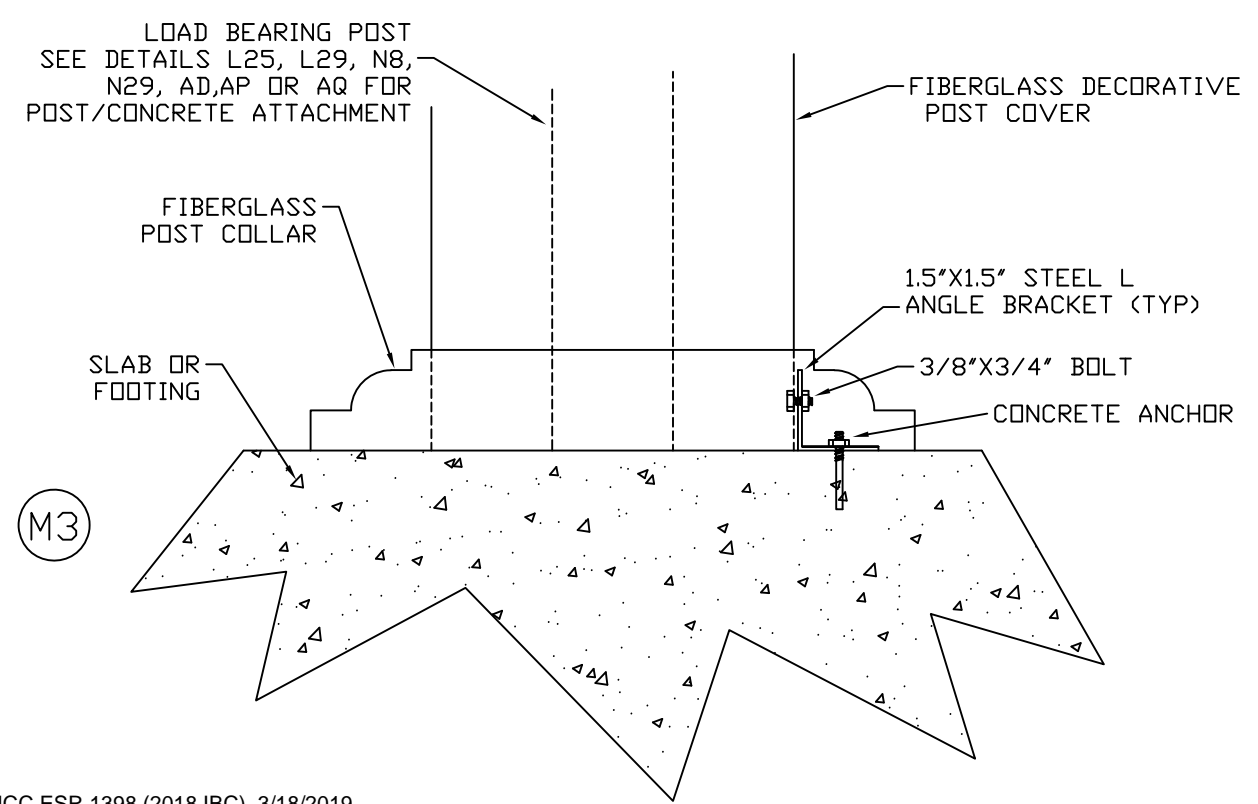


STRUCTURES COMPLYING WITH THIS DETAIL DO NOT REQUIRE ADDITIONAL DRIFTING SNOW CONSIDERATIONS

GROUND SNOW LOAD (PSF)	MAXIMUM "h" (IN)
10	9
15	14
20	17
25	18
30	20
36	23
42	26
50	30
60	33

LICENSED PROFESSIONAL ENGINEER
 CARL PUTNAM
 C 68139
 EXP 6/30/2021
 CIVIL
 STATE OF CALIFORNIA
 MAY 03 2019
 Engineer's Stamp

Amerimax™ 28921 US Hwy 74 Romoland, CA 92585
 EXTERIOR HOME PRODUCTS

DRAWN BY: CP	TYPE:
SCALE: NTS	NAME: Miscellaneous Details
DATE:	FILE#: Misc1a-2018
SHEET:	

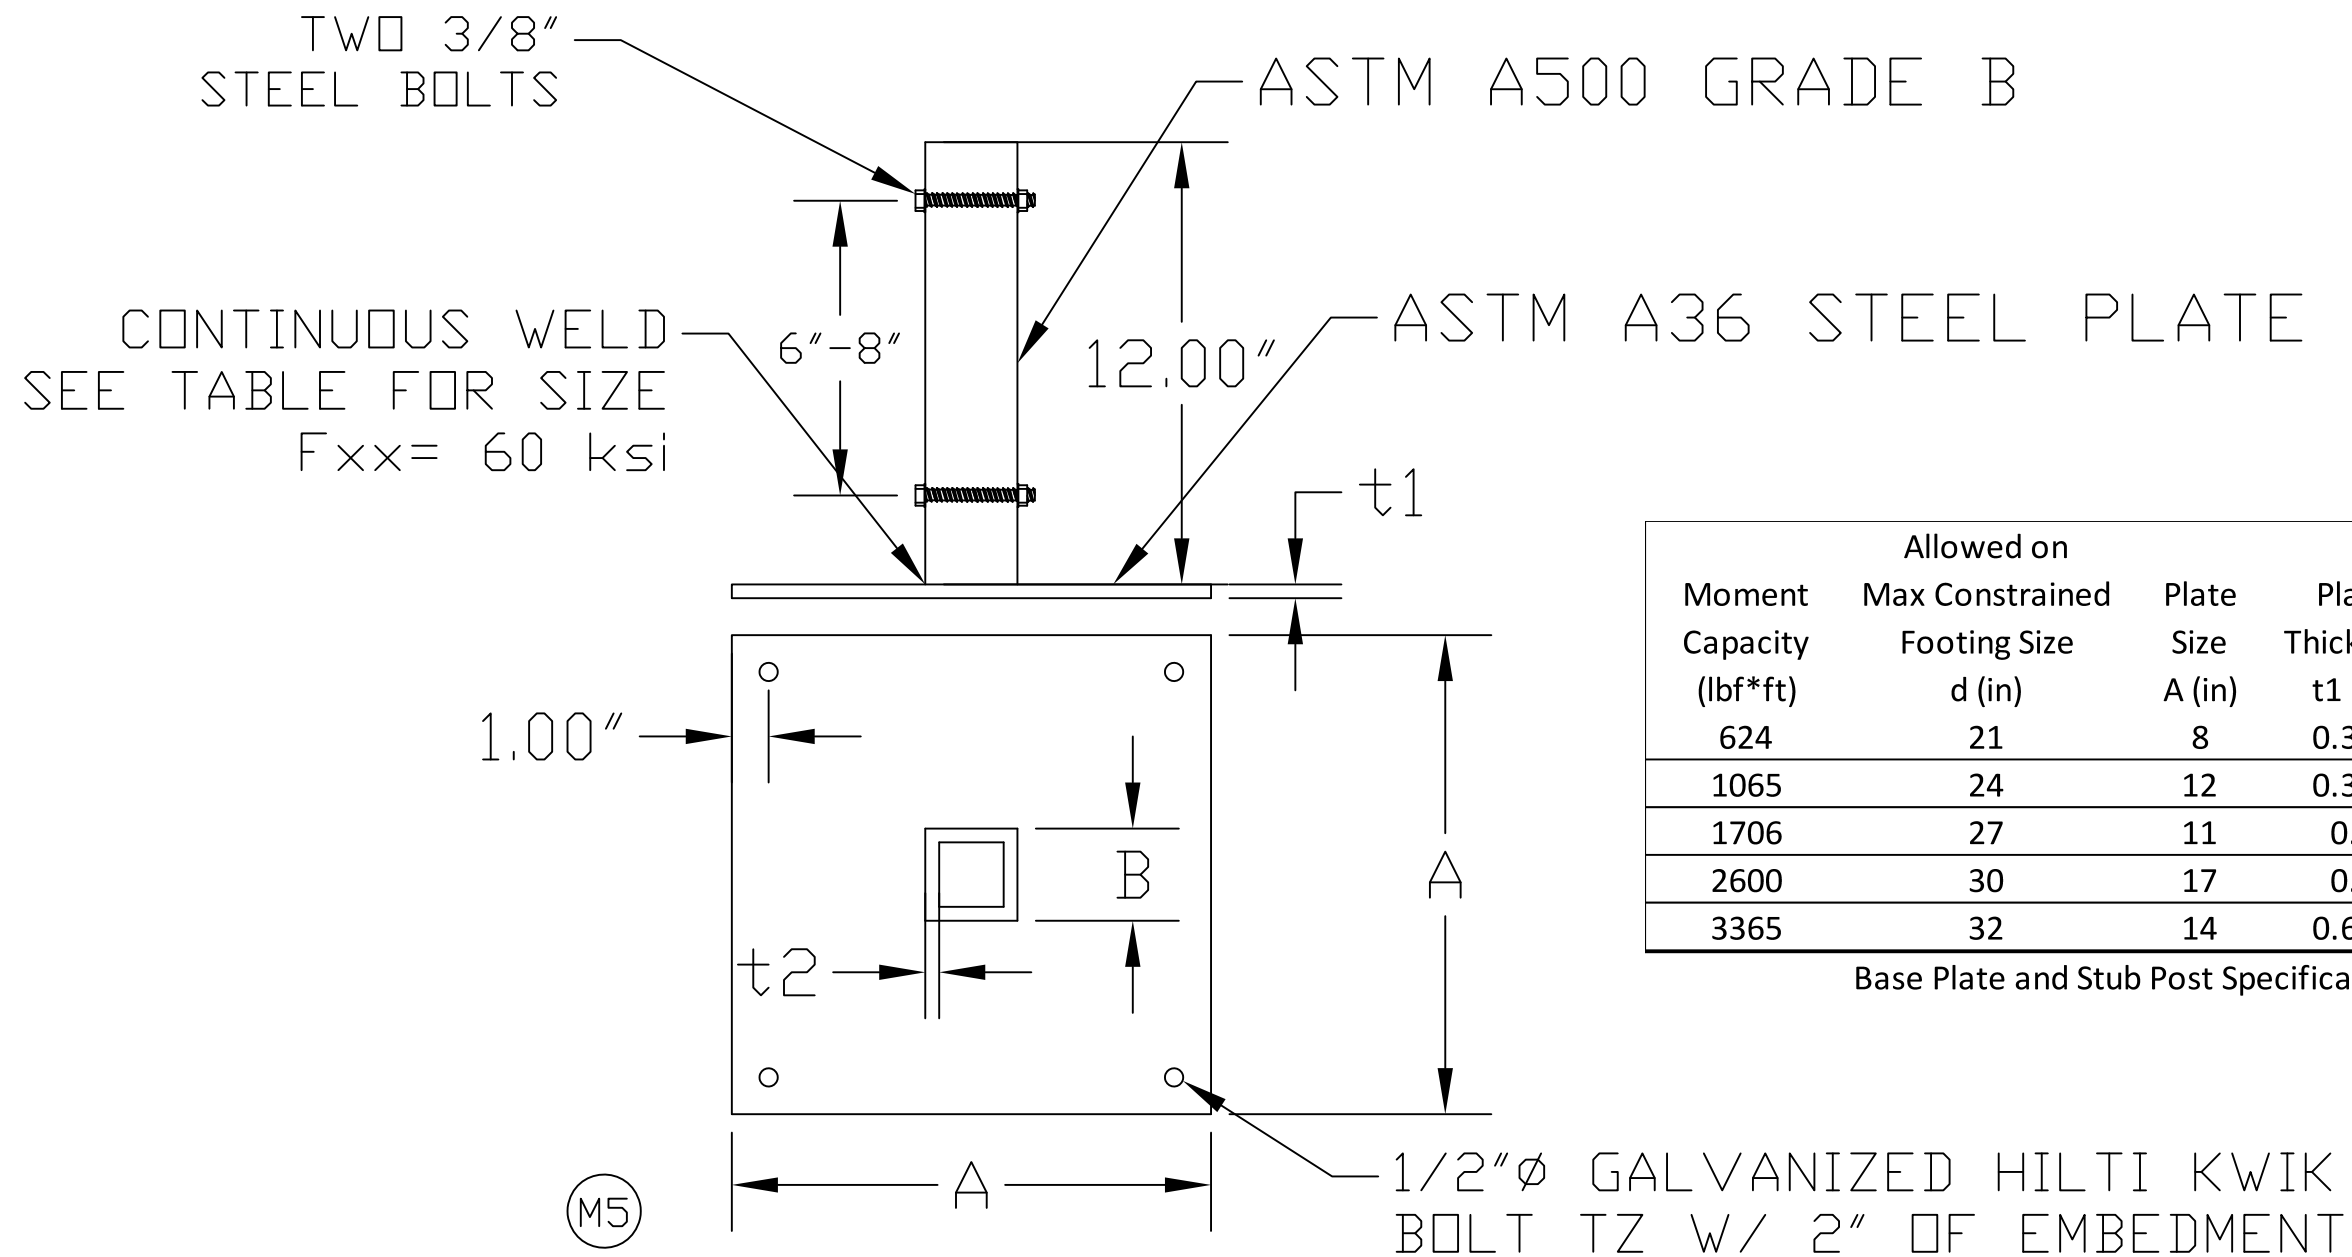

Moment Capacity (lb*ft)	Allowed on					
	Max Constrained Footing Size d (in)	Plate Size A (in)	Plate Thickness t1 (in)	Stub Post Size B (in)	Stub Post Size t2 (in)	Minimum Weld Size (in)
624	21	8	0.375	2.5	0.188	0.125
1065	24	12	0.375	2.5	0.188	0.125
1706	27	11	0.5	2.5	0.188	0.125
2600	30	17	0.5	2.5	0.25	0.188
3365	32	14	0.625	2.5	0.375	0.25

Base Plate and Stub Post Specifications




WELDED MOMENT RESISTING STEEL BASE PLATE
 ALTERNATIVE TO POST EMBEDMENT IN CONCRETE FOOTING
 THE WELDED POST BRACKET MUST BE VERIFIED TO
 COMPLY WITH THE REQUIREMENTS IN DETAIL M5 OF THESE
 PLANS AND FABRICATED IN ACCORDANCE W/ 2018 IBC
 SECTION 1704.2.5.1 BY AN APPROVED FABRICATOR TO THE
 SATISFACTION OF THE CODE OFFICIAL




MAY 03 2019
 Engineer's Stamp

Amerimax
 EXTERIOR HOME PRODUCTS 28921 US Hwy 74 Romoland, CA 92585

DRAWN BY: CP	TYPE:
SCALE: NTS	NAME: Miscellaneous Details
DATE:	FILE#: Misc1b-2018
SHEET:	

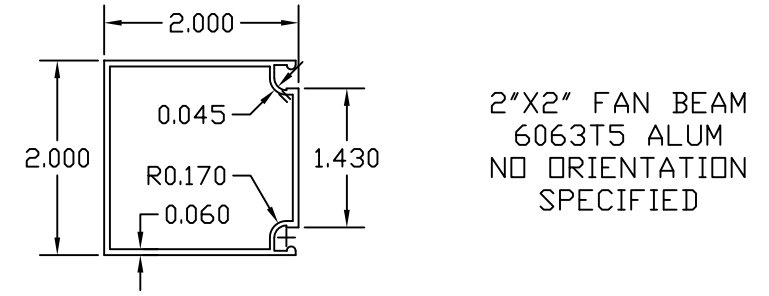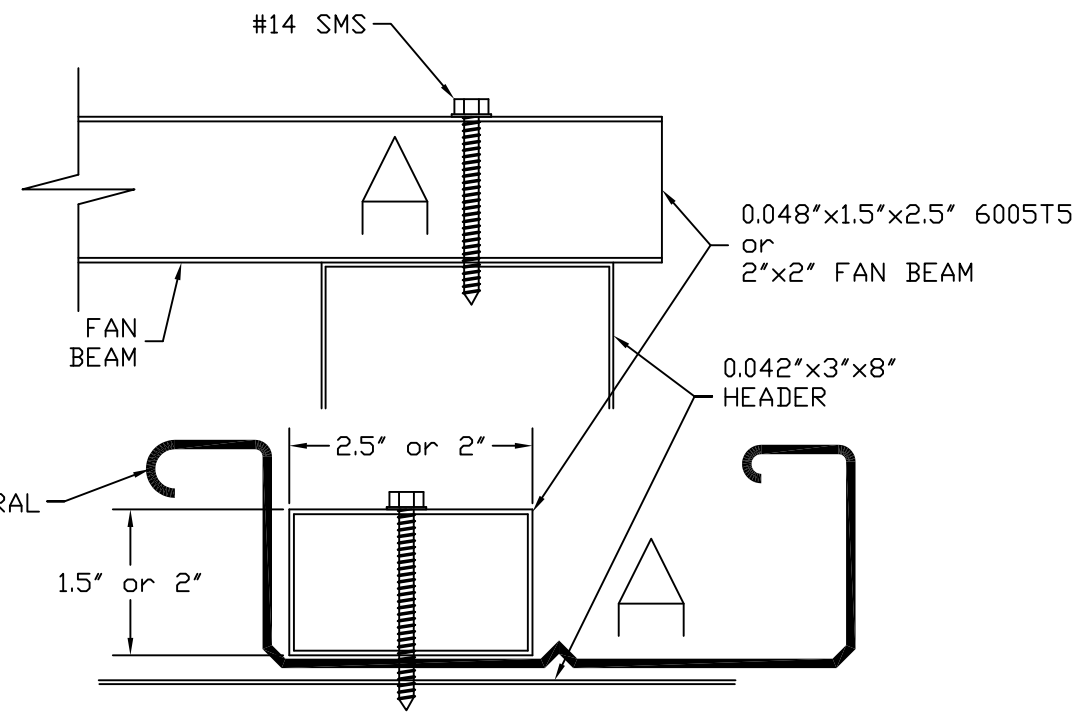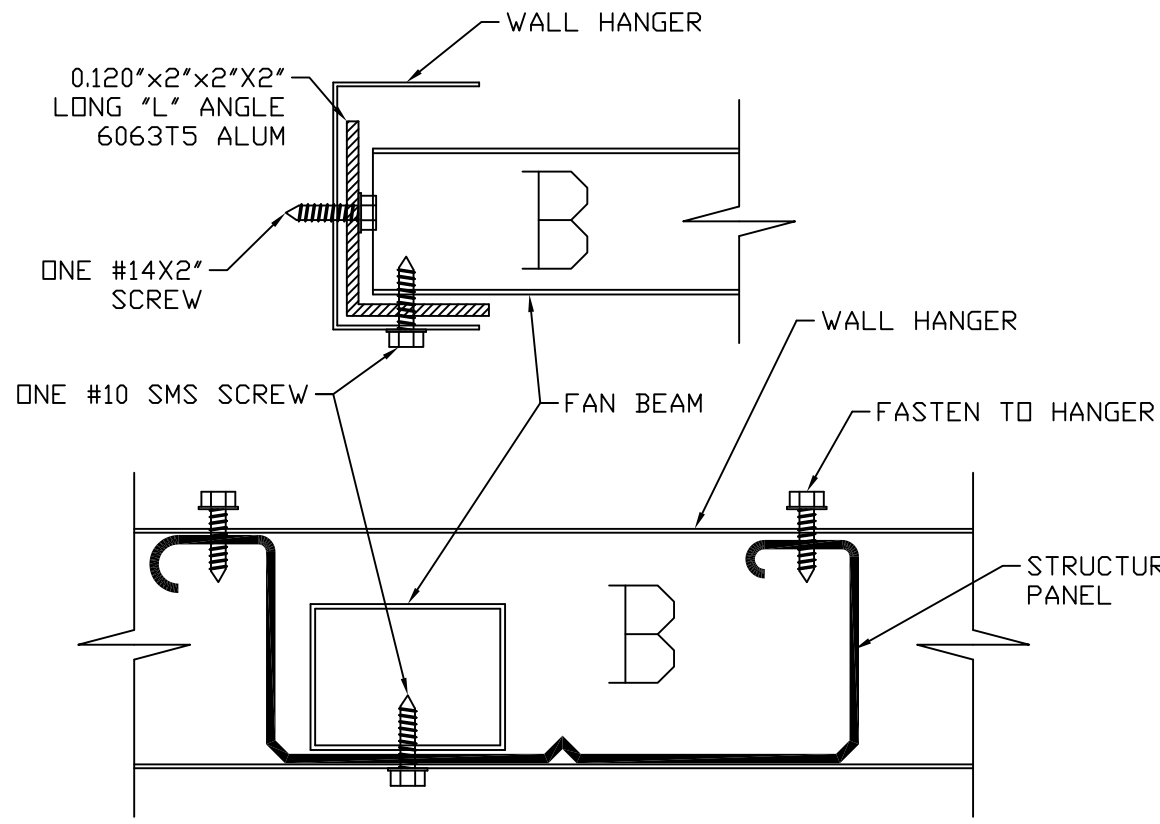


2" X 2" FAN BEAM
6063T5 ALUM
NO ORIENTATION
SPECIFIED

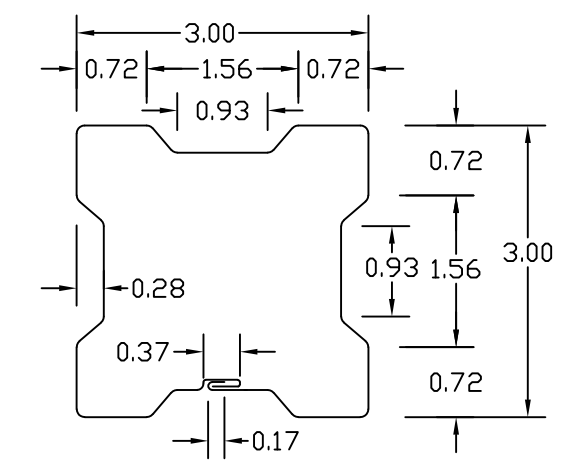

t = 0.041"
3" X 3" CLOVERLEAF HEADER
(A-653 Fy=40 KSI STEEL)

CONFORMANCE TO THE APPLICABLE ELECTRICAL CODE IS OUTSIDE THE SCOPE OF THIS DETAIL AND MUST BE APPROVED SEPERATELY.

Weight of fan/lights	Allowable Fan Beam Spans	
	0.048"x1.5"x2.5"	2"x2" Fan Beam 3x3 Steel Beam
30 lbs	15'-10"	23'

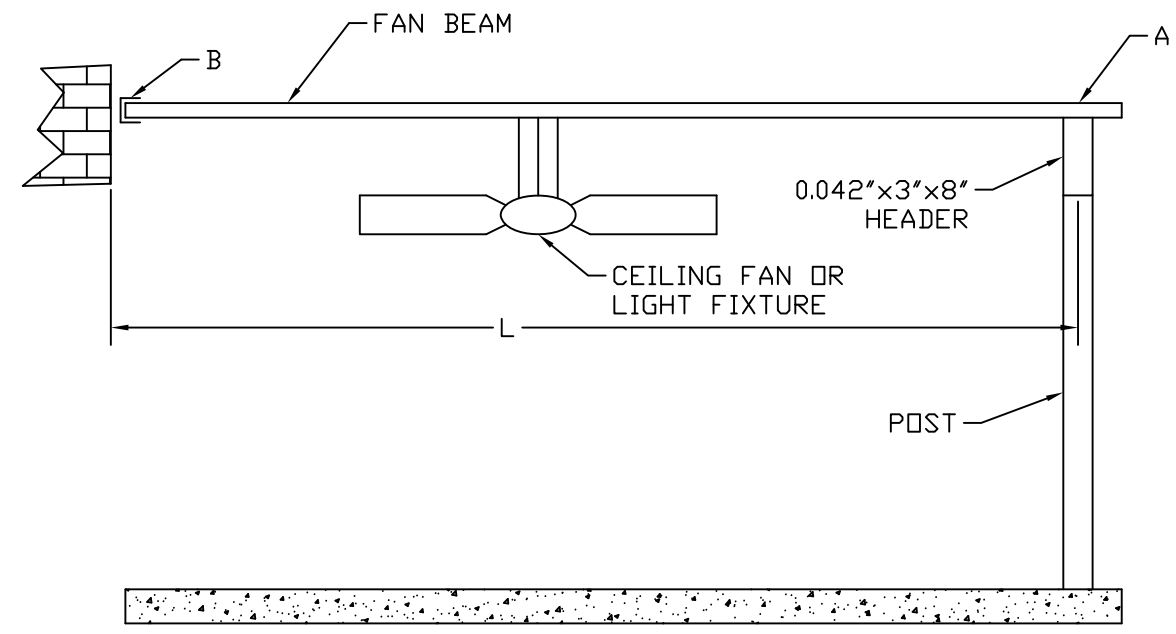

Amerimax 28921 US Hwy 74
EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: CP	TYPE:
SCALE: NTS	NAME: Miscellaneous Details
DATE:	FILE#: Misc2-2018
SHEET:	

7.0 POST AND FASTENER REQUIREMENTS FOR COMMERCIAL AND PATIO STRUCTURES

Trib Width (ft)	Allowable Width for Attached Two Post Structures on Slab Live or Ground Snow Load			
	10 psf		20 psf	
	10 psf	20 psf	10 psf	20 psf
3	45'-5"	23'-9"		
3.5	38'-11"	20'-4"		
4	34'-1"	17'-10"		
4.5	30'-3"	15'-10"		
5	27'-3"	14'-3"		
5.5	24'-9"	12'-11"		
6	22'-8"	11'-10"		
6.5	20'-11"	10'-11"		
7	19'-5"	10'-2"		
7.5	18'-2"	n/a		
8	17'-0"	n/a		
8.5	16'-0"	n/a		
9	15'-1"	n/a		

Table 7.1

POST TYPE	POST DESCRIPTIONS	DETAIL	MAX POST HGHT
A1	Twinn 0.060"x1.5"x1.5" Scroll	AC	10'
A2	0.042"x3"x8" Aluminum Post	N30 or L1	12'
B	0.024"x3"x3" Post with Sideplates	N16, BK or L24	10'
C	Clover 0.030"x3"x3" Alum	N11, AH or L11	11'
D	Clover 0.040"x3"x3" Alum	N11, AH or L11	11'
E	Colonial 0.062" Extruded	AE	11'
F1	0.041"x3"x3" Steel Clover	N11, AH or L11	11'
F2	0.041"x3"x3" Steel Clover	N11, AH or L11	10'
F3	0.041"x3"x3" Steel Clover	N11, AH or L11	9'
F4	0.041"x3"x3" Steel Clover	N11, AH or L11	8'
F5	0.041"x3"x3" Steel Clover	N11, AH or L11	7'
G1	1/8"x3"x3" Steel Square	N17, AG or L21	12'
G2	1/8"x3"x3" Steel Square	N17, AG or L21	10'
H1	3/16"x3"x3" Steel Square	N17, AG or L21	12'
H2	3/16"x3"x3" Steel Square	N17, AG or L21	10'
I1	3/16"x4"x4" Steel Square	N17, AG or L21	15'
I2	3/16"x4"x4" Steel Square	N17, AG or L21	12'
J1	3/16"x5"x5" Steel Square	N17, AG or L21	15'
J2	3/16"x5"x5" Steel Square	N17, AG or L21	12'
K1	3/16"x6"x6" Steel Square	N17, AG or L21	15'

Table 7.2

Fastener Terminology

#14 SMS = #14 sheet metal or SDS screw, 1/2" minimum length

3/8" B = 3/8" Diameter Steel Bolt

See General Notes for specifics on fasteners

Table 7.3: Required Number of Fasteners for Shearing Loads

Footer Design Size (in)	Uplift (lbs)	Aluminum Material Gage (in)								Steel Gage (in)	
		0.024				0.032				0.041	
		A	B	C	D	E	F	G	H	I	J
12	90	#14	3/8" B	3/8" B	#14	#14	3/8" B	#14	3/8" B	#14	3/8" B
13	114	SMS	BOLT	BOLT	SMS	SMS	BOLT	SMS	BOLT	SMS	BOLT
14	143	120	590	788	160	180	984	276	1384	507	1522
15	176	1	1	1	1	1	1	1	1	1	1
16	213	2	1	1	2	2	1	1	1	1	1
17	256	3	1	1	2	2	1	1	1	1	1
18	304	3	1	1	2	2	1	2	1	1	1
19	357	3	1	1	3	2	1	2	1	1	1
20	417	4	1	1	3	3	1	2	1	1	1
21	482	5	1	1	4	3	1	2	1	1	1
22	555	5	1	1	4	4	1	3	1	2	1
23	634	6	2	1	4	4	1	3	1	2	1
24	720	6	2	1	5	4	1	3	1	2	1
25	814	7	2	2	6	5	1	3	1	2	1
26	915	8	2	2	6	5	1	4	1	2	1
27	1025	9	2	2	7	6	2	4	1	2	1
28	1143	10	2	2	8	7	2	5	1	3	1
29	1270	11	3	2	8	8	2	5	1	3	1
30	1406	12	3	2	9	8	2	6	2	3	1
31	1552	n/a	3	2	10	9	2	6	2	3	1
32	1707	n/a	3	3	11	10	2	7	2	4	2
33	1872	n/a	4	3	12	11	2	7	2	4	2
34	2047	n/a	4	3	n/a	12	3	8	2	5	2
35	2233	n/a	4	3	n/a	n/a	3	9	2	5	2
36	2430	n/a	5	4	n/a	n/a	3	9	2	5	2
37	2638	n/a	5	4	n/a	n/a	3	10	2	6	2
38	2858	n/a	5	4	n/a	n/a	3	11	3	6	2
39	3090	n/a	6	4	n/a	n/a	4	12	3	7	3
40	3333	n/a	6	5	n/a	n/a	4	n/a	3	7	3
41	3590	n/a	7	5	n/a	n/a	4	n/a	3	8	3
42	3859	n/a	7	5	n/a	n/a	4	n/a	3	8	3
43	4141	n/a	8	6	n/a	n/a	5	n/a	3	9	3
44	4437	n/a	8	6	n/a	n/a	5	n/a	4	9	3
45	4746	n/a	9	7	n/a	n/a	5	n/a	4	10	4
46	5070	n/a	9	7	n/a	n/a	6	n/a	4	10	4
47	5407	n/a	10	7	n/a	n/a	6	n/a	4	11	4
48	5760	n/a	10	8	n/a	n/a	6	n/a	5	12	4
49	6128	n/a	11	8	n/a	n/a	7	n/a	5	n/a	5
50	6510	n/a	12	9	n/a	n/a	7	n/a	5	n/a	5

Table 7.4: Required Number of Fasteners for Tension Loads

Design Uplift (lbs)	Footer Size (in)	Aluminum Gage (in)				
		0.036		0.060		
		K	L	M	N	O
90	12	3/8" B	#14	3/8" B	3/8" B	#14
114	13	BOLT	SMS	BOLT	BOLT	SMS
143	14	665	141	865	1038	204
176	15	1	1	1	1	1
213	16	1	2	1	1	2
256	17	1	2	1	1	2
304	18	1	3	1	1	2
357	19	1	3	1	1	2
417	20	1	3	1	1	3
482	21	1	4	1	1	3
555	22	1	4	1	1	3
634	23	1	5	1	1	4
720	24	2	6	1	1	4
814	25	2	6	1	1	4
915	26	2	7	2	1	5
969	27	2	7	2	1	5
1025	27	2	8	2	1	6
1143	28	2	9	2	2	6
1270	29	2	10	2	2	7
1309	30	2	10	2	2	7
1406	30	3	10	2	2	7
1475	31	3	11	2	2	8
1552	31	3	12	2	2	8
1707	32	3	n/a	2	2	9
1872	33	3	n/a	3	2	10
2047	34	4	n/a	3	2	11
2233	35	4	n/a	3	3	11
2430	36	4	n/a	3	3	12
2638	37	4	n/a	4	3	n/a
2858	38	5	n/a	4	3	n/a
3090	39	5	n/a	4	3	n/a
3333	40	6	n/a	4	4	n/a
3590	41	6	n/a	5	4	n/a
3859	42	6	n/a	5	4	n/a
4141	43	7	n/a	5	4	n/a
4437	44	7	n/a	6	5	n/a
4746	45	8	n/a	6	5	n/a
5070	46	8	n/a	6	5	n/a
5407	47	9	n/a	7	6	n/a
5760	48	9	n/a	7	6	n/a
6128	49	10	n/a	8	6	n/a
6510	50	10	n/a	8	7	n/a

TABLE 7.5: WALL ATTACHMENTS FOR SOLID COVER STRUCTURES

LIVE/ SNOW LOAD (PSF)	WIND SPEED (MPH) AND EXPOSURE	ALLOWABLE PANEL SPAN FOR GIVEN FASTENER AND NUMBER						
		CONCRETE (#2) OR MASONRY (#3)		#14 SCREW (#4) PER 16"				
		ANCHOR	O/C SPACING	1/4" LAG SCREW (#5) PER 16"				
10	105	B	16"	8"	1	2	3	4
10	100	C	21'	n/a	18'	21'	n/a	n/a
10	110	C	21'	n/a	16.5'	21'	n/a	n/a
10	115	C	17'	n/a	15'	18'	n/a	n/a
10	130	C	16'	n/a	11.5'	17'	n/a	n/a
10	140	C	15'	n/a	10'	16'	n/a	n/a
10	150	C	13'	14.5'	8.5'	15'	n/a	n/a
10	170	C	10'	12.5'	6.5'	13'	n/a	n/a
20	110	C	15'	n/a	9.5'	15'	n/a	n/a
20	130	C	14'	n/a	9.5'	14'	n/a	n/a
20	170	C	10'	12.5'	6.5'	13'	n/a	n/a
25	110	C	15'	n/a	10'	15'	n/a	n/a
25	115	C	14.5'	n/a	10'	15'	n/a	n/a
25	130	C	14'	n/a	10'	14'	n/a	n/a
30	110	C	14'	n/a	8.5'	15'	n/a	n/a
30	115	C	14'	n/a	8.5'	14'	n/a	n/a
30	130	C	13.5'	n/a	8.5'	14'	n/a	n/a
35.7	115	C	13.5'	n/a	7'	14'	n/a	n/a
35.7	130	C	13'	13.5'	7'	14'	n/a	n/a
42	110	C	13'	13.5'	6'	13'	14'	n/a
42	130	C	11.5'	13'	6'	13'	14'	n/a
50	130	C	10.5'	12'	5'	10'	13'	n/a
60	130	C	9'	11'	4'	8'	12'	n/a

- 1 Spacing between bolts and screws shall be 2.5 times the shank diameter.
- 2 The edge distance of bolts and screws shall be 3 times the shank diameter
- 3 Connections shall be arranged so that the center of resistance of the connection shall coincide with the resultant line of action of the load.

TABLE 7.6: WALL ATTACHMENTS FOR LATTICE COVERS

GRND SNOW LOAD (PSF)	Wind Speed and Exposure	# of Screws* per Rafter	ALUMINUM RAFTER SPACING					
			12"	16"	20"	24"	32"	36"
			MAXIMUM ALUMINUM RAFTER SPAN					
10	160 Exp B	2	26'	26'	20'	22'	17'	15'
LIVE	140 Exp C	3	26'	22'	19'	20'	17'	17'
20	170 Exp B	2	19'	18'	14'	12'	9'	8'
LIVE	170 Exp C	3	17'	18'	15'	14'	12'	12'
25	170 Exp C	2	18'	17'	14'	13'	10'	8'
30	170 Exp C	2	17'	16'	13'	11'	8'	7'
36	170 Exp C	2	16'	14'	11'	9'	7'	6'
42	170 Exp C	2	14'	12'	9'	8'	6'	5'
50	170 Exp C	2	13'	10'	8'	6'	5'	4'
60	170 Exp C	2	11'	8'	6'	5'	4'	3'
		3	12'	12'	10'	8'	6'	5'

*Screws are #14 screws w/ 1.5" embedment into G=0.5 solid wood (Douglas Fir)

TABLE 7.7 STUCCO ATTACHMENT TO WALL ALLOWABLE DISTANCE TO FIRST ROW OF POSTS

Ground Snow Load (psf)	1/4" Lag Screws 16" o/c	Wind Speed (mph)				Exp
		1	2	3	4	
Live	10	9'-11"	19'-10"	29'-9"	39'-8"	B
Live	10	9'-8"	19'-5"	29'-1"	38'-10"	C
Live	10	8'-10"	17'-9"	26'-8"	35'-6"	C
Live	10	8'-1"	16'-3"	24'-5"	32'-7"	C
Live	10	7'-6"	15'-0"	22'-6"	30'-0"	C
Live	10	5'-11"	11'-11"	17'-10"	23'-10"	C
Live	20	5'-2"	10'-4"	15'-7"	20'-9"	C
Live	20	5'-2"	10'-4"	15'-7"	20'-9"	C
Live	20	4'-6"	9'-1"	13'-7"	18'-2"	C
	25	5'-8"	11'-4"	17'-0"	22'-8"	C
	25	4'-6"	9'-1"	13'-7"	18'-2"	C
	25	3'-6"	7'-1"	10'-8"	14'-3"	C
	30	4'-9"	9'-6"	14'-3"	19'-0"	C
	30	4'-6"	9'-1"	13'-7"	18'-2"	C
	30	3'-6"	7'-1"	10'-8"	14'-3"	C
	35.7	4'-0"	8'-0"	12'-1"	16'-1"	C
	35.7					

CONVERSION TO SQUARE TOP FOOTING

EQUIVALENT UPLIFT AND CONstrained FOOTINGS		DIAMETER OF CIRCULAR FOOTINGS (IN)			
CONstrained FOOTING (IN)	NON CONstrained FOOTING (IN)	12"	18"	24"	36"
14"	17"	24"	14"	14"	14"
15"	18"	30"	15"	15"	15"
16"	19"	36"	16"	16"	16"
17"	21"	43"	19"	17"	17"
18"	22"	52"	23"	18"	18"
19"	23"	61"	27"	19"	19"
20"	24"	n/a	31"	20"	20"
21"	26"	n/a	36"	21"	21"
22"	27"	n/a	42"	24"	22"
23"	28"	n/a	48"	27"	23"
24"	30"	n/a	54"	31"	24"
25"	31"	n/a	61"	35"	25"
26"	32"	n/a	69"	39"	26"
27"	34"	n/a	77"	44"	27"
28"	35"	n/a	86"	49"	28"
29"	36"	n/a	n/a	54"	29"
30"	38"	n/a	n/a	60"	30"
31"	39"	n/a	n/a	66"	31"
32"	40"	n/a	n/a	72"	32"
33"	42"	n/a	n/a	79"	35"
34"	43"	n/a	n/a	87"	39"
35"	44"	n/a	n/a	95"	42"
36"	46"	n/a	n/a	103"	46"
37"	47"	n/a	n/a	112"	50"
38"	48"	n/a	n/a	n/a	54"
39"	50"	n/a	n/a	n/a	58"
40"	51"	n/a	n/a	n/a	63"
41"	53"	n/a	n/a	n/a	68"
42"	54"	n/a	n/a	n/a	73"
43"	55"	n/a	n/a	n/a	78"
44"	57"	n/a	n/a	n/a	84"

TABLE 7.8

d (in)	For UPLIFT Footings Only			
	Footing Depth			
	18"	24"	30"	36"
20"	21"	18"	16"	15"
21"	23"	20"	18"	16"
22"	24"	21"	19"	17"
23"	26"	23"	20"	18"
24"	28"	24"	21"	20"
25"	29"	26"	23"	21"
26"	31"	27"	24"	22"
27"	33"	29"	26"	23"
28"	35"	30"	27"	25"
29"	37"	32"	29"	26"
30"	39"	34"	30"	27"
31"	41"	35"	32"	29"
32"	43"	37"	33"	30"
33"	45"	39"	35"	32"
34"	47"	40"	36"	33"
35"	49"	42"	38"	35"
36"	51"	44"	39"	36"
37"	53"	46"	41"	38"
38"	55"	48"	43"	39"
39"	57"	50"	44"	41"
40"	60"	52"	46"	42"
41"	N/A	54"	48"	44"
42"	N/A	56"	50"	45"
43"	N/A	58"	51"	47"
44"	N/A	60"	53"	49"
45"	N/A	N/A	55"	50"
46"	N/A	N/A	57"	52"
47"	N/A	N/A	59"	54"
48"	N/A	N/A	N/A	55"
49"	N/A	N/A	N/A	57"
50"	N/A	N/A	N/A	59"

TABLE 7.9

Trib Area (sq ft)	UPLIFT FOOTING SIZE BASED ON ACTUAL SITE DIMENSIONS											Lattice Trib Area (sq ft)
	Wind Condition											
	95 MPH Exp B	100 MPH Exp B	105 MPH Exp B	95 MPH Exp C or 110 MPH Exp B	100 MPH Exp C or 115 MPH Exp B	105 MPH Exp C or 120 MPH Exp B	110 MPH Exp C or 130 MPH Exp B	115 MPH Exp C or 130 MPH Exp B	120 MPH Exp C or 140 MPH Exp B	130 MPH Exp C or 150 MPH Exp B	140 MPH Exp C or 160 MPH Exp B	
15	14"	15"	15"	16"	17"	17"	18"	18"	19"	20"	21"	25
20	16"	16"	17"	18"	18"	19"	19"	20"	21"	22"	23"	33
25	17"	17"	18"	19"	20"	20"	21"	22"	22"	23"	24"	42
30	18"	19"	19"	20"	21"	22"	22"	23"	24"	25"	26"	50
35	19"	20"	20"	21"	22"	23"	23"	24"	25"	26"	28"	58
40	20"	20"	21"	22"	23"	24"	25"	25"	26"	28"	29"	67
45	21"	21"	22"	23"	24"	25"	26"	26"	27"	29"	30"	75
50	21"	22"	23"	24"	25"	26"	26"	27"	28"	30"	31"	83
55	22"	23"	24"	25"	26"	26"	27"	28"	29"	31"	32"	92
60	23"	23"	24"	25"	26"	27"	28"	29"	30"	31"	33"	100
65	23"	24"	25"	26"	27"	28"	29"	30"	31"	32"	34"	108
70	24"	25"	25"	27"	28"	29"	30"	30"	31"	33"	35"	117
80	25"	26"	27"	28"	29"	30"	31"	32"	33"	35"	36"	133
90	26"	27"	28"	29"	30"	31"	32"	33"	34"	36"	38"	150
100	27"	28"	29"	30"	31"	32"	33"	34"	35"	37"	39"	167
110	28"	29"	30"	31"	32"	33"	34"	35"	37"	39"	41"	183
120	28"	29"	31"	32"	33"	34"	35"	36"	38"	40"	42"	200
130	29"	30"	31"	33"	34"	35"	36"	37"	39"	41"	43"	217
140	30"	31"	32"	34"	35"	36"	37"	38"	40"	42"	44"	233
150	31"	32"	33"	34"	36"	37"	38"	39"	40"	43"	45"	250
160	31"	32"	34"	35"	36"	38"	39"	40"	41"	44"	46"	267
170	32"	33"	34"	36"	37"	39"	40"	41"	42"	45"	47"	283
180	33"	34"	35"	37"	38"	39"	41"	42"	43"	45"	48"	300
190	33"	34"	36"	37"	39"	40"	41"	43"	44"	46"	49"	317
200	34"	35"	36"	38"	39"	41"	42"	43"	45"	47"	49"	333
210	34"	36"	37"	39"	40"	41"	43"	44"	45"	48"	50"	350
220	35"	36"	37"	39"	41"	42"	43"	45"	46"	49"	51"	367
230	35"	37"	38"	40"	41"	43"	44"	45"	47"	49"	52"	383
240	36"	37"	38"	40"	42"	43"	45"	46"	47"	50"	53"	400
250	36"	38"	39"	41"	42"	44"	45"	47"	48"	51"	53"	417
260	37"	38"	39"	41"	43"	44"	46"	47"	49"	51"	54"	433
270	37"	39"	40"	42"	43"	45"	46"	48"	49"	52"	55"	450
280	38"	39"	40"	42"	44"	45"	47"	48"	50"	53"	55"	467
290	38"	40"	41"	43"	44"	46"	48"	49"	50"	53"	56"	483
300	39"	40"	41"	43"	45"	47"	48"	50"	51"	54"	57"	500
310	39"	40"	42"	44"	45"	47"	49"	50"	52"	54"	57"	517
320	39"	41"	42"	44"	46"	48"	49"	51"	52"	55"	58"	533
330	40"	41"	43"	45"	46"	48"	50"	51"	53"	56"	58"	550
340	40"	42"	43"	45"	47"	49"	50"	52"	53"	56"	59"	567
350	41"	42"	44"	46"	47"	49"	51"	52"	54"	57"	60"	583
360	41"	43"	44"	46"	48"	49"	51"	53"	54"	57"	60"	600

TABLE 7.10

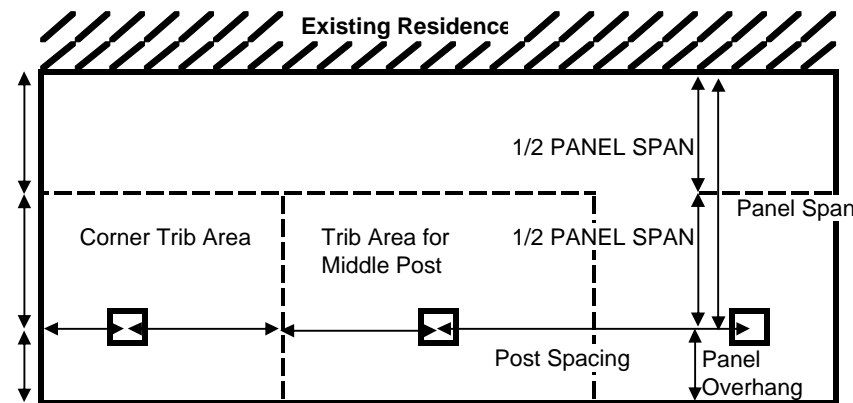


Figure 1

Determine Trib Area from Figure 1

INSTRUCTIONS TO USE TABLE 7.10

- TABLE DETERMINES UPLIFT FOOTING SIZE ONLY
MAY BE USED FOR FREESTANDING COVERS.
DOES NOT AFFECT REQUIRED CONSTRAINED FOOTING SIZE.
- DETERMINE ACTUAL TRIBUTARY AREA
FOR MIDDLE POSTS THIS IS:
TRIB WIDTH x POST SPACING
FOR END POSTS THIS IS:
(OVERHANG+ HALF OF POST SPACING) x TRIB WIDTH
- DETERMINE FOOTING SIZE FOR WIND CONDITION
- FOR LATTICE USE LAST COLUMN FOR TRIB AREA

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503



MAY 03 2019

7.0 ALTERNATIVE FOOTING TABLES (PAGE 2)

Table 7.11 Uplift Footing size for Different Wind Loads

	Cubed Footing Size d x d x d (in)																																							
95 MPH EXPOSURE B	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50					
100 MPH EXPOSURE B	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52				
105 MPH EXPOSURE B	17	18	19	20	21	23	24	25	26	27	28	29	30	31	32	33	34	35	36	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55			
110 MPH EXPOSURE B	18	19	20	21	22	23	24	25	27	28	29	30	31	32	33	34	35	37	38	39	40	41	42	43	44	45	47	48	49	50	51	52	53	54	55	56	57			
115 MPH EXPOSURE B	18	19	21	22	23	24	25	26	27	29	30	31	32	33	34	35	37	38	39	40	41	42	43	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59		
120 MPH EXPOSURE B	19	20	21	22	24	25	26	27	28	29	31	32	33	34	35	36	38	39	40	41	42	44	45	46	47	48	49	50	51	52	53	54	55	57	58	59	60	61		
130 MPH EXPOSURE B	20	21	22	24	25	26	27	29	30	31	32	34	35	36	37	39	40	41	42	44	45	46	47	49	50	51	52	53	55	56	57	58	59	60	61	62	63	64		
140 MPH EXPOSURE B	21	22	24	25	26	27	29	30	31	33	34	35	37	38	39	41	42	43	45	46	47	48	50	51	52	54	55	56	58	59	60	62	63	64	65	66	67	68		
150 MPH EXPOSURE B	22	23	25	26	27	29	30	32	33	34	36	37	38	40	41	43	44	45	47	48	49	51	52	54	55	56	58	59	60	62	63	64	66	67	68	69	70	72		
160 MPH EXPOSURE B	23	24	26	27	29	30	32	33	34	36	37	39	40	42	43	44	46	47	49	50	52	53	54	56	57	59	60	62	63	65	66	67	69	70	72	73	74	75	76	
170 MPH EXPOSURE B	24	25	27	28	30	31	33	34	36	37	39	40	42	43	45	46	48	49	51	52	54	55	57	58	60	61	63	64	66	67	69	70	72	73	74	75	76	77	78	
95 MPH EXPOSURE C	18	19	20	21	23	24	25	26	27	28	29	30	32	33	34	35	36	37	38	39	41	42	43	44	45	46	47	48	50	51	52	53	54	55	56	57	58	59	60	
100 MPH EXPOSURE C	19	20	21	22	23	24	26	27	28	29	30	31	33	34	35	36	37	38	40	41	42	43	44	45	47	48	49	50	51	52	53	54	55	57	58	59	60	61	62	
105 MPH EXPOSURE C	19	20	22	23	24	25	27	28	29	30	31	33	34	35	36	37	39	40	41	42	43	45	46	47	48	49	51	52	53	54	55	57	58	59	60	61	62	63	64	
110 MPH EXPOSURE C	20	21	22	24	25	26	27	29	30	31	32	34	35	36	37	39	40	41	42	44	45	46	47	49	50	51	52	54	55	56	57	59	60	61	62	63	64	65	66	
115 MPH EXPOSURE C	21	22	23	24	26	27	28	30	31	32	33	35	36	37	39	40	41	42	44	45	46	47	49	50	51	53	54	55	56	58	59	60	62	63	64	65	66	67	68	
120 MPH EXPOSURE C	21	22	24	25	26	28	29	30	32	33	34	36	37	38	40	41	42	44	45	46	48	49	50	52	53	54	56	57	58	59	61	62	63	65	66	67	68	69	70	
130 MPH EXPOSURE C	22	24	25	27	28	29	31	32	33	35	36	38	39	40	42	43	45	46	47	49	50	52	53	54	56	57	59	60	61	63	64	66	67	68	69	70	71	72	73	74
140 MPH EXPOSURE C	23	25	26	28	29	31	32	34	35	37	38	40	41	43	44	46	47	48	50	51	53	54	56	57	59	60	62	63	65	66	68	69	70	72	73	74	75	76	77	78
150 MPH EXPOSURE C	25	26	28	29	31	32	34	35	37	38	40	42	43	45	46	48	49	51	52	54	55	57	58	60	62	63	65	66	68	69	71	72	74	75	76	77	79	80	81	82
160 MPH EXPOSURE C	26	27	29	31	32	34	35	37	39	40	42	43	45	47	48	50	51	53	55	56	58	59	61	63	64	66	67	69	70	72	74	75	77	79	80	82	84	85	86	87
170 MPH EXPOSURE C	27	28	30	32	33	35	37	39	40	42	44	45	47	49	50	52	54	55	57	59	60	62	64	65	67	69	70	72	74	75	77	79	80	82	84	86	88	89	90	

Instructions for Table 7.11

- 1 This table is used to reduce (or increase) size for wind conditions not listed footing in this report
 - 2 Use the tables in Sections 2.0 and 5.0 to determine UPLIFT footing size.
 - 3 If your actual wind condition (mph and Exposure) is different from the table in Sections 2.0 or 5.0 then locate the wind condition (from Section 2.0 or 5.0) and footing size ("d")
 - 4 Then locate your actual wind condition and use the footing size in the same column as you found in #3.
- Example: In Section 5.0 your UPLIFT footing for 115mph Exp C is d=30"
Your actual condition is 95 mph Exposure B.
The actual UPLIFT footing size is d=24"
30"x30"x30" = 2.5'x2.5'x2.5' = 15.6 cubic feet
24"x24"x24" = 2'x2'x2' = 8 cubic feet
Almost a 50% reduction

Table 7.12 SMALLEST FOOTING WIDTH x WIDTH x DEPTH*

Uplift Footing (in)	CONSTRAINED CUBED FOOTING SIZE d x d x d																																												
	16"	17"	18"	19"	20"	21"	22"	23"	24"	25"	26"	27"	28"	29"	30"	31"	32"	33"	34"	35"	36"	37"	38"	39"	40"	41"	42"	43"	44"																
18	20x20x15	19x19x16	18x18x18	17x17x20	17x17x21	16x16x23	15x15x25	15x15x27	14x14x29	14x14x30	13x13x32	13x13x34	13x13x36	12x12x39	12x12x41	12x12x43	11x11x45	11x11x47	11x11x50	11x11x52	10x10x55	10x10x57	10x10x59	10x10x62	10x10x65	9x9x67	9x9x70	9x9x73	9x9x75																
20	24x24x14	23x23x15	22x22x17	21x21x18	20x20x20	19x19x22	19x19x23	18x18x25	17x17x27	17x17x29	16x16x30	16x16x32	15x15x34	15x15x36	14x14x38	14x14x40	14x14x42	13x13x45	13x13x47	13x13x49	12x12x51	12x12x54	12x12x58	11x11x61	11x11x63	11x11x66	11x11x68	11x11x71																	
21	26x26x14	25x25x15	24x24x16	23x23x18	22x22x19	21x21x21	20x20x23	20x20x24	19x19x26	18x18x28	18x18x30	17x17x31	17x17x33	16x16x35	16x16x37	15x15x39	15x15x41	15x15x43	14x14x45	14x14x47	14x14x49	14x14x50	13x13x52	13x13x54	13x13x57	13x13x59	12x12x61	12x12x64	12x12x66	12x12x69															
22	28x28x13	27x27x15	26x26x16	25x25x17	24x24x19	23x23x20	22x22x22	21x21x24	21x21x25	20x20x27	19x19x29	19x19x31	18x18x33	18x18x34	17x17x36	17x17x38	16x16x40	16x16x42	16x16x44	15x15x46	15x15x48	15x15x51	14x14x53	14x14x55	14x14x57	13x13x60	13x13x62	13x13x64	13x13x66	13x13x67															
23	31x31x13	29x29x14	28x28x16	27x27x17	26x26x18	25x25x20	24x24x21	23x23x23	22x22x25	22x22x26	21x21x28	20x20x30	20x20x32	19x19x33	19x19x35	18x18x37	18x18x39	17x17x41	17x17x43	16x16x45	16x16x47	16x16x49	15x15x51	15x15x54	15x15x56	14x14x58	14x14x60	14x14x63	14x14x65																
24	33x33x13	32x32x14	30x30x15	29x29x17	28x28x18	27x27x19	26x26x21	25x25x22	24x24x24	23x23x26	23x23x27	22x22x29	21x21x31	21x21x32	20x20x34	20x20x36	19x19x38	19x19x40	18x18x42	18x18x44	17x17x46	17x17x48	17x17x50	16x16x52	16x16x54	16x16x57	15x15x59	15x15x61	15x15x63	15x15x65	15x15x66	15x15x67	15x15x68	15x15x69	15x15x70	15x15x71	15x15x72	15x15x73	15x15x74	15x15x75	15x15x76	15x15x77	15x15x78	15x15x79	15x15x80
25	36x36x12	34x34x13	33x33x15	31x31x16	30x30x17	29x29x19	28x28x21	27x27x22	26x26x23	25x25x25	24x24x27	23x23x29	22x22x31	21x21x33	21x21x35	20x20x37	20x20x39	20x20x41	19x19x43	19x19x45	18x18x47	18x18x49	18x18x51	17x17x53	17x17x55	17x17x57	16x16x59	16x16x61	16x16x63	16x16x65	16x16x66	16x16x67	16x16x68	16x16x69	16x16x70	16x16x71	16x16x72	16x16x73	16x16x74	16x16x75	16x16x76	16x16x77	16x16x78	16x16x79	16x16x80
26	38x38x12	37x37x13	35x35x14	33x33x16	32x32x17	31x31x18	30x30x20	29x29x21	28x28x23	27x27x24	26x26x26	25x25x28	25x25x29	24x24x31	23x23x33	23x23x34	22x22x36	21x21x38	21x21x40	20x20x42	20x20x44	20x20x46	19x19x48	19x19x50	18x18x52	18x18x54	18x18x56	17x17x58	17x17x60																
27	41x41x12	39x39x13	37x37x14	36x36x15	34x34x17	33x33x18	32x32x19	31x31x21	30x30x22	29x29x24	28x28x25	27x27x27	26x26x29	25x25x30	25x25x32	24x24x34	24x24x35	23x23x37	22x22x39	22x22x41	21x21x43	21x21x45	21x21x47	20x20x49	20x20x51	19x19x53	19x19x55	19x19x57	18x18x59																
28	43x43x12	42x42x13	40x40x14	38x38x15	37x37x16	35x35x18	34x34x19	33x33x20	32x32x22	31x31x23	30x30x25	29x29x26	28x28x28	27x27x30	26x26x31	26x26x33	25x25x35	25x25x36	24x24x38	23x23x40	23x23x42	22x22x44	22x22x46	21x21x48	21x21x50	21x21x52	20x20x54	20x20x56	20x20x58	19x19x60															
29	45x45x12	44x44x13	42x42x14	41x41x15	39x39x16	38x38x17	36x36x19	35x35x20	34x34x21	33x33x22	32x32x24	31x31x26	30x30x27	29x29x29	28x28x31	27x27x32	26x26x34	26x26x36	25x25x39	24x24x41	24x24x43	23x23x45	23x23x47	22x22x49	22x22x50	22x22x52	21x21x54	21x21x57																	
30	47x47x12	47x47x12	45x45x13	43x43x14	41x41x16	40x40x17	38x38x18	37x37x19	36x36x21	35x35x22	34x34x24	33x33x25	32x32x27	31x31x28	30x30x30	29x29x32	28x28x33	28x28x35	27x27x37	27x27x38	26x26x40	25x25x42	25x25x44	24x24x46	24x24x48	23x23x49	23x23x51	22x22x53	22x22x55	22x22x56	22x22x57	22x22x58	22x22x59	22x22x											

7.0 Requirements for Surface Mounted Posts on Concrete Slabs or Footings for Single Span Attached Lattice Structures

REQUIRED NUMBER OF POSTS FOR SINGLE SPAN LATTICE UNITS WITH SURFACE MOUNTED POSTS ON CONCRETE SLABS OR FOOTINGS																							
Table L1a: Use this table for the following headers Moment Frame A = 367 lbf*ft						Table L1b: Use this table for the following headers Moment Frame B = 489 lbf*ft																	
Wind Speed	Required Number of Posts	Post Height (ft)																					
		Wind Exposure B					Wind Exposure C																
		8'	9'	10'	11'	12'	8'	9'	10'	11'	12'												
MAXIMUM TRIBUTARY WIDTH ALLOWED																							
95 mph	2 or 3	8'	6.5'	5'	4'	2.5'	5'	3.5'	2.5'	1.5'	0.5'	95 mph	2 or 3	11.5'	9.5'	7.5'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'
	4	13'	11'	9'	7.5'	6'	8.5'	7'	5.5'	4.5'	3'		4	18.5'	15.5'	13.5'	11.5'	9.5'	12.5'	10.5'	8.5'	7'	5.5'
	5	18.5'	15.5'	13.5'	11.5'	9.5'	12.5'	10.5'	8.5'	7'	5.5'		5	24'	22'	19'	16.5'	14'	17.5'	14.5'	12.5'	10.5'	9'
	6	23.5'	20'	17.5'	15'	13'	16'	13.5'	11.5'	9.5'	8'		6	24'	24'	24'	21.5'	19'	22.5'	19'	16.5'	14'	12'
	7	24'	24'	21.5'	19'	16.5'	20'	17'	14.5'	12.5'	10.5'		7	24'	24'	24'	24'	23.5'	24'	23.5'	20.5'	18'	15.5'
100 mph	2 or 3	7'	5.5'	4'	3'	2'	4'	3'	2'	1'	0.5'	100 mph	2 or 3	10'	8'	6.5'	5.5'	4'	6.5'	5'	4'	2.5'	1.5'
	4	11.5'	9.5'	8'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'		4	16.5'	14'	11.5'	10'	8.5'	11'	9'	7.5'	6'	4.5'
	5	16.5'	14'	11.5'	10'	8.5'	11'	9'	7.5'	6'	4.5'		5	22.5'	19.5'	16.5'	14.5'	12.5'	15.5'	13'	11'	9'	7.5'
	6	21'	18'	15.5'	13'	11.5'	14.5'	12'	10'	8.5'	7'		6	24'	24'	21.5'	19'	16.5'	20'	17'	14.5'	12.5'	10.5'
	7	24'	22'	19'	16.5'	14.5'	17.5'	15'	12.5'	11'	9'		7	24'	24'	24'	23.5'	20.5'	24'	21'	18'	15.5'	13.5'
105 mph	2 or 3	6'	4.5'	3.5'	2.5'	1.5'	3.5'	2.5'	1.5'	0.5'	0'	105 mph	2 or 3	9'	7'	5.5'	4.5'	3.5'	5.5'	4'	3'	2'	1'
	4	10.5'	8.5'	7'	5.5'	4.5'	6.5'	5'	4'	3'	2'		4	14.5'	12'	10'	8.5'	7'	9.5'	8'	6.5'	5'	4'
	5	14.5'	12'	10'	8.5'	7'	9.5'	8'	6.5'	5'	4'		5	20.5'	17.5'	15'	12.5'	11'	14'	11.5'	9.5'	8'	6.5'
	6	19'	16'	13.5'	11.5'	10'	13'	10.5'	9'	7'	6'		6	24'	22.5'	19.5'	17'	14.5'	18'	15'	13'	11'	9.5'
	7	23'	20'	17'	15'	13'	16'	13.5'	11'	9.5'	8'		7	24'	24'	24'	21'	18.5'	22'	18.5'	16'	14'	12'
110 mph	2 or 3	5'	4'	3'	2'	1'	3'	2'	1'	0'	0'	110 mph	2 or 3	8'	6'	5'	3.5'	2.5'	5'	3.5'	2.5'	1.5'	0.5'
	4	9'	7.5'	6'	4.5'	3.5'	6'	4.5'	3.5'	2'	1.5'		4	13'	11'	9'	7.5'	6'	8.5'	7'	5.5'	4.5'	3'
	5	13'	11'	9'	7.5'	6'	8.5'	7'	5.5'	4.5'	3'		5	18.5'	15.5'	13'	11'	9.5'	12.5'	10'	8.5'	7'	5.5'
	6	17'	14.5'	12'	10.5'	8.5'	11.5'	9.5'	7.5'	6.5'	5'		6	23.5'	20'	17.5'	15'	13'	16'	13.5'	11.5'	9.5'	8'
	7	21'	18'	15.5'	13'	11.5'	14'	12'	10'	8.5'	7'		7	24'	24'	21.5'	18.5'	16.5'	20'	17'	14.5'	12.5'	10.5'
115 mph	2 or 3	4.5'	3.5'	2.5'	1.5'	0.5'	2.5'	1.5'	0.5'	0'	0'	115 mph	2 or 3	7'	5.5'	4'	3'	2'	4'	3'	2'	1'	0.5'
	4	8'	6.5'	5'	4'	3'	5'	4'	2.5'	1.5'	1'		4	11.5'	9.5'	8'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'
	5	11.5'	9.5'	8'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'		5	16.5'	14'	12'	10'	8.5'	11'	9'	7.5'	6'	5'
	6	15.5'	13'	11'	9'	7.5'	10'	8.5'	7'	5.5'	4'		6	21.5'	18'	15.5'	13.5'	11.5'	14.5'	12'	10'	8.5'	7'
	7	19'	16'	13.5'	11.5'	10'	13'	10.5'	9'	7.5'	6'		7	24'	22.5'	19.5'	17'	14.5'	18'	15'	13'	11'	9.5'
120 mph	2 or 3	4'	3'	2'	1'	0'	2'	1'	0.5'	0'	0'	120 mph	2 or 3	6'	5'	3.5'	2.5'	1.5'	3.5'	2.5'	1.5'	0.5'	0'
	4	7.5'	5.5'	4.5'	3.5'	2.5'	4.5'	3.5'	2'	1.5'	0.5'		4	10.5'	8.5'	7'	5.5'	4.5'	7'	5.5'	4'	3'	2'
	5	10.5'	8.5'	7'	5.5'	4.5'	7'	5.5'	4'	3'	2'		5	15'	12.5'	10.5'	9'	7.5'	10'	8'	6.5'	5'	4'
	6	14'	11.5'	9.5'	8'	6.5'	9'	7.5'	6'	4.5'	3.5'		6	19.5'	16.5'	14'	12'	10'	13'	11'	9'	7.5'	6'
	7	17'	14.5'	12.5'	10.5'	9'	11.5'	9.5'	8'	6.5'	5'		7	23.5'	20.5'	17.5'	15'	13'	16'	13.5'	11.5'	9.5'	8'
130 mph	2 or 3	3'	2'	1'	0'	0'	1.5'	0.5'	0'	0'	0'	130 mph	2 or 3	5'	3.5'	2.5'	1.5'	0.5'	2.5'	1.5'	1'	0'	0'
	4	6'	4.5'	3.5'	2.5'	1.5'	3.5'	2.5'	1.5'	0.5'	0'		4	8.5'	7'	5.5'	4.5'	3'	5.5'	4'	3'	2'	1'
	5	8.5'	7'	5.5'	4.5'	3'	5.5'	4'	3'	2'	1'		5	12.5'	10'	8.5'	7'	5.5'	8'	6.5'	5'	4'	3'
	6	11.5'	9.5'	7.5'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'		6	16'	13.5'	11.5'	9.5'	8'	11'	9'	7'	6'	4.5'
	7	14'	12'	10'	8.5'	7'	9.5'	7.5'	6'	5'	3.5'		7	20'	17'	14.5'	12.5'	10.5'	13.5'	11'	9.5'	7.5'	6.5'
140 mph	2 or 3	2'	1.5'	0.5'	0'	0'	1'	0'	0'	0'	0'	140 mph	2 or 3	4'	2.5'	1.5'	1'	0'	2'	1'	0.5'	0'	0'
	4	4.5'	3.5'	2.5'	1.5'	0.5'	2.5'	1.5'	0.5'	0'	0'		4	7'	5.5'	4.5'	3'	2'	4.5'	3'	2'	1'	0.5'
	5	7'	5.5'	4.5'	3'	2'	4.5'	3'	2'	1'	0.5'		5	10.5'	8.5'	7'	5.5'	4.5'	6.5'	5'	4'	3'	2'
	6	9.5'	7.5'	6'	5'	4'	6'	4.5'	3.5'	2.5'	1.5'		6	13.5'	11.5'	9.5'	8'	6.5'	9'	7'	5.5'	4.5'	3.5'
	7	12'	10'	8'	6.5'	5.5'	8'	6'	5'	3.5'	2.5'		7	16.5'	14'	12'	10'	8.5'	11'	9'	7.5'	6'	5'

Seismic Size Requirements			
Table L2a Moment Frame A		Table L2b Moment Frame B	
Ss	Size Allowed (cubic feet)	Ss	Size Allowed (cubic feet)
20%	1575	20%	2099
30%	1050	30%	1399
40%	852	40%	1135
50%	720	50%	960
60%	600	60%	800
70%	514	70%	685
80%	525	80%	700
90%	467	90%	622
100%	420	100%	560
110%	382	110%	509
120%	350	120%	466
130%	323	130%	431
140%	300	140%	400
150%	280	150%	373

Directions for using Seismic Table L2a, L2b, L2c or L2d*****

- Determine Tributary width
- Determine width of structure
- Determine height of structure
- Determine number of posts structure has
- Determine Ss for your area (contact your local building department)****
- Choose Table L2a-d based on the header
- Determine the maximum size allowed on the chart
- Multiply #1, #2 and #3 and divide by #4*****
- If #8 is lower than #7 the structure is OK for seismic
- If the Ss is over 150% but less than 215% use 150%

*no check needed for Patio Covers attached to slab under these conditions
 **no check needed for Patio Covers that are 10' tall attached to slab under these conditions
 ***no check needed for Patio Covers that are 8' tall attached to slab under these conditions
 ****Ss is the Maximum Considered Earthquake Ground Motion (0.2 sec) mapped on Figure 1613.3.1(1) in the 2018 IBC
 ***** Alternatively, divide by these numbers
 For 2 post Structures divide by 3
 For 3 post Structures divide by 3
 For 4 post Structures divide by 4.5
 For 5 post Structures divide by 6
 For all others add 1.5 to number of posts
 ***** Not for use in areas with flat roof snow loads exceeds 30 psf.

Moment Frame A: Detail L26, 4 screws, A=5", B= 7", sideplates = 0.024"
 Moment Frame A: Detail L12, 4 screws per header, A=2", B= 5", DBL HEADER
 Moment Frame A: Detail L8, 6 screws, A=2", B= 6", SINGLE STEEL C
 Moment Frame B: Detail L26, 4 screws, A=5", B= 7", sideplates = 0.032"
 Moment Frame B: Detail L26, 6 screws, A=5", B= 7", sideplates = 0.024"
 Moment Frame C: Detail L26, 8 screws, A=4", B= 6", sideplates = 0.024"
 Moment Frame C: Detail L12, 4 screws per header, A=2", B= 7", DBL HEADER
 Moment Frame C: Detail L12, 6 screws per header, A=2", B= 5", DBL HEADER
 Moment Frame C: Detail L8, 4 BOLTS, A=2", B= 7", SINGLE STEEL C
 Moment Frame C: Detail L8, 10 screws, A=2", B= 6", SINGLE STEEL C
 Moment Frame D: Detail L8, 4 BOLTS, A=2", B= 5", DBL STEEL C
 Moment Frame D: Detail L8, 6 screws per header, A=2", B= 6", DBL STEEL C

Tables L1 and L2 need to be checked for surface mount concrete attachment

Amerimax Exterior Home Products
 28921 US Hwy 74
 Romoland, CA 92585

Carl Putnam, P. E.
 3441 Ivylink Place
 Lynchburg, VA 24503



MAY 03 2019

7.0 Requirements for Surface Mounted Posts on Concrete Slabs or Footings for Sngle Span Attached Lattice Structures

REQUIRED NUMBER OF POSTS FOR SINGLE SPAN LATTICE UNITS WITH SURFACE MOUNTED POSTS ON CONCRETE SLABS OR FOOTINGS												
Table L1c: Use this table for the following headers Moment Frame C = 536 lbf*ft												
Wind Speed	Required Number of Posts	Post Height (ft)										
		Wind Exposure B					Wind Exposure C					
MAXIMUM TRIBUTARY WIDTH ALLOWED												
95 mph	2 or 3	12.5'	10.5'	9'	7'	6'	8.5'	6.5'	5.5'	4'	3'	
	4	20.5'	17.5'	15'	13'	11'	14'	11.5'	9.5'	8'	6.5'	
	5	24'	24'	21'	18.5'	16'	19.5'	16.5'	14'	12'	10'	
	6	24'	24'	24'	24'	21'	24'	21'	18.5'	16'	14'	
	7	24'	24'	24'	24'	24'	24'	24'	22.5'	20'	17.5'	
100 mph	2 or 3	11.5'	9.5'	7.5'	6'	5'	7.5'	6'	4.5'	3.5'	2.5'	
	4	18'	15.5'	13'	11'	9.5'	12'	10'	8.5'	7'	5.5'	
	5	24'	21.5'	18.5'	16'	14'	17'	14.5'	12.5'	10.5'	9'	
	6	24'	24'	24'	21'	18.5'	22'	19'	16'	14'	12'	
	7	24'	24'	24'	24'	23'	24'	23.5'	20'	17.5'	15.5'	
105 mph	2 or 3	10'	8'	6.5'	5'	4'	6.5'	5'	3.5'	2.5'	1.5'	
	4	16'	13.5'	11.5'	9.5'	8'	11'	9'	7.5'	6'	4.5'	
	5	22.5'	19'	16.5'	14.5'	12.5'	15.5'	13'	11'	9'	7.5'	
	6	24'	24'	21.5'	19'	16.5'	20'	17'	14.5'	12.5'	10.5'	
	7	24'	24'	24'	23.5'	20.5'	24'	21'	18'	15.5'	13.5'	
110 mph	2 or 3	9'	7'	5.5'	4.5'	3.5'	5.5'	4'	3'	2'	1'	
	4	14.5'	12'	10'	8.5'	7'	9.5'	8'	6.5'	5'	4'	
	5	20.5'	17.5'	15'	12.5'	11'	14'	11.5'	9.5'	8'	6.5'	
	6	24'	22.5'	19.5'	17'	14.5'	18'	15'	13'	11'	9'	
	7	24'	24'	24'	21'	18.5'	22'	18.5'	16'	14'	12'	
115 mph	2 or 3	8'	6.5'	5'	3.5'	2.5'	5'	3.5'	2.5'	1.5'	0.5'	
	4	13'	11'	9'	7.5'	6'	8.5'	7'	5.5'	4.5'	3'	
	5	18.5'	15.5'	13'	11.5'	9.5'	12.5'	10'	8.5'	7'	5.5'	
	6	23.5'	20'	17.5'	15'	13'	16'	13.5'	11.5'	9.5'	8'	
	7	24'	24'	21.5'	19'	16.5'	20'	17'	14.5'	12.5'	10.5'	
120 mph	2 or 3	7'	5.5'	4'	3'	2'	4.5'	3'	2'	1'	0.5'	
	4	12'	10'	8'	6.5'	5.5'	7.5'	6'	5'	3.5'	2.5'	
	5	16.5'	14'	12'	10'	8.5'	11'	9'	7.5'	6'	5'	
	6	21.5'	18.5'	15.5'	13.5'	11.5'	14.5'	12'	10'	8.5'	7'	
	7	24'	22.5'	19.5'	17'	15'	18'	15'	13'	11'	9.5'	
130 mph	2 or 3	5.5'	4.5'	3'	2'	1'	3.5'	2'	1.5'	0.5'	0'	
	4	9.5'	8'	6.5'	5'	4'	6'	5'	3.5'	2.5'	1.5'	
	5	14'	11.5'	9.5'	8'	6.5'	9'	7.5'	6'	4.5'	3.5'	
	6	18'	15'	13'	11'	9.5'	12'	10'	8'	6.5'	5.5'	
	7	22'	19'	16'	14'	12'	15'	12.5'	10.5'	9'	7.5'	
140 mph	2 or 3	4.5'	3.5'	2'	1.5'	0.5'	2.5'	1.5'	0.5'	0'	0'	
	4	8'	6.5'	5'	4'	3'	5'	3.5'	2.5'	1.5'	1'	
	5	11.5'	9.5'	8'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'	
	6	15'	12.5'	10.5'	9'	7.5'	10'	8'	6.5'	5.5'	4'	
	7	18.5'	16'	13.5'	11.5'	9.5'	12.5'	10.5'	8.5'	7'	6'	

Seismic Size Requirements			
Table L2c		Table L2d	
Moment Frame C		Moment Frame D	
Ss	Size Allowed (cubic feet)	Ss	Size Allowed (cubic feet)
20%	2301	20%	3559
30%	1534	30%	2372
40%	1244	40%	1924
50%	1052	50%	1627
60%	877	60%	1356
70%	751	70%	1162
80%	767	80%	1186
90%	682	90%	1054
100%	614	100%	949
110%	558	110%	863
120%	511	120%	791
130%	472	130%	730
140%	438	140%	678
150%	409	150%	633

Directions for using Seismic Table L2a, L2b, L2c or L2d*****

- Determine Tributary width
- Determine width of structure
- Determine height of structure
- Determine number of posts structure has
- Determine Ss for your area (contact your local building department)****
- Choose Table L2a-d based on the header
- Determine the maximum size allowed on the chart
- Multiply #1, #2 and #3 and divide by #4*****
- If #8 is lower than #7 the structure is OK for seismic
- If the Ss is over 150% but less than 215% use 150%

*no check needed for Patio Covers attached to slab under these conditions
 **no check needed for Patio Covers that are 10' tall attached to slab under these conditions
 ***no check needed for Patio Covers that are 8' tall attached to slab under these conditions
 ****Ss is the Maximum Considered Earthquake Ground Motion (0.2 sec) mapped on Figure 1613.3.1(1) in the 2018 IBC
 ***** Alternatively, divide by these numbers
 For 2 post Structures divide by 3
 For 3 post Structures divide by 3
 For 4 post Structures divide by 4.5
 For 5 post Structures divide by 6
 For all others add 1.5 to number of posts
 ***** Not for use in areas with flat roof snow loads exceeds 30 psf.

Moment Frame A: Detail L26, 4 screws, A=5", B= 7", sideplates = 0.024"
 Moment Frame A: Detail L12, 4 screws per header, A=2", B= 5", DBL HEADER
 Moment Frame A: Detail L8, 6 screws, A=2", B= 6", SINGLE STEEL C
 Moment Frame B: Detail L26, 4 screws, A=5", B= 7", sideplates = 0.032"
 Moment Frame B: Detail L26, 6 screws, A=5", B= 7", sideplates = 0.024"
 Moment Frame C: Detail L26, 8 screws, A=4", B= 6", sideplates = 0.024"
 Moment Frame C: Detail L12, 4 screws per header, A=2", B= 7", DBL HEADER
 Moment Frame C: Detail L12, 6 screws per header, A=2", B= 5", DBL HEADER
 Moment Frame C: Detail L8, 4 BOLTS, A=2", B= 7", SINGLE STEEL C
 Moment Frame C: Detail L8, 10 screws, A=2", B= 6", SINGLE STEEL C
 Moment Frame D: Detail L8, 4 BOLTS, A=2", B= 5", DBL STEEL C
 Moment Frame D: Detail L8, 6 screws per header, A=2", B= 6", DBL STEEL C


Tables L1 and L2 need to be checked for surface mount concrete attachment

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503



MAY 03 2019

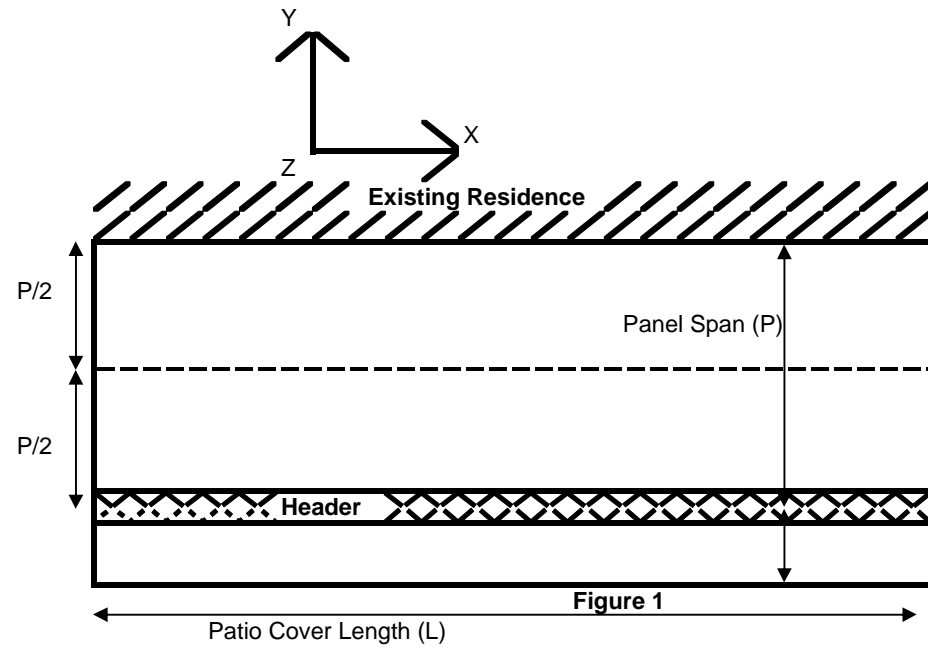

Kz	0.7	0.98	height factor, Exposure B and C
Kzt	1		Topographic factor
Kd	0.85		Wind Directionality factor
I	1		Importance Factor
GCP net (up)	1.28		Net Pressure Coefficient uplift
GCP net(down)	0.78		Net Pressure Coefficient down
Dead	1		psf

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
(434) 384-2514
carlputnam@comcast.net



Wind Speed (mph)	Exposure	qh (psf)	Design Wind	Design Wind
			Down Load (psf) 0.6xW+	Up Load (psf) 0.6xW-
95	B	13.7	9.6	10.6
100	B	15.2	9.6	11.7
105	B	16.8	9.6	12.9
110	B	18.4	9.6	14.2
115	B	20.1	9.6	15.5
120	B	21.9	10.3	16.8
130	B	25.7	12.0	19.8
140	B	29.9	14.0	22.9
150	B	34.3	16.0	26.3
160	B	39.0	18.2	29.9
170	B	44.0	20.6	33.8
95	C	19.2	9.6	14.8
100	C	21.3	10.0	16.4
105	C	23.5	11.0	18.1
110	C	25.8	12.1	19.8
115	C	28.2	13.2	21.7
120	C	30.7	14.4	23.6
130	C	36.0	16.9	27.7
140	C	41.8	19.6	32.1
150	C	48.0	22.5	36.8
160	C	54.6	25.5	41.9
170	C	61.6	28.8	47.3

TABLE 1

Determine Snow Loads on Existing Structure

- 1 Determine Roof Snow/Live Load, S. See General Note 3.
- 2 Dead Load = 1 psf
- 3 Add Dead and Live/Snow Loads, multiply by half of Panel Span
Wall Load = (D + S) P / 2
- 4 Result is wall load in pounds per linear foot.

Determine Wind Loads on Existing Structure

- 1 Determine Wind Load, W+ or W-. See Table 1
- 2 Add 1 psf to down load, subtract 0.6 psf from up load
- 3 Multiply W+ or W- by half of Panel Span
Wall Load = W P / 2
- 4 Result is wall load in pounds per linear foot.
- 5 Maximum Shear Load in X direction is 497 lbf (170 mph Exposure C, 12'-11" Panel Span)
Max load in Y direction (towards house) is 77 plf (170 mph Exp C, 10" I beam)
Max load in Y direction due to force couple resisting lateral is 108 plf (170 mph Exp C, Projection = Width)

Determine Seismic Loads on Existing Structure (Excludes Roof Snow Load over 30 psf)

- 1 Vertical Loads and Horizontal Loads = maximum of 1 psf

Combination Loads based on Equation 16-11

- 1 Determine Combination Load, C. See Table 2
- 3 Multiply C by half of Panel Span
Wall Load = C P / 2
- 4 Result is wall load in pounds per linear foot.

Wind Speed (mph)	Exposure	Combination Loads: Snow + Wind + Dead Loads								
		Live Loads (psf)		Ground Snow Loads (psf)						
		10	20	15	25	30	35.7	42	50	60
Roof Live /Snow Loads		10	20	15	21	25.2	30.0	35.3	42	50.4
95	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
100	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
105	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
110	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
115	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
120	B	16.2	23.7	19.9	24.4	27.6	31.2	35.2	40.2	46.5
130	B	17.5	25.0	21.3	25.8	28.9	32.5	36.5	41.5	47.8
140	B	19.0	26.5	22.7	27.2	30.4	34.0	37.9	43.0	49.3
150	B	20.5	28.0	24.3	28.8	31.9	35.5	39.5	44.5	50.8
160	B	22.2	29.7	25.9	30.4	33.6	37.2	41.1	46.2	52.5
170	B	24.0	31.5	27.7	32.2	35.4	38.9	42.9	48.0	54.3
95	C	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
100	C	16.0	23.5	19.7	24.2	27.4	31.0	34.9	40.0	46.3
105	C	16.8	24.3	20.5	25.0	28.2	31.7	35.7	40.8	47.1
110	C	17.6	25.1	21.3	25.8	29.0	32.5	36.5	41.6	47.9
115	C	18.4	25.9	22.1	26.6	29.8	33.4	37.4	42.4	48.7
120	C	19.3	26.8	23.0	27.5	30.7	34.3	38.2	43.3	49.6
130	C	21.1	28.6	24.9	29.4	32.5	36.1	40.1	45.1	51.4
140	C	23.2	30.7	26.9	31.4	34.6	38.2	42.1	47.2	53.5
150	C	25.3	32.8	29.1	33.6	36.7	40.3	44.3	49.3	55.6
160	C	27.7	35.2	31.4	35.9	39.1	42.7	46.6	51.7	58.0
170	C	30.1	37.6	33.9	38.4	41.5	45.1	49.1	54.1	60.4

TABLE 2

Amerimax Structural Properties of Beams, Fascia, Panels and Rafters for Use by Design Professionals

Structural Element	I (in ⁴) top in compression	I (in ⁴) bottom in compression	ASSUMES FULL LATERAL BRACING		Max Allowable Shear (lbf)	Material	E (ksi)	Ftu or Fu (ksi)	Fty or Fy (ksi)	Fcy (ksi)
			Max Allowable Moment (top in compression) (lbf*ft)	Max Allowable Moment (bottom in compression) (lbf*ft)						
Rafters										
0.024"x2"x6.625" Aluminum Rafter	2.283	same	298	278	166	3004H34	10100	32	25	22
0.032"x2"x6.625" Aluminum Rafter	3.072	same	563	504	398	3004H34	10100	32	25	22
0.040"x2"x6.625" Aluminum Rafter	3.873	same	866	801	784	3004H34	10100	32	25	22
0.042"x3"x8" Aluminum Rafter	7.907	same	1164	1038	747	3004H34	10100	32	25	22
0.024"x3"x3" Aluminum Rafter	0.445	same	130	124	380	3105H25	10100	23	19	17
0.040"x3"x3" Aluminum Rafter	0.754	same	389	343	1506	3105H25	10100	23	19	17
Solid Panels										
0.018"x2.5"x6" Aluminum Panel	0.265	same	138	109	779	3004H36	10100	35	28	25
0.024"x2.5"x6" Aluminum Panel	0.353	same	253	169	927	3004H34	10100	32	25	22
0.032"x2.5"x6" Aluminum Panel	0.471	same	385	253	1236	3004H34	10100	32	25	22
0.036"x2.5"x6" Aluminum Panel	0.53	same	439	301	1391	3004H34	10100	32	25	22
0.018"x3.5"x12" Aluminum Panel	0.545	same	316	352	450	3004H36	10100	35	28	25
0.024"x3.5"x12" Aluminum Panel	0.727	same	409	473	536	3004H34	10100	32	25	22
0.032"x3.5"x12" Aluminum Panel	0.969	same	568	692	715	3004H34	10100	32	25	22
0.036"x3.5"x12" Aluminum Panel	1.09	same	652	808	804	3004H34	10100	32	25	22
0.018"x2.5"x12" Aluminum Panel	0.25	same	184	141	246	3004H36	10100	35	28	25
0.024"x2.5"x12" Aluminum Panel	0.334	same	315	241	584	3004H36	10100	35	28	25
0.032"x2.5"x12" Aluminum Panel	0.445	same	484	371	1384	3004H36	10100	35	28	25
0.036"x2.5"x12" Aluminum Panel	0.501	same	511	392	1970	3004H34	10100	32	25	22
0.018"x2"x6" Aluminum Panel	0.154	same	133	150	528	3004H36	10100	35	28	25
0.024"x2"x6" Aluminum Panel	0.205	same	196	207	629	3004H34	10100	32	25	22
0.032"x2"x6" Aluminum Panel	0.273	same	294	318	838	3004H34	10100	32	25	22
0.036"x2"x6" Aluminum Panel	0.307	same	333	382	943	3004H34	10100	32	25	22
Aluminum Headers										
0.042"x3"x8" Aluminum Header	7.907	same	1164	1038	747	3004H34	10100	32	25	22
Double 0.042"x3"x8" Aluminum Header	15.814	same	2328	2076	1494	3004H34	10100	32	25	22
Double 0.040"x2"x6.625" Aluminum Header	7.746	same	1732	1602	1568	3004H34	10100	32	25	22
Aluminum Fascia										
California Extruded Fascia	3.09	same	1160	1536	5478	6063T6	10100	30	25	25
Classic Extruded Fascia	6.03	same	3089	3842	13837	6061T6	10100	38	35	35
5.5" Extruded Fascia	3.46	same	1564	1538	3414	6105T5	10100	38	35	35
Alaskan Fascia	3.95	same	2349	1905	4963	6105T5	10100	38	35	35
4"x3" Ibeam	3.617	same	2445	2580	2106	6063T6	10100	30	25	25
7"x4" Ibeam	13.857	same	6718	6718	4244	6105T5	10100	38	35	35
Steel Headers										
0.041"x3"x3" Steel Cloverleaf	0.77	same	1028	1028	6694	ASTM A653 Grade 40	29000	55	40	
Double 0.041"x3"x3" Steel Cloverleaf	1.54	same	2056	2056	13388	ASTM A653 Grade 40	29000	55	40	
12 Gauge Steel C Beam	13.28	same	8549	8549	11504	ASTM A653 Grade 50	29000	65	50	
14 Gauge Steel C Beam	9.04	same	5821	5821	4029	ASTM A653 Grade 50	29000	65	50	
16 Gauge Steel C Beam	7.46	same	4805	4805	2394	ASTM A653 Grade 50	29000	65	50	
Double 12 Gauge Steel C Beam	26.56	same	17098	17098	23008	ASTM A653 Grade 50	29000	65	50	
Double 14 Gauge Steel C Beam	18.08	same	11642	11642	8058	ASTM A653 Grade 50	29000	65	50	
Double 16 Gauge Steel C Beam	14.92	same	9610	9610	4788	ASTM A653 Grade 50	29000	65	50	




Misc7-2018

CONSTRAINED FOOTING SIZE d (IN)	REQUIRED SLAB AREA PER POST (SQUARE FEET)			
	3.5"	5.5"	7.25"	9.25"
20	26	17	13	10
21	31	20	15	12
22	36	23	17	14
23	41	26	20	16
24	47	30	23	18
25	54	34	26	20
26	61	39	30	23
27	70	44	34	26
28	78	50	38	30
29	88	56	42	33
30	98	63	48	37
31	110	70	53	41
32	122	78	59	46
33	135	86	65	51
34	149	95	72	56
35	164	104	79	62
36	180	115	87	68
37	198	126	95	75
38	216	137	104	82
39	236	150	114	89
40	257	163	124	97
41	279	178	135	106
42	303	193	146	114
43	328	208	158	124
44	354	225	171	134
45	382	243	185	145
46	412	262	199	156
47	443	282	214	168
48	476	303	230	180
49	511	325	247	193
50	547	348	264	207

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503

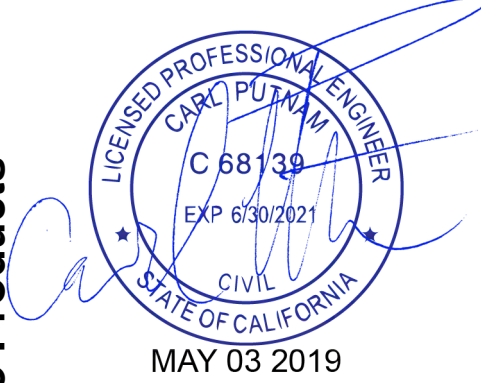

MAY 03 2019

Misc8-2018